

V28/33D STC

Project Guide – Marine

Four-stroke diesel engine compliant with IMO Tier III

Four-stroke diesel engine

V28/33D STC IMO Tier III Project Guide – Marine

Revision..... **06.2025/6.2**

2026-02-24 - 6.2

While remaining the same legal entity, MAN Energy Solutions has been re-named to Everllence and its products are being rebranded from “MAN” and/or “MAN Energy Solutions” to “Everllence”. As this is an ongoing process, any reference to “MAN” and/or “MAN Energy Solutions” is actually a reference to “Everllence”.

All data provided in this document is non-binding. This data serves informational purposes only and is especially not guaranteed in any way. Depending on the subsequent specific individual projects, the relevant data may be subject to changes and will be assessed and determined individually for each project. This will depend on the particular characteristics of each individual project, especially specific site and operational conditions.

Everllence SE
86224 Augsburg
GERMANY

Phone +49 (0) 821 322-0
Fax +49 (0) 821 322-3382
www.everllence.com

Copyright © 2025 Everllence
All rights reserved, including reprinting, copying (Xerox/microfiche) and translation.

Table of contents

1	Introduction	9
1.1	Medium-speed propulsion engine programme	9
1.2	Engine description IMO Tier III	9
1.3	Engine overview and SCR system components.....	19
1.4	Turbocharger overview.....	21
1.4.1	View of a TCA type turbocharger	21
1.4.2	Compensator between turbine outlet (engine) and exhaust gas pipe (plant)	22
1.4.3	No additional masses allowed	23
2	Engine and operation	25
2.1	Approved applications and destination/suitability of the engine.....	25
2.2	Certification IMO Tier III	26
2.3	Engine design.....	28
2.3.1	Engine cross section	28
2.3.2	Engine designations – Design parameters	29
2.3.3	Turbocharger assignments	29
2.3.4	Engine main dimensions, weights and views	30
2.3.5	Main dimensions, weights and views of SCR components	31
2.3.6	Engine inclination.....	35
2.3.7	Engine equipment for various applications	36
2.4	Ratings (output) and speeds	40
2.4.1	General remark.....	40
2.4.2	Standard engine ratings	40
2.4.3	Power definition and load profile	41
2.4.4	Engine ratings (output) for different applications.....	43
2.4.5	Derating, definition of P Operating	43
2.4.6	Engine speeds and related main data.....	44
2.4.7	Speed adjusting range.....	45
2.5	Increased exhaust gas pressure due to exhaust gas after treatment installations	45
2.6	Starting.....	47
2.6.1	General remarks.....	47
2.6.2	Type of engine start.....	47
2.6.3	Requirements on engine and plant installation	48
2.6.4	Starting conditions	49
2.6.5	Start-up – Definitions and requirements.....	50
2.7	Low-load operation.....	51
2.7.1	Low-load operation V28/33D STC.....	51
2.8	Engine load reduction and engine stop	53
2.9	Engine load reduction as a protective safety measure	55
2.10	Engine operation under arctic conditions.....	57
2.11	Earthing measures of diesel engines.....	61

2.12	Propeller operation	63
2.12.1	STC operating range for mechanical propulsion (FPP, water jet, CPP)	63
2.12.2	General requirements for the CPP propulsion control	65
2.12.3	General requirements for the FPP propulsion control	67
2.12.4	Load application for mechanical propulsion (FPP and CPP)	68
2.13	Fuel oil, urea, lube oil, starting air and control air consumption	71
2.13.1	Fuel oil consumption for emission standard: IMO Tier III	71
2.13.2	Urea consumption for emission standard IMO Tier III	74
2.13.3	Lube oil consumption	75
2.13.4	Compressed air consumption – SCR system	76
2.13.5	Starting air and control air consumption	77
2.13.6	Recalculation of fuel consumption dependent on ambient conditions	78
2.13.7	Influence of engine aging on fuel consumption	79
2.14	Planning data 455 kW/cyl., CPP/FPP, IMO Tier II	79
2.14.1	Nominal values for cooler specification – 455 kW/cyl., CPP/FPP	79
2.14.2	Flow scheme for cooler specification – 455 kW/cyl., CPP/FPP	81
2.14.3	Temperature basis, nominal air and exhaust gas data – 455 kW/cyl., CPP/FPP	82
2.14.4	Load specific values at ISO conditions – 455 kW/cyl., CPP/FPP	83
2.14.5	Load specific values at tropical conditions – 455 kW/cyl., CPP/FPP	84
2.15	Planning data 500 kW/cyl., CPP/FPP, IMO Tier II	85
2.15.1	Nominal values for cooler specification – 500 kW/cyl., CPP/FPP	85
2.15.2	Flow scheme for cooler specification – 500 kW/cyl., CPP/FPP	86
2.15.3	Temperature basis, nominal air and exhaust gas data – 500 kW/cyl., CPP/FPP	87
2.15.4	Load specific values at ISO conditions – 500 kW/cyl., CPP/FPP	88
2.15.5	Load specific values at tropical conditions – 500 kW/cyl., CPP/FPP	89
2.16	Operating/service temperatures and pressures	90
2.17	Leakage rate	96
2.18	Filling volumes	97
2.19	Venting amount of crankcase and turbocharger	97
2.20	Exhaust gas emission	98
2.20.1	Maximum permissible NOx emission limit value IMO Tier II and IMO Tier III	98
2.20.2	Smoke emission index (FSN)	98
2.20.3	Exhaust gas – possible components and visibility	99
2.20.4	Emission-related installation instruction for engines	101
2.21	Noise	104
2.21.1	Airborne noise	104
2.21.2	Intake noise	104
2.21.3	Exhaust gas noise	105
2.21.4	Blow-off noise example	107
2.21.5	Noise and vibration – Impact on foundation	107
2.22	Vibration	110
2.22.1	Torsional vibrations	110
2.23	Requirements for power drive connection (static)	113
2.23.1	Limit values of masses to be coupled after the engine	113
2.23.2	10% PTO – Maximum torque and requirements screw connection	114

2.24	Requirements for power drive connection (dynamic)	114
2.24.1	Moments of inertia – Crankshaft, damper, flywheel	114
2.24.2	Balancing of masses – Firing order	116
2.24.3	Static torque fluctuation	117
2.25	Power transmission	119
2.25.1	Flywheel arrangement	119
2.26	Foundation	120
2.26.1	General requirements for engine foundation	120
2.26.2	Resilient mounting position	121
2.26.3	Resilient seating	122
3	Data Logging Solutions	125
3.1	Data Logging - General Information	125
3.2	Data Logging Cabinet Plus (DLC+)	125
3.3	Data Logging - Additional Information	126
4	Engine automation	129
4.1	SaCoS 5000 system overview	129
4.1.1	Cybersecurity guidelines	130
4.1.1.1	Terms, abbreviations and definitions	130
4.1.1.2	System Overview	132
4.1.1.3	Physical security of SaCoS	133
4.1.1.4	Secure access and storage of SaCoS data	133
4.1.1.5	Secure use of the ExG-MM in the DLC+	133
4.1.1.6	Securing Z1:Control(Customer)	133
4.1.1.7	Maintaining network segmentation	134
4.1.1.8	Preparation for security incidents	134
4.1.1.9	Safe disposal	134
4.1.1.10	User account management	134
4.1.1.11	Security Incident Report	135
4.1.2	Equipment on engine and off engine	135
4.2	Power supply and distribution	142
4.3	Operation	144
4.4	Functionality	145
4.5	Interfaces	147
4.6	Technical data	148
4.7	Installation requirements	149
4.8	Engine-located measuring and control devices	151
5	Specification for engine supplies	159
5.1	Specification of lubricating oil for operation with DMA, DFA	159
5.2	Diesel fuel (DMA, DFA) specification	160
5.3	Specification of engine coolant	165
5.4	Cooling water inspecting	169
5.5	Cooling water system cleaning	170

5.6	Specification of intake air (combustion air)	172
5.7	Specification of compressed air	173
5.8	Specification of urea solution	174
6	Engine supply systems	177
6.1	3D Engine Viewer – A support programme to configure the engine room	177
6.2	Basic principles for pipe selection	179
6.2.1	External pipe dimensioning	179
6.2.2	Engine pipe connections and dimensions	180
6.2.3	Specification of materials for piping	181
6.2.4	Installation of flexible pipe connections	183
6.2.5	Condensate amount in charge air pipes and air vessels.....	189
6.3	SaCoS Engine Room Automation	191
6.3.1	SaCoS ERA system overview	191
6.3.2	Cybersecurity guidelines	194
6.3.2.1	Terms, abbreviations, and definitions	194
6.3.2.2	System overview	195
6.3.2.3	Physical security of SaCoS	196
6.3.2.4	Secure access and storage of SaCoS data	196
6.3.2.5	Securing Z1:Control(Customer).....	196
6.3.2.6	Maintaining network segmentation.....	196
6.3.2.7	Preparation for security incidents	197
6.3.2.8	Safe disposal.....	197
6.3.2.9	User account management	197
6.3.2.10	Security incident report.....	197
6.3.3	Power supply	197
6.3.4	Interfaces	198
6.3.5	Technical data.....	199
6.3.6	Installation requirements	199
6.4	Lube oil system	199
6.4.1	Internal lube oil system	199
6.4.2	External lube oil system	205
6.4.3	Prelubrication/postlubrication	211
6.4.4	Lube oil filling and outlets.....	211
6.5	Crankcase vent	212
6.6	Water systems	214
6.6.1	Cooling water system description.....	214
6.6.2	Internal LT cooling water system	216
6.6.3	External LT cooling water system	218
6.6.4	Internal HT cooling water system.....	219
6.6.5	External HT cooling water system.....	219
6.6.6	Internal seawater system	220
6.6.7	External seawater system	220
6.6.8	External cooling water system diagram.....	221
6.6.9	External cooling water collecting and supply system.....	223
6.6.10	Miscellaneous items	223

6.6.11	Water pump performance	224
6.7	Fuel oil system	224
6.7.1	DMA supply system description	224
6.7.2	Internal fuel oil supply system	224
6.7.3	External fuel oil supply system	227
6.8	Compressed air system	231
6.8.1	Compressed air system description.....	231
6.8.2	Internal compressed air system	232
6.8.3	External compressed air system	233
6.8.4	External compressed air system – Dimensioning starting air receivers, compressors.....	235
6.9	Engine room ventilation and intake air	237
6.9.1	External general information	237
6.9.2	External air supply with or without arctic conditions	238
6.10	Exhaust gas system.....	243
6.10.1	External exhaust gas system – General information	243
6.10.2	External components and assemblies of the exhaust gas system	246
6.11	SCR system	246
6.11.1	General	246
6.11.2	As-delivered conditions and packaging	247
6.11.3	Transportation and handling	247
6.11.4	Storage	247
6.11.5	Components and assemblies of the SCR system	248
6.11.6	Installation of the SCR system	251
6.11.7	Recommendations	251
7	Engine room planning	253
7.1	Installation and arrangement.....	253
7.1.1	General details	253
7.1.2	Installation drawings	254
7.1.3	Removal dimensions	257
7.1.4	3D Engine Viewer – A support programme to configure the engine room	263
7.1.5	Lifting device	265
7.1.6	Space requirement for maintenance	268
7.1.7	Major spare parts	268
7.1.8	Major spare parts – Main dimensions	271
7.1.9	Mechanical propulsion system arrangement	276
7.2	Exhaust gas ducting	277
7.2.1	Example: Ducting arrangement	277
7.2.2	External general details for Tier III SCR system duct arrangement.....	277
7.2.3	Position of the outlet casing of the turbocharger	279
8	Annex	281
8.1	Safety instructions and necessary safety measures	281
8.1.1	General	281
8.1.2	Safety equipment and measures provided by plant-side.....	281
8.2	Programme for Factory Acceptance Test (FAT)	286

8.3	Engine running-in	292
8.4	Definitions	295
8.5	Abbreviations	300
8.6	Symbols	301
8.7	Preservation, packaging, storage	304
8.7.1	General	304
8.7.2	Storage location and duration	306
8.7.3	Follow-up preservation when preservation period is exceeded	306
8.7.4	Removal of corrosion protection	307
8.8	Engine colour	307
Index		309

1 Introduction

1.1 Medium-speed propulsion engine programme

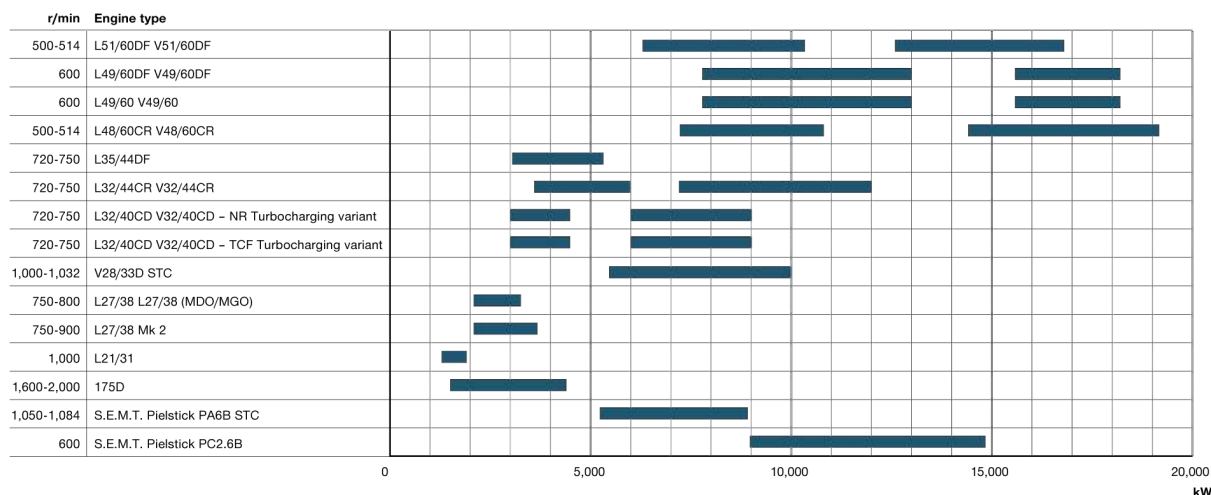


Figure 1: Everllence engine programme

1.2 Engine description IMO Tier III

Simplicity and functionality

The 280 mm-bore/330 mm-stroke V28/33D STC engine with its simple and functional design is known for:

- High reliability
- Low fuel consumption
- Low operating costs
- High operating efficiency at low and high powers
- Low acoustic and thermal signature characteristics
- Capable of extended operation at low loads without white smoke or maintenance impact
- Optimum power-to-weight and power-to-size ratios
- Ease of installation and maintenance

NO_x emission IMO Tier II/IMO Tier III

The engine V28/33D STC meets the NO_x emission limit IMO Tier II. Everllence can only deliver an IMO Tier III certificate and act as "applicant" (within the meaning of the IMO) if the engine plus SCR is supplied by Everllence.

Fuel injection

An advanced microprocessor-managed, solenoid valve-controlled fuel injection system secures flexible and precise control of the injection quantity, rate and timing independent of engine speed.

With the advanced combustion chamber technology the specific fuel consumption is reduced to a competitive level. The large torque envelope of STC engines reduces fuel consumption by optimising the propeller efficiency.

Operation with FAME - transesterified biofuel (optional)

In case of intended use of FAME fuels according to EN-14214 or ASTM D6751 and according to the additional requirements of Everlence (see paragraph [FAME \(fatty acid methyl ester\) additive of 0.5 to 100% \(DFA\), Page 163](#) in section Diesel fuel (DMA, DFA) specification).

- Special considerations for fuel handling, storage and fuel preparation to be considered
- To be clarified, if special equipment on engine or within plant is needed
- Change of engine performance to be clarified

Contact Everlence if this option is needed.

Operation with synthetic fuels (optional)

Synthetic fuels such as HVO, BTL, CTL, GTL according to DIN EN 15940 differ in the procedure of production, but are identical in their fuel properties and need to comply to the requirements of Everlence (see paragraph "Synthetic fuels (DIN EN 15940)" in section Diesel fuel (DMA, DFA) specification).

In case of intended use of these synthetic diesel fuels:

- Special considerations for fuel handling, storage and fuel preparation have to be considered
- To be clarified, if special equipment on engine or within plant is needed
- Change of engine performance to be clarified

Due to the lower volumetric heat value than DMA in case of fixed engine setting a minor increase of the specific fuel consumption ($\Delta be_{42700,ISO} < +1,5\%$), and a slight decrease of NO_x-emissions is expected.

Contact Everlence if this option is needed.

Crankcase

Machined from a spheroidal graphite iron casting and featuring underslung main bearings which are retained by two vertical studs and two cross-bolts per side for overall engine stiffness. The main bearing caps are secured by hydraulically-tensioned studs to ensure maximum integrity of the crankshaft system.

Oil sump

There are two oil sump designs available, allowing different inclinations. Contact Everlence for detailed information.

Cylinder liners

Individual units machined from a centrifugal-spun grey iron casting and incorporating deep flanges that are cooled by a separate cast-aluminium water jacket enabling a dry crankcase. The liners are secured in position in the crankcase by the cylinder heads, and their running surfaces are plateau honed and finished to improve oil retention. A flame ring fitted at the top of the liner prevents the build-up of combustion residues (coke) on the piston crowns and minimises lubricating oil consumption.

Crankshaft

A new strengthened design ensures reduced stresses and improved lubrication via optimised drillings. It is machined from a high tensile NiCrMo continuous grain-flow steel forging and fitted with two bolt-on balance weights per throw. A solid camshaft drive gear is bolted to a flange at the free end that also incorporates a taper to which the vibration damper is fitted.

Main power drive at counter coupling side (100% PTO, optional)

As a standard the main power drive connection is placed at coupling side. Optionally to provide better customer flexibility in engine arrangement, the main power drive is also available on free end side below turbochargers. This option is available for 12V and 16V engine.

Power take off for auxiliaries at counter coupling side (auxiliary PTO, optional)

If the main power drive connection is placed at coupling side, optionally an auxiliary PTO at counter coupling side can be used, to drive for example, a fire fighting pump. This option is available for 12V, 16V, and 20V engine. Hereby the maximum available output of the engine has to be considered.

Main and connecting rod bearings

Generously dimensioned, precision made, extended life, easily replaceable, thin wall, steel-backed aluminum-tin shells.

Camshafts

Of modular design, comprising one cam element and one bearing journal per engine cylinder, assembled through side access doors and mounted on each side of the engine. Large cam base circles are employed together with large bearings to reduce operating stresses. Housed in the crankcase, the two hollow camshafts incorporate the oil supply gallery to the engine and bearings.

Engine driven pumps for easy installation

Lube oil pump, fuel oil supply pump, HT cooling water pump, LT cooling water pump and seawater pump are all as a standard installed and engine driven from the flywheel counter side of the engine to simplify the installation.

Pistons

A two-piece design with a lightweight body and alloy steel crown, and a three-piece pack comprising two chrome-ceramic compression rings and an oil control ring. The casehardened gudgeon pin is fully floating and retained by a circlip at each end. Lubricating oil is fed from the connecting rod through drillings in the gudgeon pin and piston to a cooling chamber in the piston crown. The oil is then discharged through drillings in the underside of the crown back to the sump.

Connecting rods

This straight cut design ensures high reliability, good engine balancing, and low vibrations. It is manufactured from a one-piece alloy steel forging, and the partially grooved lead bronze bearing shell is carried in straight cut big ends

with each cap secured by four hydraulically-tensioned studs and nuts. The stepped small end features a steel-backed lead/bronze bush, and all bearing pressures are kept at a minimum.

Cylinder heads

Machined from a spheroidal graphite iron casting with a thick combustion face incorporating coolant drillings. The two inlet and two exhaust valves, the latter with cooled seats, are arranged around the central fuel injector.

Twin inlet ports connect directly to the air manifold, while a single tandem exhaust port exits from the top face for ease of maintenance. Each pair of valves is operated via short push rods and conventional rocker arms from the camshaft via followers of the roller bucket tappet type mounted in a separate casing bolted to the crankcase.

Camshaft drive

Located at the free end of the engine and comprising a solid gear bolted to the crankshaft driving a compound idler gear for each cylinder bank, which in turn drive the two camshafts. All gear spindles are supported both sides of the gear by the crankcase.

Air manifolds

This single-element air manifold of symmetrical design is made of GGG40. It is mounted down the vee of the crankcase, and incorporating passages for the lubricating oil and water systems.

Intercooler

A cylindrical two-stage unit contained in a casing that includes part of the inlet ducting; the assembly is mounted directly on top of the air manifold.

Lube oil filter

Mounted at flywheel side of the engine including the lube oil filter and oil cooler.

Duplex filter system: Aluminium design with duplex paper oil filter cartridges allowing switch over during engine operation.

Also an automatic lube oil filter available: Cast iron design with integrated thermostat and a centrifugal oil separator.

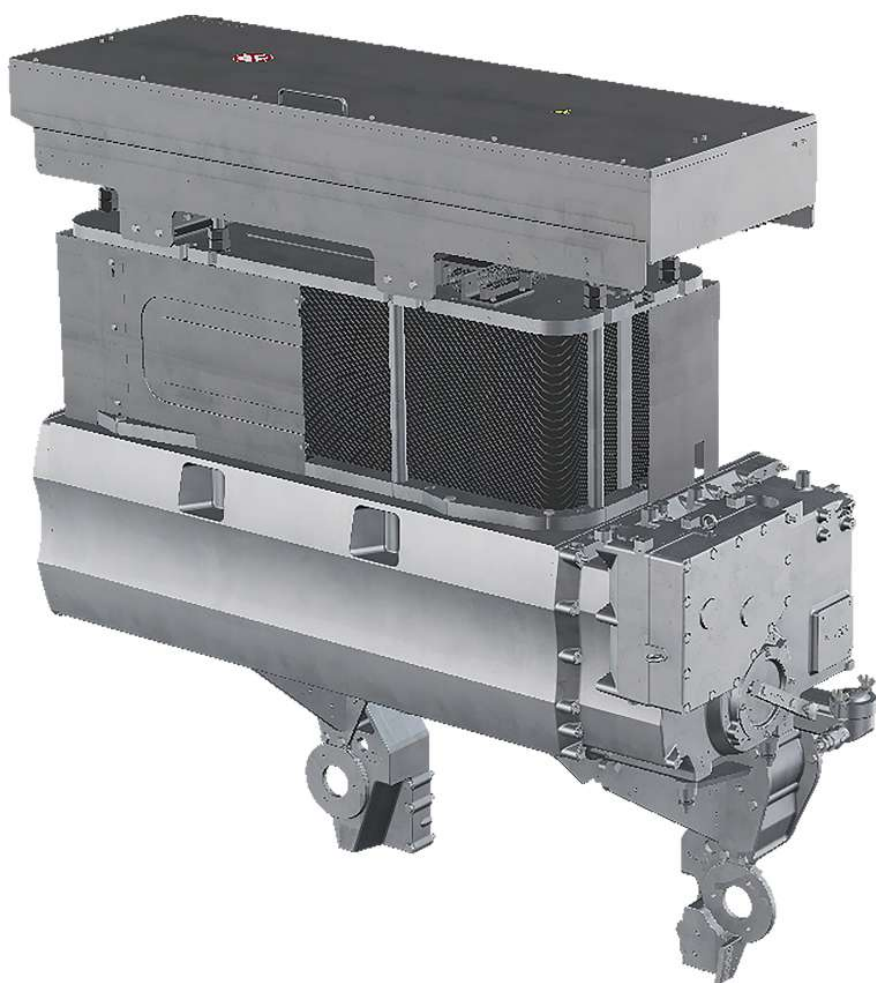


Figure 2: Oil cooler with mounted lube oil duplex filter



Figure 3: Oil cooler with mounted lube oil automatic filter

Turbocharging

Twin axial-flow Everlence turbochargers are mounted on a cast iron bracket at the free end of the engine. Developed specifically for the V28/33D STC engine, the high efficiency and compact Everlence TCA33 turbocharger features angled turbine inlet casings designed to match the engine exhaust in terms of interfaces and gas flow optimisation. Each turbocharger uses the same inlet casing, which is simply rephased to the opposite angle.

High efficiency at full and part loads from the turbocharging system yields a substantial charge air surplus and thorough combustion without residues. A requirement for the engine to fit compact machinery rooms resulted in a new turbine outlet casing design. Detailed analysis and design achieved very low pressure losses in the connection itself and in the downstream exhaust duct.

A single turbocharger frame size covers all cylinder configurations, making interfaces common across the engine range; and installation is standardised without compromising performance and efficiency.



Figure 4: Generic illustration of a Everllence TCA turbocharger

Sequential turbocharging

The sequentially turbocharging (STC) offers optimised engine-turbocharger matching for high torque at low rpm with reduced fuel consumption, smoke and noise. The system incorporates two identical standard Everllence TCA33 turbochargers: One alone supplies sufficient charge air in low and medium speed running modes; the second unit cuts in to boost charging at higher speeds.

A digital control system is programmed to automatically switch off one turbocharger at low rpm, increasing the amount of air reaching the combustion chambers.

An extended torque envelope yielding economical operating modes and improved engine acceleration characteristics from STC versions are particularly valued for naval propulsion applications. High torque at low power is particularly useful when towing another vessel.



Figure 5: V28/33D STC system

Extended low-load operation

With STC, the V28/33D STC engine has the capability to operate for extended periods at low-load conditions without visible smoke exhaust emissions or negatively affecting full load performance or maintenance demands.

Electronics – SaCoS 5000

The V28/33D STC is equipped with the classification society compliant safety and control system SaCoS 5000. SaCoS 5000 combines all functions of modern engine management into one complete system.

SaCoS 5000 offers:

- Integrated self-diagnosis functions
 - Future prove design
 - Digital ready
 - Maximum reliability and availability
 - Simple use and diagnosis
 - Quick exchange of modules
 - Crankcase monitoring system plus oil mist detection
- As a standard for all our four-stroke medium-speed engines manufactured in Augsburg, these engines will be equipped with a crankcase monitoring system (CCM = splash oil & main bearing temperature) plus OMD (oil mist detection). OMD and CCM are integral part of the Everllence' safety philosophy and the combination of both will increase the possibility to early detect a possible engine failure and prevent subsequent component damage.
- Propulsion optimisation interface

The propulsion optimisation interface serves with engine parameters and provides information about upcoming limitations at an early stage. This allows a smooth and look ahead control of the CPP propulsion system.

Cyber security

The marine certified safety and control system SaCoS 5000 is compliant to the IACS UR E27 requirements for cyber resilience on-board equipment, which will get mandatory for ships contracted for construction or after 1st July 2024. A confirmation of compliance will be given by the main classification societies, ensuring the utmost benefit for our customers.

PrimeServ Assist - CEON (optional feature)

Everllence PrimeServ Assist is our solution to support our customers in monitoring and assessing the condition of their equipment. Equipment connected to our Everllence CEON cloud platform is monitored by Everllence's advanced analytics running in the Everllence CEON platform to detect degradations and optimisation potentials. Everllence experts analyse root causes and define mitigating actions based on this data.

Benefits:

- Availability: Ensuring 24/7 engine availability by monitoring operating values and pro-actively advising on operating tasks.
- Efficiency: Optimize equipment performance and reduce fuel consumption and emissions by detecting degradations of performance influencing parameters over time.
- Maintenance: Reduce maintenance cost by evaluating aging of individual components over time and pro-active advising counter measures.

SCR technology

Everllence has developed its own SCR technology to be able to optimise the emissions technology and the engine performance in addition with the Everllence own SCR control programme for increased customer benefit.

Common SCR systems require constantly high exhaust gas temperatures. The Everllence SCR system however is an integrated system (engine plus SCR) that is automatically adjusting the exhaust gas temperature in an optimal way to ensure ideal operation of both engine and SCR.

For example, the engine is operating at optimum condition, however the system is registering an increasing back pressure over the SCR. To resolve this, the regeneration feature of the integrated SCR system is activated and the waste gate engaged to increase exhaust gas temperature. After a short time, the SCR system is regenerated and the engine can continue operation in the design point area. Thus the SCR assures ideal engine operation by regenerating the SCR system whenever necessary to achieve minimum fuel oil consumption. Of course, the SCR system also meets the requirements of IMO Tier III during regeneration.

For the SCR reactor two designs are available to provide more flexibility to fit the reactor into the available space. The two reactor variants are named LPC and LPS. LPC is the standard reactor with a Low Pressure Compact design. The LPC reactor is equipped with a single layer of honeycombs resulting in a very low height.

The LPS is a Low Pressure Slim variant of the reactor with smallest footprint. Therefore, the honeycombs are arranged in two layers. The honeycombs have different cell density per layer to keep the back pressure of the reactor on a low level.

Everllence total system competence

As the leading engine builder in the marine sector, Everllence has unrestricted access to the know-how required to design and execute highly efficient SCR systems for both new engines and retrofit applications on engines already in the field.

In Everllence's case, this clear "Advantage" over other supplier of SCR systems is further multiplied by our status as a global leader in the design and manufacture of turbochargers and fuel injection systems for large engines. Everllence and its PrimeServ after-sales organisation is ideally placed to supply and service the optimum SCR system for your engine.

1.3 Engine overview and SCR system components

— Control Signal

— Aqueous Urea Solution

— Compressed Air

*not true to scale

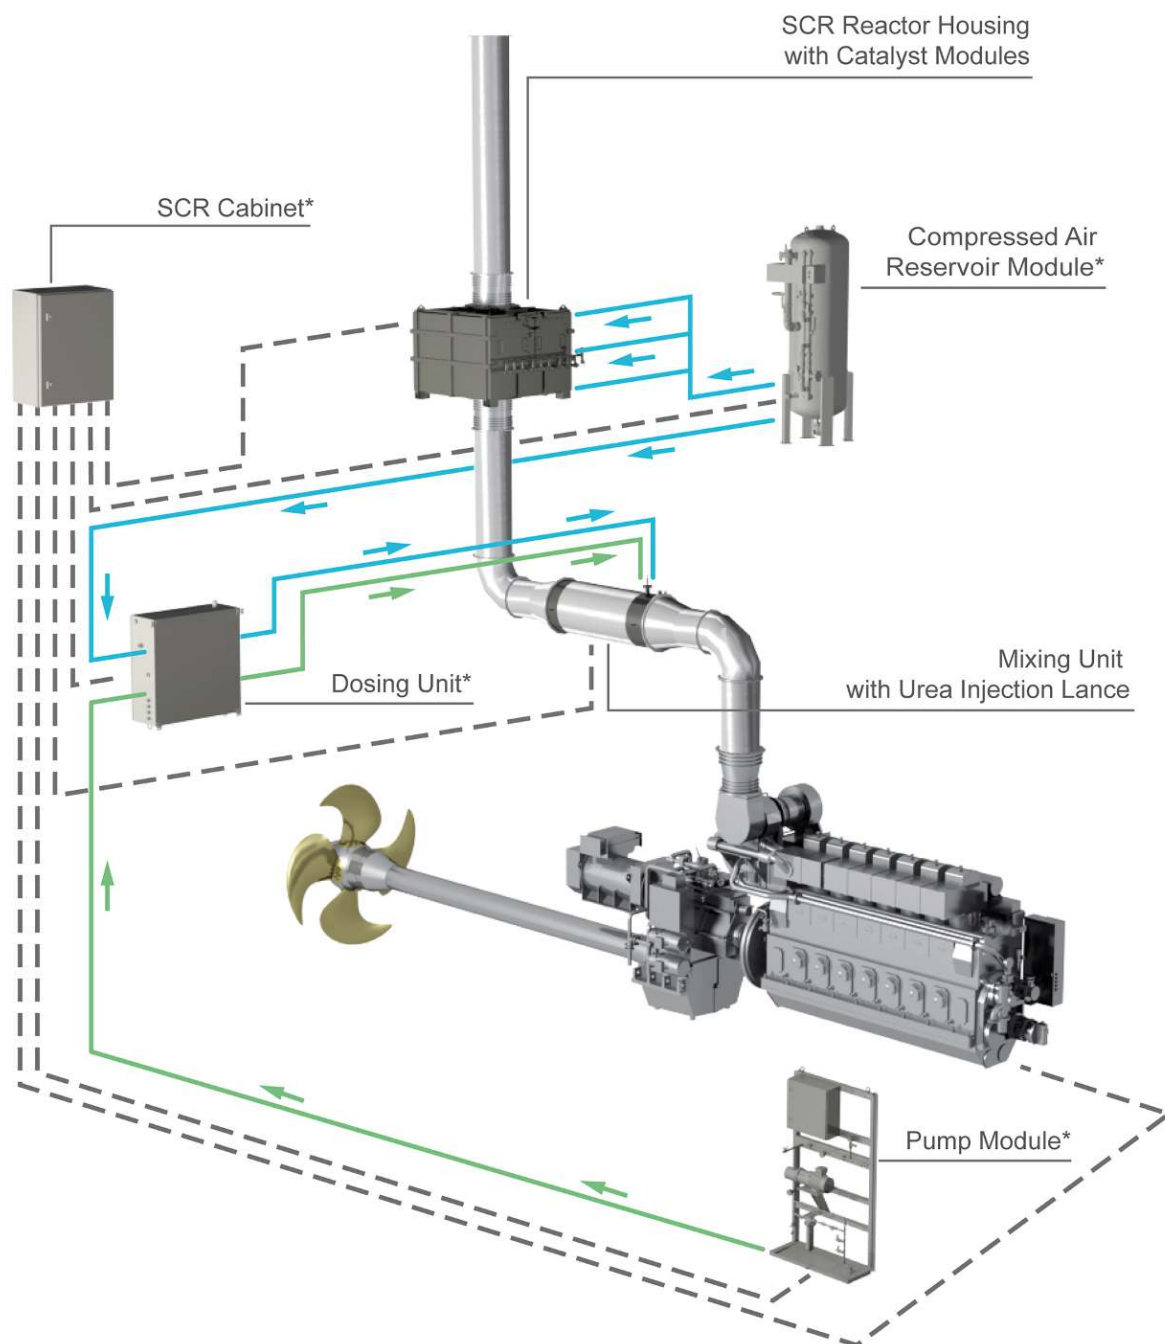


Figure 6: SCR system components overview (example)

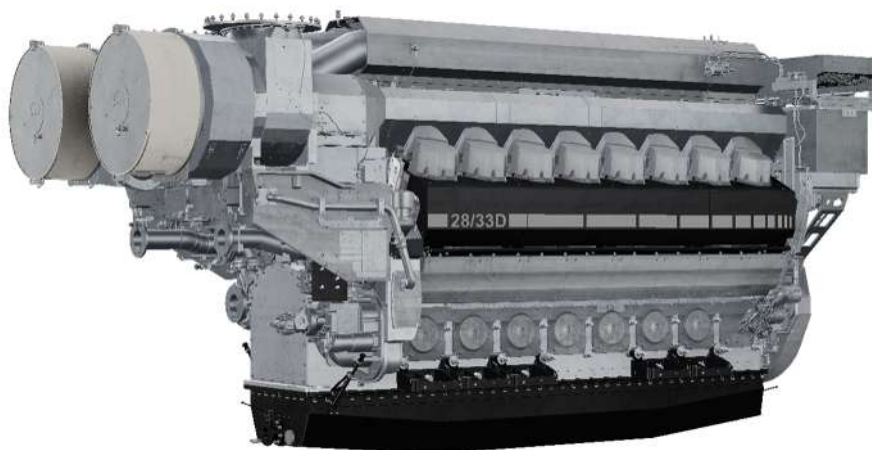


Figure 7: Engine overview, engine view on counter coupling side (CCS)

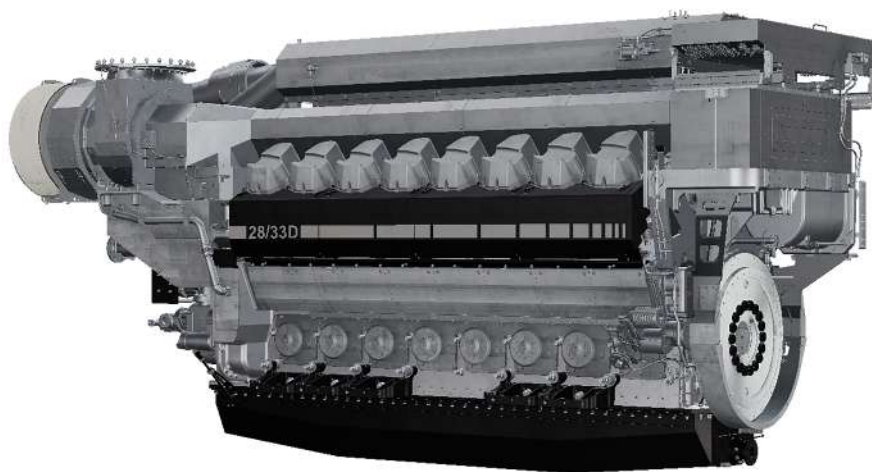


Figure 8: Engine overview, lube oil module with automatic filter, engine view on coupling side (CS)


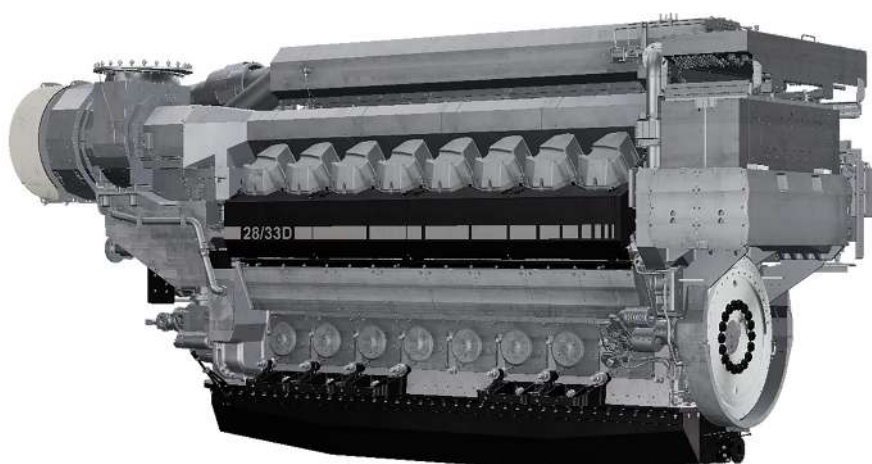


Figure 9: Engine overview, lube oil module with duplex filter, engine view on coupling side (CS)

1.4 Turbocharger overview

1.4.1 View of a TCA type turbocharger

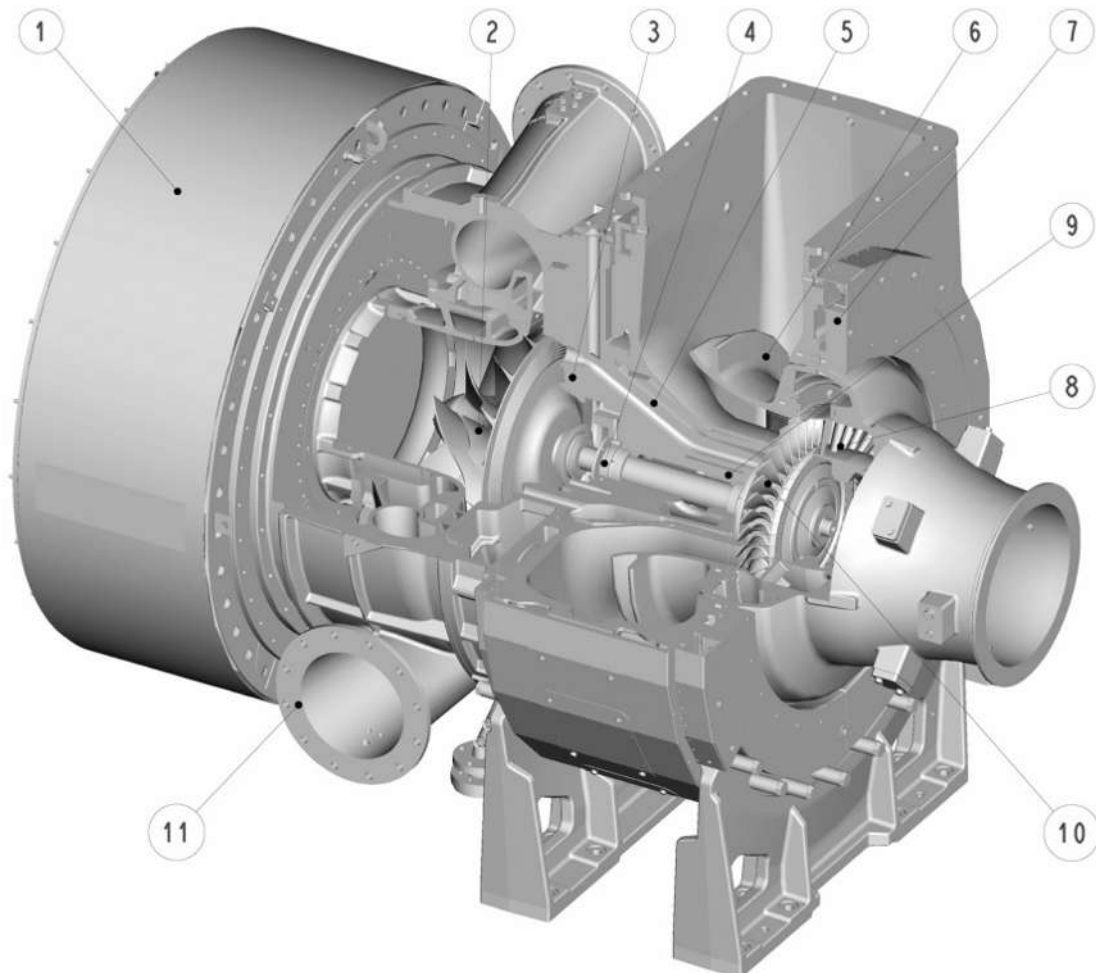

- | | |
|---------------------------------|----------------------|
| 1 Silencer | 7 Burst-proof casing |
| 2 Compressor wheel | 8 Nozzle ring |
| 3 Bearing casing | 9 Plain bearing |
| 4 Thrust bearing | 10 Turbine blades |
| 5 Integrated sealing air system | 11 Compressor casing |
| 6 Exhaust diffuser | |

Figure 10: TCA type turbocharger

The following view indicates the modern design principle of the TCA series:

- Whispering silencer
- Easy-to-service, low-noise compressor wheel
- Optional water-cooled compressor wheel
- Uncooled bearing casing
- Easy access to thrust bearing
- Integrated sealing air, oil pipe, and venting systems

1.4.2 Compensator between turbine outlet (engine) and exhaust gas pipe (plant)

All turbocharger casing flanges, with the exception of the turbine outlet, may only be subjected to loads generated by the gas forces, and not to additional external forces or torques.

This necessitates the use of compensators directly at the turbine outlet.

The compensators must be pre-loaded in such a manner that thermal expansion of the pipes and casings does not exert forces or torques in addition to those generated by the air and gas.

- Forces and torques according to API standard 617.
- Operating direction implemented according to Everllence standard.
- Minimising the load as far as possible.
- Characteristic values include gas forces, masses and compensator.

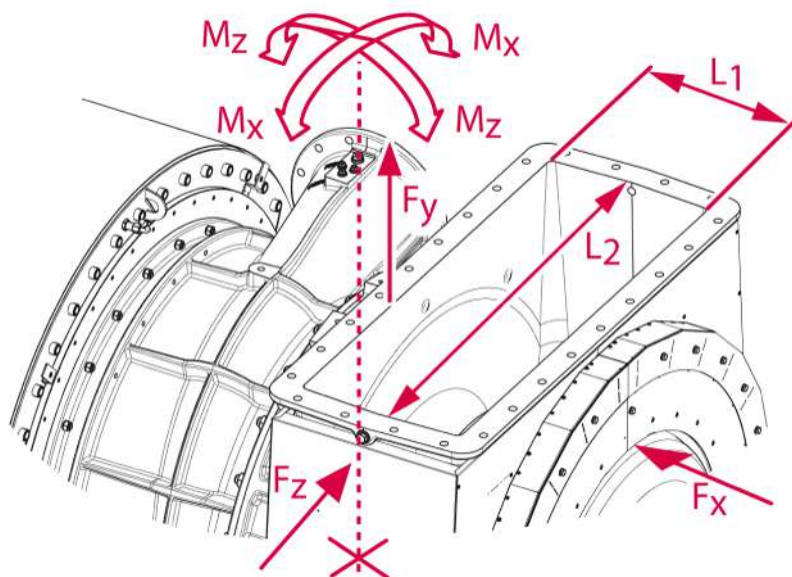


Figure 11: Maximum connection loads on gas outlet casing

Type	F_x [N]	F_y [N]	F_z [N]	M_x [Nm]	M_z [Nm]	L_1 [mm]	L_2 [mm]
TCA33	3,900	7,900	7,900	6,000	3,000	400	690
TCA44	4,200	8,500	8,500	6,400	3,200	340	949
TCA55	4,500	9,100	9,100	6,900	3,400	390	1,080
TCA66	4,900	9,900	9,900	7,500	3,700	463	1,283
TCA77	5,400	10,900	10,900	8,200	4,100	550	1,524
TCA88	5,900	12,000	12,000	9,100	4,500	653	1,810
TCA88-25	6,300	12,700	12,700	9,600	4,800	653	1,812

Note:

- The layout of the compensator has to consider the possible movement of the engine according its foundation and engine mounting and the movement/extension of the exhaust gas pipe of the plant.
- Recommendations for the layout of the exhaust gas pipe in the section [Exhaust gas system, Page 243](#) have to be considered.

1.4.3 No additional masses allowed

In general no masses are to be fixed to any part of the engine/turbocharger, as these have an impact to the general vibration behaviour of the engine.

Additional loads and changed vibration behaviour can endanger the operational safety of the engine.

Consequently, for any questions in this regard consult Everllence in advance.

This page is intentionally left blank

2 Engine and operation

2.1 Approved applications and destination/suitability of the engine

Approved applications

The V28/33D STC is designed as multi-purpose drive.

It has been approved by type approval as marine main engine.

As marine main engine¹⁾ it may be applied for mechanical propulsion drive²⁾ for applications as:

- High-speed ferries
- Mega yachts
- Offshore patrol vessels
- Corvettes
- Frigates
- Amphibious ships
- Logistic ships
- Others – to fulfill all customers needs the project requirements have to be defined at an early stage

V28/33D STC to be applied for multi-engine plants only.

Note:

The engine is not designed for operation in hazardous areas. It has to be ensured by the ship's own systems, that the atmosphere of the engine room is monitored and in case of detecting a gas-containing atmosphere the engine will be stopped immediately.

¹⁾ In line with rules of classifications societies each engine whose driving force may be used for propulsion purpose is stated as main engine.

²⁾ See section [Engine ratings \(output\) for different applications, Page 43](#).

Offshore

For offshore applications it may be applied for mechanical drive for applications as:

- Platforms/offshore supply vessels
- Anchor handling tugs
- General all kinds of service & supply vessels
- Drilling ships

V28/33D STC to be applied for multi-engine plants only.

Due to the wide range of possible requirements such as flag state regulations, fire fighting items, redundancy, inclinations and dynamic positioning modes all project requirements need to be clarified at an early stage.

Note:

The engine is not designed for operation in hazardous areas. It has to be ensured by the ship's own systems, that the atmosphere of the engine room is monitored and in case of detecting a gas-containing atmosphere the engine will be stopped immediately.

Destination/suitability of the engine

Note:

Regardless of their technical capabilities, engines of our design and the respective vessels in which they are installed must at all times be operated in line with the legal requirements, as applicable, including such requirements that may apply in the respective geographical areas in which such engines are actually being operated.

Operation of the engine outside the specified operated range, not in line with the media specifications or under specific emergency situations (e.g. suppressed load reduction or engine stop by active "Override", triggered firefighting system, crash of the vessel, fire or water ingress inside engine room) is declared as not intended use of the engine (for details see engine specific operating manuals). If an operation of the engine occurs outside of the scope of supply of the intended use a thorough check of the engine and its components needs to be performed by supervision of the Everllence service department. These events, the checks and measures need to be documented.

Electric and electronic components attached to the engine – Required engine room temperature

In general our engine components meet the high requirements of the marine classification societies.

Relevant design criteria for the engine room air temperature:

Minimum air temperature in the area of the engine and its components
Recommended: $\geq 5^{\circ}\text{C}$.

Maximum air temperature in the area of the engine and its components
 $\leq 45^{\circ}\text{C}$.

The electronic components are suitable for proper operation within an air temperature range from 5°C to 55°C .

For further information see also section [Engine automation, Technical data, environmental conditions, Page 149](#).

Note:

Condensation of the air at engine components must be prevented.

Note:

It can be assumed that the air temperature in the area of the engine and attached components will be 5–10 K above the ambient air temperature outside the engine room. If the temperature range is not observed, this can affect or reduce the lifetime of electrical/electronic components at the engine or the functional capability of engine components. Air temperatures at the engine $> 55^{\circ}\text{C}$ are not permissible.

2.2 Certification IMO Tier III

The engine's certification for compliance with NO_x limits according to NO_x technical code will be done according scheme B, meaning engine plus SCR will be handled as separate parts.

Certification has to be in line with IMO Resolution MEPC 198(62), adopted 15 July 2011.

Emission level engine: IMO Tier II

Emission level engine plus SCR catalyst: IMO Tier III

Certification of engine

Engine will be tested as specified in section [Programme for Factory Acceptance Test \(FAT\), Page 286](#) according to relevant classification rules. It will also be certified as member or parent engine according to NO_x technical code for emission category IMO Tier II.

Certification of complete system (engine plus SCR system)

Certification of SCR catalyst and components will be done in accordance with MEPC 198(62) for a scaled, standardised SCR reactor and SCR components based on product features and following scaled parameters:

- Exhaust gas mass flow
- Exhaust gas composition (NO_x, O₂, CO₂, H₂O, SO₂)
- Exhaust gas temperature
- Catalyst modules (AV, SV or LV value)
- Reducing agent
- Desired NO_x conversion rate

The on-board confirmation test required for a scheme B certification will be done for the parent engine plus SCR system for a group according to IMO resolution MEPC 198(62).

2.3 Engine design

2.3.1 Engine cross section

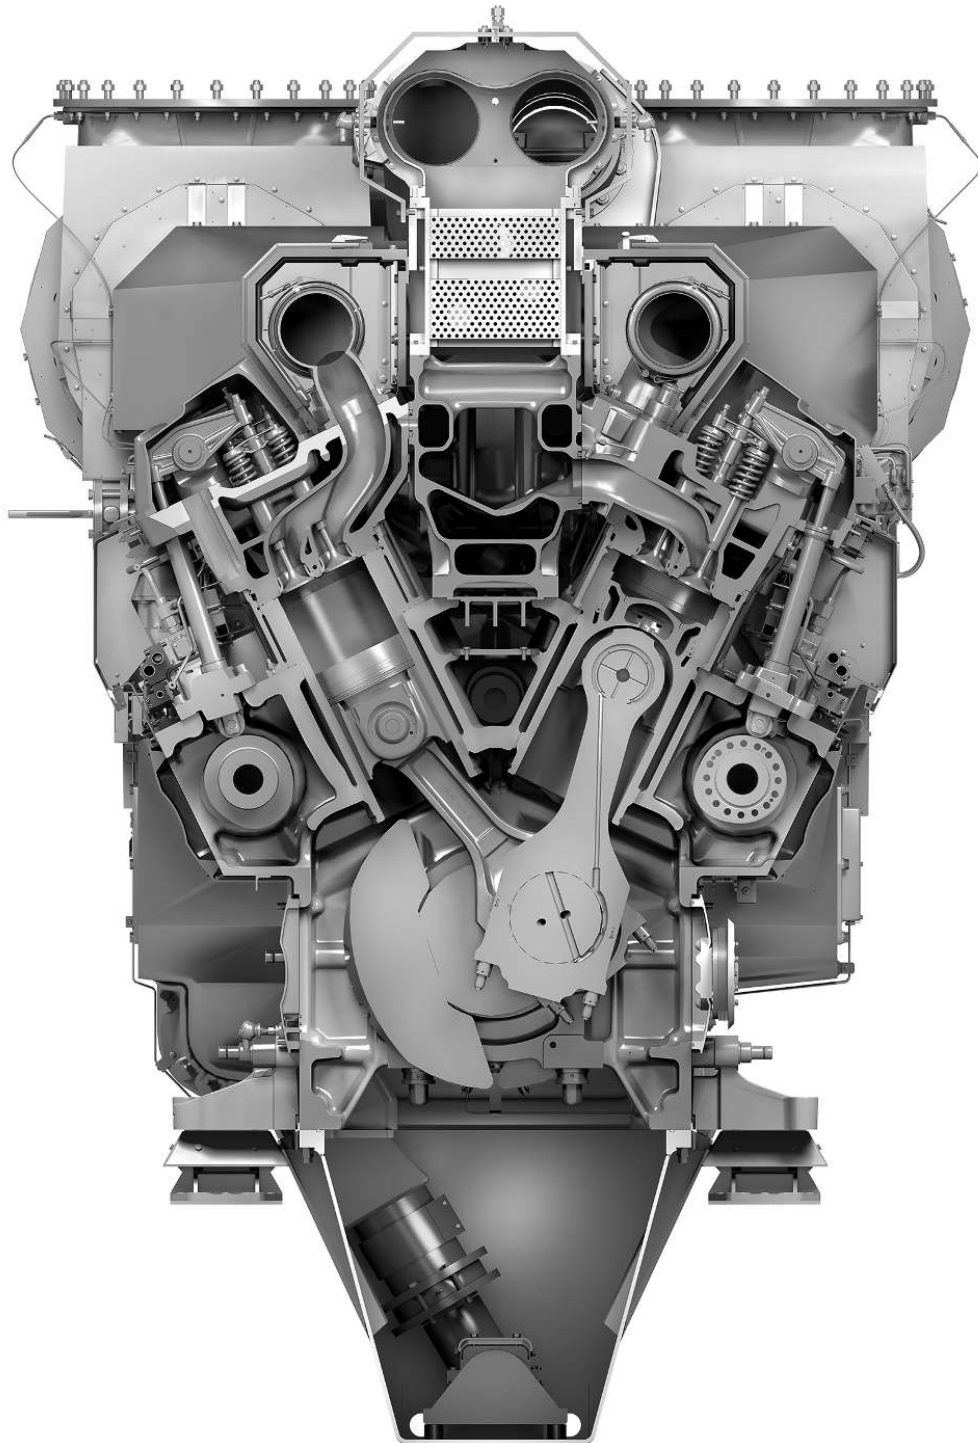



Figure 12: Cross section

2026-02-24 - G.2

2.3.2 Engine designations – Design parameters

Example to declare engine designations

MAN 12V28/33D STC

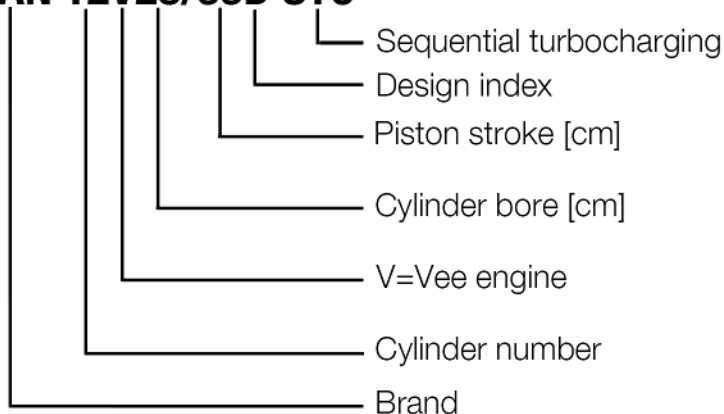

Parameter	Value	Unit
Number of cylinders	12, 16, 20	-
Cylinder bore	280	mm
Piston stroke	330	
Displacement per cylinder	20.3	litre
Distance between cylinder centres, vee engine	460	mm
Vee engine, vee angle	52	°
Crankshaft diameter at journal, vee engine	300	mm
Crankshaft diameter at crank pin	240	

Table 1: Design parameters

2.3.3 Turbocharger assignments

No. of cylinders, config.	CPP, FPP
12V	TCA33-42
16V	TCA33-42
20V	TCA33-42

Table 2: Turbocharger assignments

Turbocharger assignments mentioned above are for guidance only and may vary due to project-specific reasons. Consider the relevant turbocharger Project Guides for additional information.

2.3.4 Engine main dimensions, weights and views

V28/33D STC mechanical propulsion

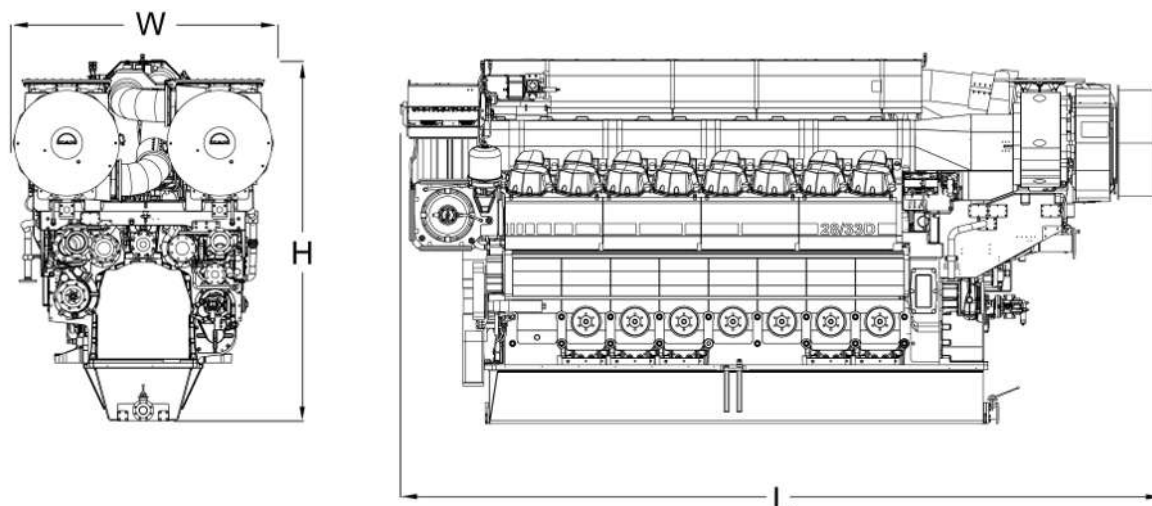


Figure 13: Main dimensions and weights – V28/33D STC mechanical propulsion (lube oil module with automatic filter)

No. of cylinders, config.	W	H (low oil sump)	H (deep oil sump)	L	Weight with flywheel ¹⁾
	mm				t
12V	2,473	3,417	3,682	6,217	36.1
16V				7,137	43.5
20V				8,057	51.0

¹⁾ Tolerance: 5%. Weight refer to engine with flywheel, TC silencer, attached pumps, oil filter and lube oil cooler (weight given without media filling of engine).

For Flywheel data, see section [Flywheel arrangement, Page 119](#).

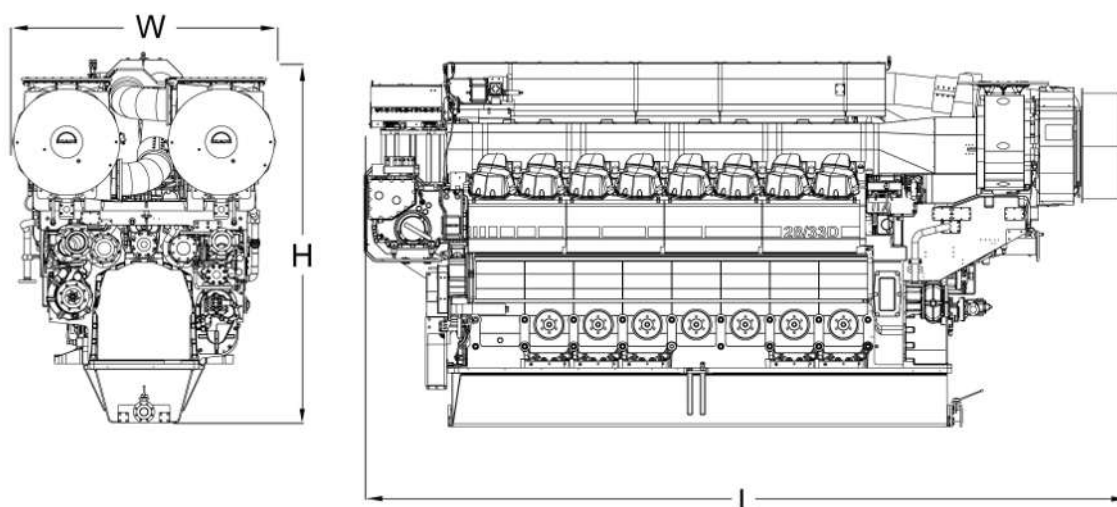


Figure 14: Main dimensions and weights – V28/33D STC mechanical propulsion (lube oil module with duplex filter)

No. of cylinders, config.	W	H (low oil sump)	H (deep oil sump)	L	Weight with flywheel ¹⁾
	mm				t
12V	2,473	3,417	3,682	6,207	35.6
16V				7,127	43.0
20V				8,047	50.6

¹⁾ Tolerance: 5%. Weight refer to engine with flywheel, TC silencer, attached pumps, oil filter and lube oil cooler (weight given without media filling of engine).

For Flywheel data, see section [Flywheel arrangement, Page 119](#).

2.3.5 Main dimensions, weights and views of SCR components

Depending on the individual projects SCR properties may vary. The following dimensions and weights are for guidance only.

For the SCR reactor two designs are available, SCR reactor LPC and SCR reactor LPS. LPC is the standard reactor with a compact design. LPS is a specialised reactor with smallest footprint.

SCR reactor

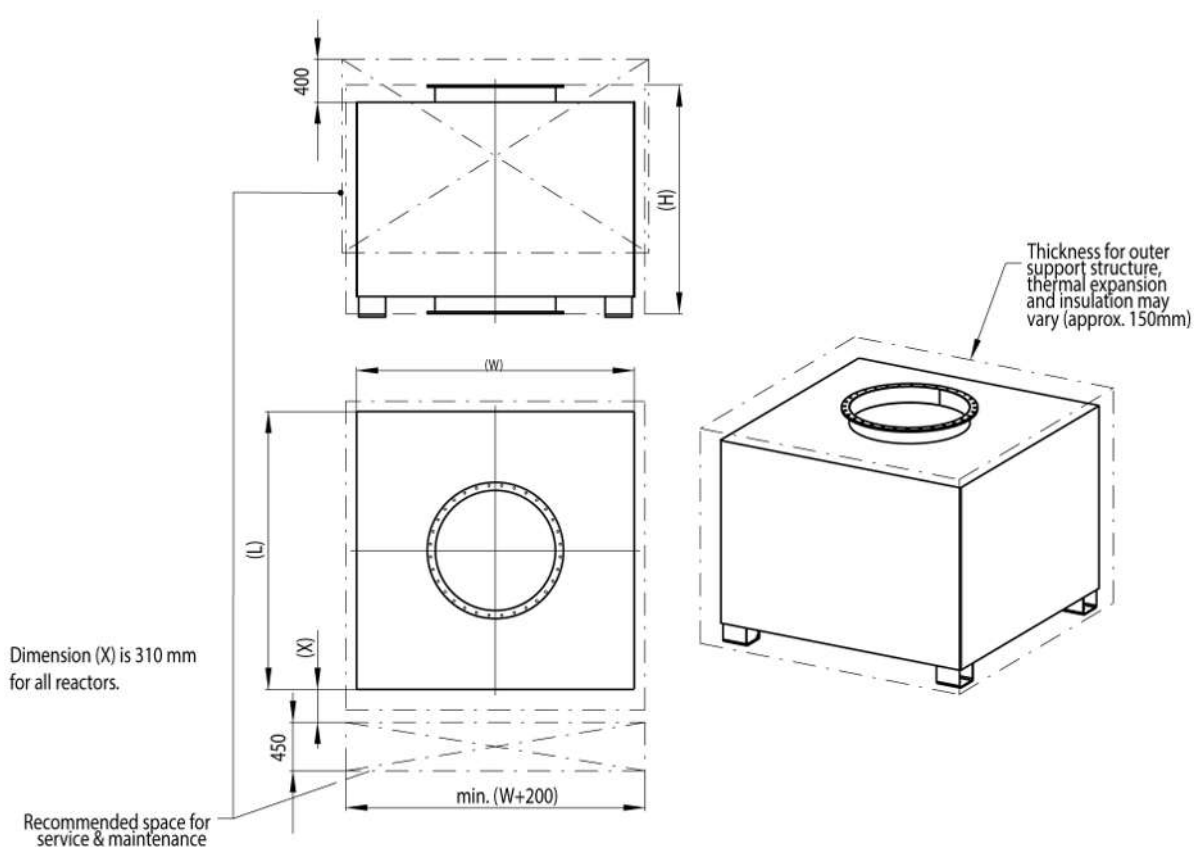


Figure 15: SCR reactor

SCR reactor - LPC	Engine power approximately	Duct	H (total length)	W (without insulation)	L (without insulation)	Handling weight	Operational weight
No.	[kW]	DN	[mm]	[mm]	[mm]	[kg]	[kg]
1	0–1,400	500	1,892	1,252	1,252	900	1,364
2	1,401–2,400	600	1,938	1,502	1,502	1,190	1,886
3	2,401–3,600	800	1,985	1,752	1,752	1,530	2,574
4	3,601–4,900	900	2,032	2,084	2,084	1,900	3,321
5	4,901–6,000	1,000	2,079	2,334	2,334	2,310	4,166
6	6,001–7,800	1,100	2,126	2,584	2,584	2,680	5,029
7	7,801–9,000	1,200	2,228	2,916	2,916	3,250	6,150
8	9,001–12,000	1,400	2,330	3,248	3,248	4,010	7,519
9	12,001–13,700	1,500	2,432	3,416	3,416	4,080	8,256
10	13,701–15,000	1,600	2,534	3,748	3,748	4,950	9,851
11	15,001–17,000	1,700	2,635	3,990	3,990	5,410	11,094
12	17,001–20,000	1,800	2,737	4,248	4,248	6,040	12,565
13	20,001–21,600	2,000	2,839	4,580	4,580	7,200	14,624

Table 3: SCR reactor - LPC

SCR reactor - LPS	Engine power approximately	Duct	H (total length)	W (without insulation)	L (without insulation)	Handling weight	Operational weight
No.	[kW]	DN	[mm]	[mm]	[mm]	[kg]	[kg]
1	0–2,400	500	3,072	1,252	1,252	1,340	2,268
2	2,401–3,600	600	3,118	1,502	1,502	1,770	3,162
3	3,601–4,900	800	3,165	1,752	1,752	2,180	4,268
4	4,901–6,000	900	3,212	2,084	2,084	2,800	5,642
5	6,001–9,000	1,000	3,259	2,334	2,334	3,350	7,062
6	9,001–12,000	1,100	3,306	2,584	2,584	3,910	8,608
7	12,001–13,700	1,200	3,408	2,916	2,916	4,780	10,580
8	13,701–15,000	1,400	3,510	3,248	3,248	6,040	13,058
9	15,001–20,000	1,500	3,612	3,416	3,416	5,950	14,302
10	20,001–21,600	1,600	3,714	3,748	3,748	7,300	17,102

Table 4: SCR reactor - LPS

Note:

In accordance with applicable security policies there must be provided adequate maintenance space, which permits the safe execution of all necessary maintenance work.

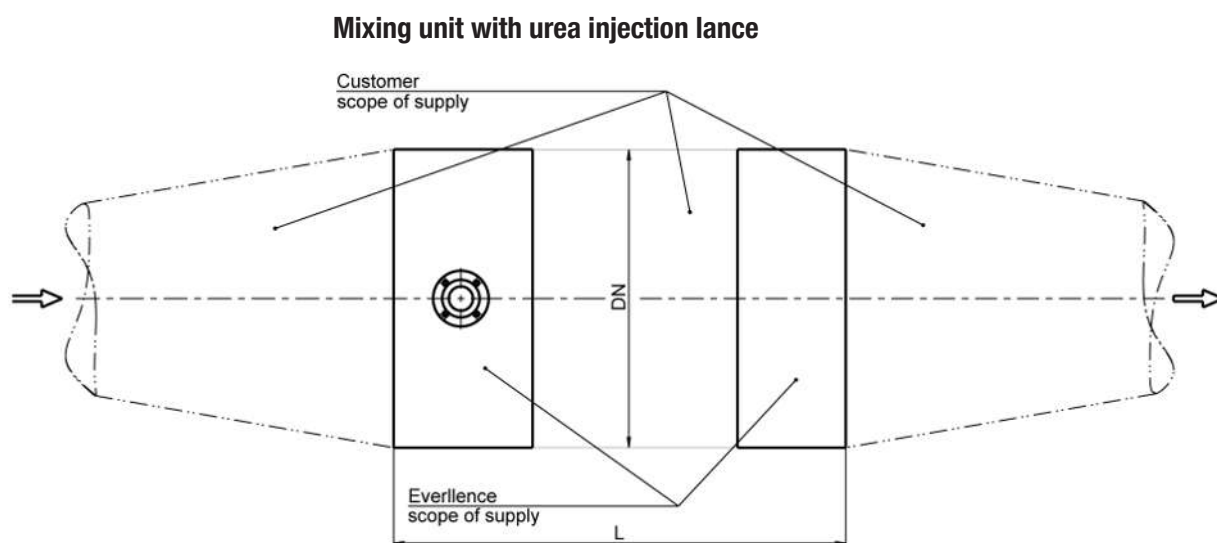


Figure 16: Mixing unit with urea injection lance

Mixing unit No.	Engine power approximately [kW]	Mixing pipe ¹⁾ DN	Length straight mixing pipe (L) [mm]
1	0–1,000	500	2,580
2	1,001–2,000	600	2,630
3	2,001–3,000	800	2,735
4	3,001–4,200	1,000	2,845
5	4,201–5,400	1,100	3,300
6	5,401–6,800	1,200	3,350
7	6,801–8,500	1,400	3,455
8	8,501–10,500	1,500	3,360
9	10,501–13,000	1,600	3,405
10	13,001–20,000	2,100	3,660
11	20,001–21,600	2,300	3,760

¹⁾ Diameter mixing pipe differs from exhaust pipe diameter.

Table 5: Mixing unit with urea injection lance

Dosing unit

Dosing unit No.	Height [mm]	Width [mm]	Depth [mm]	Weight [kg]
1	800	800	300	80

Table 6: Dosing unit

SCR cabinet

SCR cabinet No.	Height [mm]	Width [mm]	Depth [mm]	Weight [kg]
1	800	400	300	30

Table 7: SCR cabinet

Pump module

Pump module	Height	Width	Depth	Weight
No.	[mm]	[mm]	[mm]	[kg]
1	1,800	1,000	400	210

Table 8: Pump module

Compressed air reservoir module

Air module	Height	Width	Depth	Weight
No.	[mm]	[mm]	[mm]	[kg]
1	1,730	810	620	195

Table 9: Compressed air reservoir module

2.3.6 Engine inclination

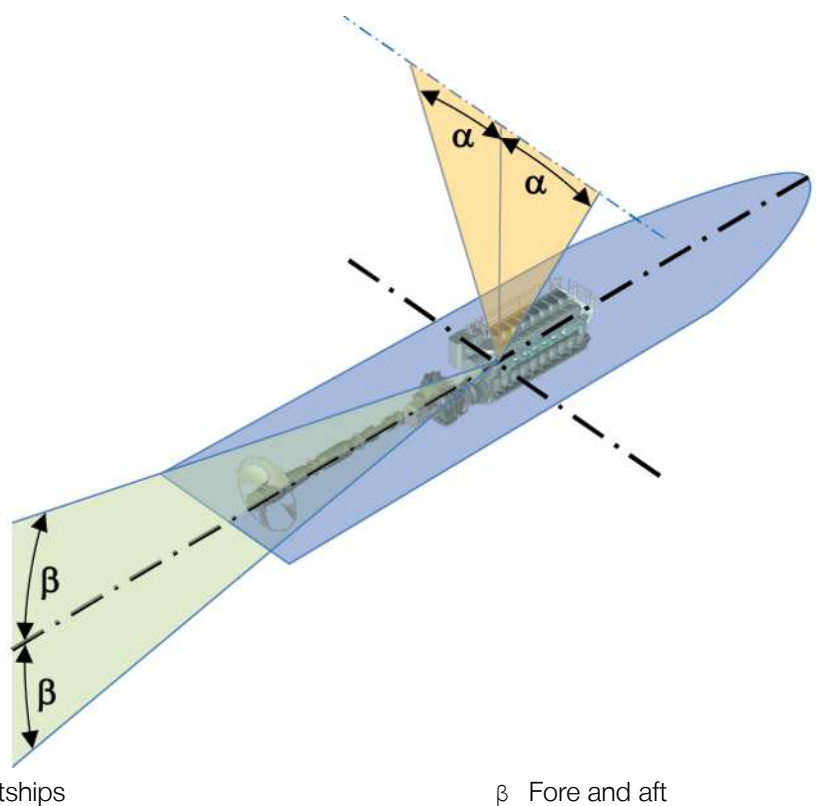


Figure 17: Angle of inclination

Max. permissible angle of inclination [°] ^{1) 2)}					
Application	Athwartships α		Fore and aft β		
	Heel to each side (static)	Rolling to each side (dynamic)	Trim (static) ³⁾		Pitching (dynamic)
			L < 100 m	L > 100 m	
Main engines	15	22.5	5	500/L	7.5

¹⁾ Athwartships and fore and aft inclinations may occur simultaneously.
²⁾ While engine may be installed 3° tilted as a maximum in vessels longitudinal direction.
³⁾ Depending on length L of the ship.

Table 10: Inclinations

Note:

For higher requirements contact Everllence. Arrange engines always length-wise of the ship.

2.3.7 Engine equipment for various applications

Device/measure, (figure pos.)	Mechanical propulsion
Cylinder pressure limitation by hot charge air blow-off (binary)	Order-related, required if the intake air < 0°C ¹⁾
Hot charge air by-pass (variable)	X
Temperature after turbine control by waste gates (variable)	X
SCR system	X
Exhaust flap STC and air flap STC	X
Turbocharger – Compressor cleaning device (wet)	X
Two-stage charge air cooler	X
Oil mist detector	X
Splash oil monitoring	X
Main bearing temperature monitoring	X
Starting system – Compressed air starter	X
Slow turn	O
Attached HT cooling water pump	X
Attached LT cooling water pump	X
Attached lube oil pump	X
Attached seawater pump	X
Attached fuel supply pump	X
Attached HT cooling water temperature control valve	X
Attached lube oil temperature control	X ²⁾
Attached lube oil cooler	X
Attached lube oil pressure control valve	X ³⁾
Oil sump	X (deep oil sump) O (low oil sump)
Power take off 100% on counter coupling side	O
Oil mist eliminator (not attached to the engine)	X
Attached lube oil duplex filter	X
Attached lube oil automatic filter	O (lube oil automatic filter plus lube oil centrifugal filter)
X = required, O = optional ¹⁾ Everllence recommends an engine room temperature of +5°C to avoid freezing wetness on intake air silencer filter mat and electronic equipment. ²⁾ Lube oil inlet temperature control by wax thermostat (standard for engines with lube oil duplex filter). For engines with optional lube oil automatic filter: Lube oil outlet temperature control by wax thermostat. ³⁾ Integrated in the attached lube oil pump.	

Table 11: Engine equipment

Cylinder pressure limitation by hot charge air blow-off (binary) (see figure [Over-view flaps, Page 38](#))

Engine equipment for various applications – General description

If engines are operated at full load at low air intake temperature, the high air density leads to the danger of excessive charge air pressure and, consequently, to excessive cylinder pressure. In order to avoid such conditions, part of the charge air is withdrawn upstream of the charge air cooler and blown off (hot charge air blow-off).

Note:

Hot air withdrawn before charge air cooler has to be blown outside the engine room where it can not harm persons and property or may be used e.g. for intake air preheating.

Hot charge air by-pass (variable) (see figure [Over-view flaps, Page 38](#))

A part of the hot charge air after compressor will be withdrawn into the exhaust gas pipe. The flap is closed in normal operation.

In some areas of the operating map of the engine, this charge air by-pass will be opened and the increased air flow at the turbine results in a higher charge air pressure of the compressor, which leads to an improved operational behavior of the engine.

In addition, this flap may be used to avoid surging of the turbocharger.

Temperature after turbine control by waste gates (variable) (see figure [Over-view flaps, Page 38](#))

The waste gate is used to by-pass the turbine of the turbocharger with a part of the exhaust gas. This leads to a charge air pressure reduction and the temperature after turbine is increased.

For plants with an SCR catalyst, downstream of the turbine, a minimum exhaust gas temperature upstream the SCR catalyst is necessary in order to ensure its proper performance.

In case the temperature downstream the turbine falls below the set minimum exhaust gas temperature value, the waste gate is opened gradually in order to blow-off exhaust gas upstream of the turbine until the exhaust gas temperature downstream of the turbine (and thus upstream of the SCR catalyst) has reached the required level.

SCR system

The SCR system uses a reduction agent to transform the pollutant NO_x into environmentally friendly nitrogen and water vapour. The Everllence SCR system is capable of complying with the IMO Tier III limits over the entire range of applications.

Exhaust flap STC and air flap STC (see figure [Over-view flaps, Page 38](#))

Allows to turn off the second turbocharger at lower loads.

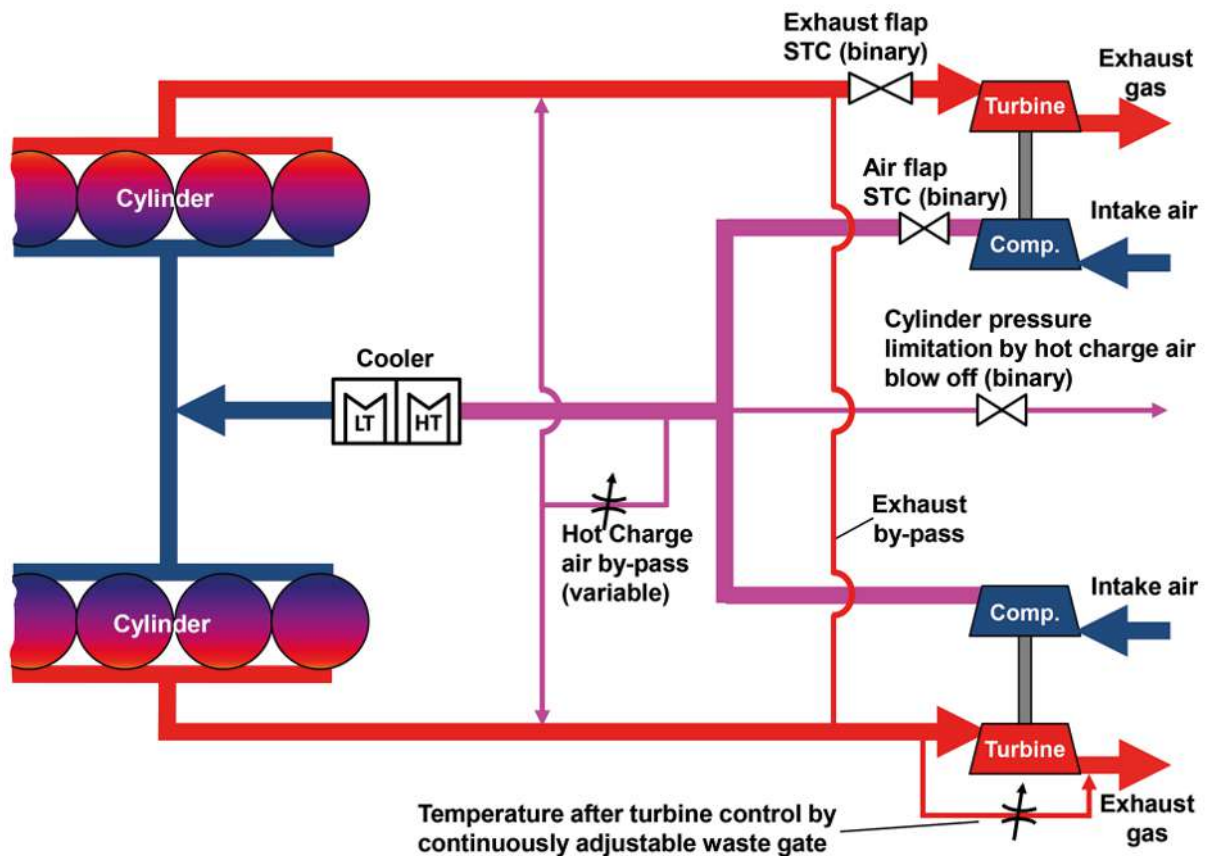


Figure 18: Overview flaps

Turbocharger – Compressor cleaning device (wet)

Depending on the quality of the intake air, deposits may be formed on the blades of the compressor wheel and diffuser. This contamination reduces the efficiency of the compressor. Cleaning of the compressor is carried out with water during operation at full load with a special compressor cleaning device.

Two-stage charge air cooler

The two-stage charge air cooler consists of two stages which differ in the temperature level of the connected water circuits. The charge air is first cooled by the HT circuit (high temperature stage of the charge air cooler, engine) and then further cooled down by the LT circuit (low temperature stage of the charge air cooler, lube oil cooler).

Oil mist detector

Bearing damage, piston seizure and blow-by in combustion chamber leads to increased oil mist formation. As a part of the safety system the oil mist detector monitors the oil mist concentration in crankcase to indicate these failures at an early stage.

Splash oil monitoring

The splash oil monitoring system is a constituent part of the safety system. Sensors are used to monitor the temperature of each individual drive unit (or pair of drive at V engines) indirectly via splash oil.

Main bearing temperature monitoring

As an important part of the safety system the temperatures of the crankshaft main bearings are measured just underneath the bearing shells in the bearing caps. This is carried out using oil-tight resistance temperature sensors.

Starting system – Compressed air starter

The engine is equipped with compressed air starters, which are attached to the engine. On starting command they will turn the flywheel until a defined speed is reached.

Slow turn	Engines, which are equipped with slow turn, are automatically turned prior to engine start with the turning process being monitored by the engine control. If the engine does not reach the expected number of crankshaft revolutions (2.5 revolutions) within a specified period of time, or in case the slow turn time is shorter than the programmed minimum slow turn time, an error message is issued. This error message serves as an indication that there is liquid (oil, water, fuel) in the combustion chamber. If the slow turn manoeuvre is completed successfully, the engine is started automatically. Slow turn is always required for plants with power management system (PMS) demanding automatic engine start.
Attached HT cooling water temperature control valve	To facilitate the installation and media control the HT cooling water temperature control valve is installed at the engine and integrated in the media circuit already. The position of the valve is shown in figure Internal cooling water system (LT and HT) – Exemplary 12V28/33D STC, Page 217 .
Attached lube oil temperature control	The lube oil temperature control valve regulates the inlet oil temperature of the engine.
Attached lube oil cooler	The lube oil cooler is designed according the heat data, flow rates and tolerances which are indicated in section Planning data, Page 79 .
Attached lube oil pressure control valve	The lube oil pressure control valve regulates the inlet oil pressure of the engine.
Attached lube oil duplex filter	The lube oil filter is a duplex paper cartridge filter. It is a depth filter. The position is shown in figure Internal lube oil system – Exemplary for variant with lube oil duplex filter, Page 202 .
Attached lube oil automatic filter	Optional a configuration with automatic filter and centrifuge is available. The attached lube oil automatic filter is equipped with an integrated second filtration stage. This second stage protects the engine from particles which may pass the first stage filter elements in case of any malfunction.

2.4 Ratings (output) and speeds

2.4.1 General remark

The engine power which is stated on the type plate derives from the following sections and corresponds to $P_{\text{Operating}}$ as described in section [Derating, definition of P Operating, Page 43](#).

2.4.2 Standard engine ratings

Engine V28/33D STC propulsion, 455 kW/cyl.

$P_{\text{ISO, standard}}$: ISO standard output (as specified in DIN ISO 3046-1)

455 kW/cyl., 1,000 rpm (ICN) [corresponds to 100% output]

No. of cyl., config.	Engine rating $P_{\text{ISO, standard}}$ ^{1) 2)}					
	455 kW/cyl., 1,000 rpm	Available turning direction	Minimum continuous rating up to a maximum of 12 hours ³⁾		Minimum continuous rating up to a maximum of 48 hours ³⁾	
	kW	CW/CCW ^{4) 5)}	FPP at 300 rpm kW	CPP at 400 rpm kW	FPP at 300 rpm kW	CPP at 400 rpm kW
12V	5,460	Yes/Yes	125	165	250	325
16V	7,280	Yes/Yes	165	215	330	430
20V	9,100	Yes/Yes	205	270	410	540

¹⁾ $P_{\text{ISO, standard}}$ as specified in DIN ISO 3046-1, see paragraph [Reference conditions for engine rating, Page 41](#), according ICN power definition.

²⁾ Engine fuel: DMA according to ISO 8217, fulfilling the stated quality requirements. Contents of FAME or synthetic fuels are not considered for this reference, as they affect the volumetric heat value. In engine operation with FAME or synthetic fuels, the power output will be reduced due to the limitation of the injection quantity to the value of DMA.

³⁾ See section [Low-load operation V28/33D STC, Page 51](#).

⁴⁾ For multi-engine arrangement only.

⁵⁾ CW clockwise; CCW counter clockwise.

Table 12: Engine V28/33D STC propulsion, 455 kW/cyl.

Engine V28/33D STC propulsion, "Navy" (ICFN), 500 kW/cyl.¹⁾P_{ISO, standard}: ISO standard output (as specified in DIN ISO 3046-1)

500 kW/cyl., 1,032 rpm (ICFN) [corresponds to 100% output]

No. of cyl., config.	Engine rating P _{ISO, standard} ^{2) 3)}						
	Fuel stop power ICFN ¹⁾ 500 kW/cyl., 1,032 rpm	MCR 455 kW/cyl., 1,000 rpm	Available turning direction	Minimum continuous rating up to a maximum of 12 hours ⁴⁾		Minimum continuous rating up to a maximum of 48 hours ⁴⁾	
	kW	kW	CW/CCW ^{5) 6)}	FPP at 300 rpm kW	CPP at 400 rpm kW	FPP at 300 rpm kW	CPP at 400 rpm kW
12V	6,000	5,460	Yes/Yes	125	165	250	325
16V	8,000	7,280	Yes/Yes	165	215	330	430
20V	10,000	9,100	Yes/Yes	205	270	410	540

¹⁾ Only available for special class rules or without class approval.²⁾ P_{ISO, standard} as specified in DIN ISO 3046-1, see paragraph [Reference conditions for engine rating, Page 41](#), according ICFN power definition for application with "Navy" load profile. (F = Fuel stop power, represents highest load also at FAT).³⁾ Engine fuel: DMA according to ISO 8217, fulfilling the stated quality requirements. Contents of FAME or synthetic fuels are not considered for this reference, as they affect the volumetric heat value. In engine operation with FAME or synthetic fuels, the power output will be reduced due to the limitation of the injection quantity to the value of DMA.⁴⁾ See section [Low-load operation V28/33D STC, Page 51](#).⁵⁾ For multi-engine arrangement only.⁶⁾ CW clockwise; CCW counter clockwise.

Table 13: Engine V28/33D STC propulsion, "Navy" (ICFN), 500 kW/cyl.

Reference conditions for engine rating

According to ISO 15550; ISO 3046-1

Air temperature before turbocharger t _t	K/°C	298/25
Total atmospheric pressure p _t	kPa	100
Relative humidity Φ _t	%	30
Cooling water temperature inlet charge air cooler (LT stage)	K/°C	298/25

Table 14: Reference conditions for engine rating

2.4.3 Power definition and load profile

Ratings are given according to ISO 3046-1:2002.

According ISO 15550:2002, the power figures in the tables remain valid within a range of ± 3% up to tropical conditions at sea level, i.e.:

- Compressor inlet temperature 45°C.
- Compressor inlet pressure 1,000 mbar.
- Seawater temperature 32°C.

For all commercial medium speed propulsion engines the power is defined according ICFN¹⁾ definition (ISO 3046-1:2002 : ISO standard power).

For all navy medium speed propulsion applications the engine rated power is stated as ICFN (ISO standard Continuous Fuel stop Net power), derived from standard ISO 3046-1:2002. It means the engine is capable to deliver power continuously during a period of time corresponding to the application. The engine is operated at stated speed and reference ambient conditions as stated above, while the fuel amount is limited and the fuel stop power cannot be exceeded. The engine rated power is delivered between the maintenance intervals as defined. The ICFN engine power rating description corresponds to 100% engine power output and cannot be exceeded.

**Exemplary load profile: V28/33D STC "Navy" (ICFN), 500 kW/cyl.
= 100% engine output**

Typical use: Fast yachts, frigates, corvettes, OPV.

The continuous operating time for loads > 455 kW/cyl. (DMA) ist limited to max. 1 hour. After an operation at higher loads, the load must be decreased to ≤ 455 kW/cyl. for at least 11 hours. Due to the limitation of the injection quantity to the value of DMA, the overload range is shifted to a lower power output when using FAME or synthetic fuels. An operating hours counter based on the injection quantity with a corresponding indication for overload operation is implemented in the engine control system. Please observe the engine control unit carefully. The proportion of higher loads in the load profile must not be exceeded.

Engine operating time [%]

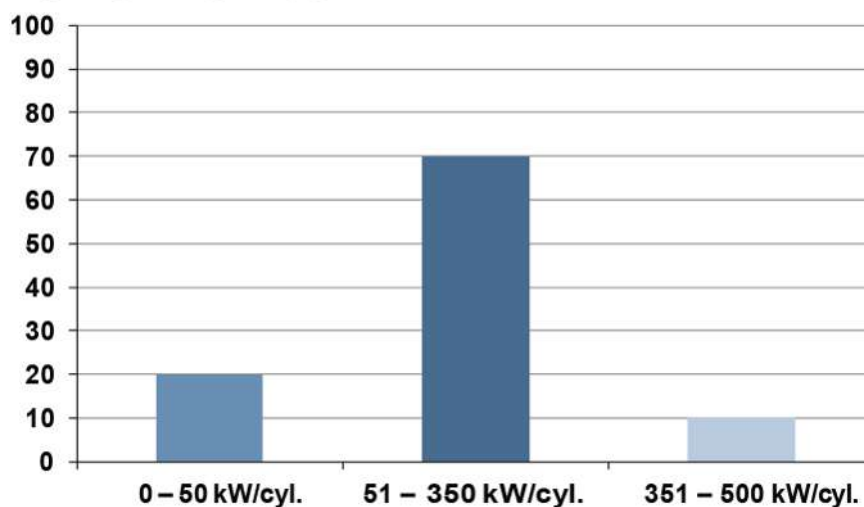


Figure 19: Exemplary load profile: V28/33D STC "Navy" (ICFN), 500 kW/cyl.

¹⁾ IC[F]N according to ISO 3046; I = Power to ISO 3046; C = Continuous power output; [F = Fuel stop power]; N = Net power

2.4.4 Engine ratings (output) for different applications

$P_{\text{Application, ISO}}$: Available output under ISO conditions dependent on application

	$P_{\text{Application}}$ available output in percentage from ISO standard output	$P_{\text{Application}}$ available output	Max. fuel admission (blocking)	Max. permissible speed reduction at maximum torque¹⁾	Tropic conditions ($t_r/t_{cr}/p_r=100 \text{ kPa}$)²⁾	Notes
Kind of application	%	kW/cyl.	%	%	°C	
Marine main engines						
Main drive with controllable pitch propeller	100	455 (ICN) 500 (ICFN) ³⁾	100	-	45/38	⁴⁾
Main drive with fixed pitch propeller	100	455 (ICN) 500 (ICFN) ³⁾	100	10	45/38	⁴⁾

¹⁾ Maximum torque given by available output and nominal speed.

²⁾ t_r = air temperature at compressor inlet of turbocharger; t_{cr} = cooling water temperature before charge air cooler; p_r = atmospheric pressure.

³⁾ For engines with ICFN power definition ("Navy" load profile) as described in section [Power definition and load profile, Page 41](#).

⁴⁾ According to DIN ISO 3046-1 Everllence has specified a maximum continuous rating for marine engines listed in the column $P_{\text{Application}}$.

Table 15: Available outputs/related reference conditions V28/33D STC

2.4.5 Derating, definition of $P_{\text{Operating}}$

$P_{\text{Operating}}$: Available rating (output) under local conditions and dependent on application

Dependent on local conditions or special application demands a further load reduction of $P_{\text{Application, ISO}}$ might be required.

1. No derating

No derating necessary, provided that the conditions listed are met:

	No derating up to stated reference conditions (tropic), see 1.
Air temperature before turbocharger T_x	$\leq 318 \text{ K (45°C)}$
Ambient pressure	$\geq 100 \text{ kPa (1 bar)}$
Cooling water temperature inlet charge air cooler (LT stage)	$\leq 311 \text{ K (38°C)}$
Intake air pressure before compressor	$\geq -2 \text{ kPa}^{1)}$
Exhaust gas back pressure after turbocharger	$\leq 5 \text{ kPa}^{1)}$

	No derating up to stated reference conditions (tropic), see 1.
Relative humidity Φ_r	$\leq 60\%$
¹⁾ Below/above atmospheric pressure.	

Table 16: Derating – Limits of ambient conditions

2. Derating

Contact Everllence:

- If limits of ambient conditions mentioned in the upper table [Derating – Limits of ambient conditions, Page 43](#) are exceeded. A special calculation is necessary.
- If higher requirements for the emission level exist. For the permissible requirements see section [Exhaust gas emission, Page 98](#).
- If special requirements of the plant for heat recovery exist.
- If special requirements on media temperatures of the engine exist.
- If any requirements of Everllence mentioned in the Project Guide cannot be met.

2.4.6 Engine speeds and related main data

Engine V28/33D STC

Rated speed	rpm	1,000 (1,032) ¹⁾
Permissible range of the speed		^{2) 3)}
Clutch ⁴⁾		
Minimum engine speed for activation (FPP)		400 ⁵⁾
Minimum engine speed for activation (CPP)		400 ⁵⁾
Maximum engine speed for activation		1,000 ⁶⁾
Highest engine operating speed		1,000 (1,032) ¹⁾
Alarm overspeed		1,070
Auto shutdown overspeed via control module/alarm		1,100

¹⁾ For engines with ICFN power definition (Navy load profile) as described in section [Power definition and load profile, Page 41](#).

²⁾ According, see section [STC operating range for mechanical propulsion \(FPP, water jet, CPP\), Page 63](#).

³⁾ In rare occasions it might be necessary that certain engine speed intervals have to be barred for continuous operation. For FPP applications as well as for applications using resilient mounted engines, the admissible engine speed range has to be confirmed (preferably at an early project phase) by a torsional vibration calculation, by a dimensioning of the resilient mounting, and, if necessary, by an engine operational vibration calculation.

⁴⁾ Engagement of clutch needs to be finished latest in 5 minutes, to minimize engine operation time without load at high speed.

⁵⁾ Dependent also on clutch in load.

⁶⁾ May possibly be restricted by manufacturer of clutch. Nominal speed for activation of clutch only allowed for necessity of switching a 2nd engine to an already driven shaft. After activation of clutch in accordance to Project Guide engine load to be increased instantly for a homogenous load distribution between these engines.

Table 17: Speeds

2.4.7 Speed adjusting range

The following specification represents the standard settings. For special applications, deviating settings may be necessary.

	Drive	Speed droop	Maximum speed at full load	Maximum speed at idle running	Minimum speed
Electronic speed control	Parallel operation of 2 engines driving 1 shaft with/without PTO (CPP):				
	Conventional	5%	100% (+0.5%)	105% (+0.5%)	40%
	or master/slave operation	0%	100% (+0.5%)	100% (+0.5%)	40%
	Fixed pitch propeller plants	0%	100% (+0.5%)	-	30%

Table 18: Electronic speed control

Note:

Only if several engines drive one shaft with fixed pitch propeller, the speed droop is relevant for the load distribution. In the case of electronic speed control, a speed droop of 0% is also possible during parallel operation.

2.5 Increased exhaust gas pressure due to exhaust gas after treatment installations

Resulting installation demands

If the recommended exhaust gas back pressure as stated in section [Operating/service temperatures and pressures, Page 90](#) cannot be met due to exhaust gas after treatment installations following limit values need to be considered.

Exhaust gas back pressure after turbocharger	
Operating pressure Δp_{exh} , maximum specified	0–50 mbar
Operating pressure Δp_{exh} , range with increase of fuel consumption or possible derating	50–80 mbar
Operating pressure Δp_{exh} , where agreement and feedback of Everllence is required	> 80 mbar

Table 19: Exhaust gas back pressure after turbocharger

Intake air pressure before turbocharger	
Operating pressure Δp_{intake} , standard	0 to –20 mbar
Operating pressure Δp_{intake} , range with increase of fuel consumption or possible derating	–20 to –40 mbar
Operating pressure Δp_{intake} , where agreement and feedback of Everllence is required	< –40 mbar

Table 20: Intake air pressure before turbocharger

Sum of the exhaust gas back pressure after turbocharger and the absolute value of the intake air pressure before turbocharger	
Operating pressure $\Delta p_{\text{exh}} + \text{Abs}(\Delta p_{\text{intake}})$, standard	0–70 mbar
Operating pressure $\Delta p_{\text{exh}} + \text{Abs}(\Delta p_{\text{intake}})$, range with increase of fuel consumption or possible derating	70–120 mbar
Operating pressure $\Delta p_{\text{exh}} + \text{Abs}(\Delta p_{\text{intake}})$, where agreement and feedback of Everllence is required	> 120 mbar

Table 21: Sum of the exhaust gas back pressure after turbocharger and the absolute value of the intake air pressure before turbocharger

Maximum exhaust gas pressure drop – Layout

- Supplier of equipment in exhaust gas line have to ensure that pressure drop Δp_{exh} over entire exhaust gas piping incl. pipe work, scrubber, boiler, silencer, etc. must stay below stated standard operating pressure at all operating conditions.
- It is recommended to consider an additional 10 mbar for consideration of aging and possible fouling/staining of the components over lifetime.
- A proper dimensioning of the entire flow path including all installed components is advised or even the installation of an exhaust gas blower if necessary.
- At the same time the pressure drop Δp_{intake} in the intake air path must be kept below stated standard operating pressure at all operating conditions and including aging over lifetime.
- For significant overruns in pressure losses even a reduction in the rated power output may become necessary.
- On plant side it must be prepared, that pressure sensors directly after turbine outlet and directly before compressor inlet may be installed to verify above stated figures.

By-pass for emergency operation

- Evaluate if the chosen exhaust gas after treatment installation demands a by-pass for emergency operation.
- For scrubber application, a by-pass is recommended to ensure emergency operation in case that the exhaust gas cannot flow through the scrubber freely.
- The by-pass needs to be dimensioned for the same pressure drop as the main installation that is by-passed – otherwise the engine would operated on a differing operating point with negative influence on the performance, e.g. a lower value of the pressure drop may result in too high turbocharger speeds.

Single streaming per engine recommended/multi-streaming to be evaluated project-specific

- In general each engine must be equipped with a separate exhaust gas line as single streaming installation. This will prevent reciprocal influencing of the engine as e.g. exhaust gas backflow into an engine out of operation or within an engine running at very low load (negative pressure drop over the cylinder can cause exhaust gas back flow into intake manifold during valve overlap).
- In case a multi-streaming solution is realised (i.e. only one combined scrubber for multiple engines) this needs to be stated on early project stage. Hereby air/exhaust gas tight flaps need to be provided to safeguard engines out of operation. A specific layout of e.g. sealing air mass flow will be necessary and also a power management may become ne-

cessary in order to prevent operation of several engines at very high loads while others are running on extremely low load. A detailed analysis as HAZOP study and risk analysis by the yard becomes mandatory.

Engine to be protected from backflow of media out of exhaust gas after treatment installation

- A backflow of e.g. urea, scrubbing water, condensate or even rain from the exhaust gas after treatment installation towards the engine must be prevented under all operating conditions and circumstances, including engine or equipment shutdown and maintenance/repair work.

Turbine cleaning

- Both wet and dry turbine cleaning must be possible without causing malfunctions or performance deterioration of the exhaust system incl. any installed components such as boiler, scrubber, silencer, etc.

White exhaust plume by water condensation

- When a wet scrubber is in operation, a visible exhaust plume has to be expected under certain conditions. This is not harmful for the environment. However, countermeasures like reheating and/or a demister should be considered to prevent condensed water droplets from leaving the funnel, which would increase visibility of the plume.
- The design of the exhaust system including exhaust gas after treatment installation has to make sure that the exhaust flow has sufficient velocity in order not to sink down directly onboard the vessel or near to the plant. At the same time the exhaust pressure drop must not exceed the limit value.

Vibrations

- There must be a sufficient decoupling of vibrations between engine and exhaust gas system incl. exhaust gas after treatment installation, e.g. by compensators.

2.6 Starting

2.6.1 General remarks

Engine and plant installation need to be in accordance to the below stated requirements and the required starting procedure.

Note:

Statements are relevant for non arctic conditions.

For arctic conditions consider relevant sections and clarify undefined details with Everllence.

2.6.2 Type of engine start

Normal start

The standard procedure of a monitored engine start in accordance to Everllence guidelines.

For details and requirements see section [Starting conditions, Page 49](#).

Stand-by start

Shortened starting up procedure of a monitored engine start: Several preconditions and additional plant installations required.

This kind of engine start has to be triggered by an external signal: "Stand-by start required".

For details and requirements see section [Starting conditions, Page 49](#).

Exceptional start (e.g. blackout start)

A monitored engine start (without monitoring of lube oil pressure) within one hour after stop of an engine that has been faultless in operation or of an engine in stand-by mode.

This kind of engine start has to be triggered by an external signal "Black Start" and may only be used in exceptional cases.

For details and requirements see section [Starting conditions, Page 49](#).

Emergency start

Manual start of the engine at emergency start valve at the engine (if applied), without supervision by the SaCoS engine control. These engine starts will be applied only in emergency cases, in which the customer accepts, that the engine might be harmed.

2.6.3 Requirements on engine and plant installation

As stated in section [Engine equipment for various applications, Page 36](#) the V28/33D STC in general is equipped with attached lubrication pump, HT- and LT cooling water pump, seawater pump and fuel oil supply pump.

Additional plant installation requirements

As a standard and for start-up in normal starting mode (preheated engine) following installations are required:

- Prelubrication pump (free-standing)
- Preheating HT cooling water system (40–68°C)
- Preheating lube oil system in case of stand-by operation and if minimum temperature +20°C of lube oil can not be kept (40–55°C), see accordingly section [External lube oil system, Page 205](#)

Additional plant installation requirements for "Stand-by Operation" capability

To enable in addition to the normal starting mode also an engine start from PMS (Power Management System) from stand-by mode with thereby shortened start-up time following installations are required:

- Prelubrication pump (free-standing) with low pressure before engine ($0.3 \text{ bar} < p_{\text{Oil before engine}} < 0.6 \text{ bar}$)
- Preheating HT cooling water system (40–68°C)
- Preheating lube oil system (40–55°C), see accordingly section [External lube oil system, Page 205](#)
- Power management system with supervision of stand-by times engines

Additional plant installation requirements for "Blackout start" capability

As the V28/33D STC is equipped with all required attached pumps on plant side only following item needs to be considered:

- Regarding "Blackout start" fuel oil conditions, see table [Fuel, Page 94](#).

2.6.4 Starting conditions

Type of engine start:	Blackout start	Stand-by start	Normal start
Explanation:	After blackout	From stand-by mode	After stand-still
Start-up time until load application:	< 1 minute	< 1 minute	> 2 minutes
General notes			
-	Engine start-up only within 1 h after stop of engine that has been faultless in operation or within 1 h after end of stand-by mode.	Maximum stand-by time 7 days ¹⁾ . Supervised by power management system plant. Stand-by mode is only possible after engine has been faultless in operation and has been faultless stopped.	Standard
Additional external signal:	Blackout start	Stand-by request	-
¹⁾ If an engine has been in total for 7 days in stand-by mode, no extension of stand-by mode is allowed. The engine needs to be started and operated faultless before the next stand-by mode can be applied. Prior to next stand-by mode, engine needs to be operated at minimum 50% output for ≥ 30 min.			

Table 22: Starting conditions – General notes

Type of engine start:	Blackout start	Stand-by start	Normal start
General engine status	No start-blocking active	Engine in proper condition No start-blocking active Note: Start-blocking of engine leads to withdraw of "stand-by mode".	Engine in proper condition No start-blocking active
Engine to be turned before start?	No	Yes ¹⁾	Yes ²⁾
Engine to be pre-heated and prelubricated?	No ³⁾	Yes	Yes
¹⁾ Engine has to be turned after 12 hours of standstill (shorter time intervals after alignment with Everllence possible). ²⁾ It is recommended to install slow turn. Otherwise the engine has to be turned by turning gear. ³⁾ Valid only, if mentioned above conditions (see table Starting conditions – General notes, Page 49) have been considered. Non-observance endangers the engine or its components.			

Table 23: Starting conditions – Required engine conditions

Type of engine start:	Blackout start	Stand-by start	Normal start
Lube oil system			
Prelubrication period	No ¹⁾	Permanent	Yes, previous to engine start

Type of engine start:	Blackout start	Stand-by start	Normal start
Prelubrication pressure before engine	-	See section Operating/service temperatures and pressures, Page 90 limits according figure "Prelubrication/postlubrication lube oil pressure (duration > 10 min)"	See section Operating/service temperatures and pressures, Page 90 limits according figure "Prelubrication/postlubrication lube oil pressure (duration ≤ 10 min)"
HT cooling water			
HT cooling water to be preheated?	No ¹⁾	Yes	Yes
Fuel system			
For MGO operation	No special preparations required	External fuel system in operation or in operation with starting command to engine.	

¹⁾ Valid only, if mentioned above conditions (see table [Starting conditions – General notes, Page 49](#)) have been considered. Non-observance endangers the engine or its components.

Table 24: Starting conditions – Required system conditions V28/33D STC

2.6.5 Start-up – Definitions and requirements

General remark	Prior to the start-up of the engine it must be ensured that the emergency stop of the engine is working properly. Additionally all required supply systems must be in operation or in stand-by operation.
Start-up – Cold engine	If an engine start has to be activated under cold engine conditions, following requirements have to be fulfilled as a minimum: ▪ Lube oil temperature +5°C, HT cooling water temperature ≥ 5°C. ▪ The engine is prelubricated. Due to the higher viscosity of the lube oil of a cold engine the prelubrication phase needs to be increased. Before further use of the engine a warming-up phase is required to reach at least the level of the regular preheating temperatures (lube oil temperature > 20°C, cooling water temperature > 40°C). Note: ▪ It needs to be proven within plant layout, that lube oil circuit is capable to be operated at stated low lube oil temperature with accordingly high viscosity and high pressures. ▪ If engine cold start is frequently performed, wear could increase in a long-term perspective. ▪ "Start-Reliability" under stated cold start conditions is reduced and cannot be guaranteed, as the probability of a false start is increased. ▪ If applicable, warming-up phase can be shortened if engine is operated at lower speed.
Start-up – Preheated engine (Normal start)	For the start-up of the engine it needs to be preheated: ▪ Lube oil temperature ≥ 20°C. ▪ HT cooling water temperature ≥ 40°C.
Start-up – Engine in stand-by mode (Stand-by start)	For engines in stand-by mode no start preparation is needed and accordingly the engine start will be done just after the start request (if preconditions are fulfilled). Required conditions media system:

- 0.3 bar < prelubrication pressure before engine < 0.6 bar.
- Lube oil temperature $\geq 40^{\circ}\text{C}$, see accordingly section [Lube oil system, Page 199](#)
- HT cooling water temperature $\geq 40^{\circ}\text{C}$

Start-up (Exceptional start) The engine start will be done just after the start request – but as previously stated without monitoring of lube oil pressure, and therefore this may only be used in exceptional cases.

2.7 Low-load operation

Definition

Basically, the following load conditions are distinguished:

- Overload: > 100% (MCR) of the engine output (not admitted, see section [Engine ratings \(output\) for different applications, Page 43](#))
- Full load (MCR): 100% (MCR) of the engine output
- Part load: < 100% (MCR) of the engine output
- Low load: < 25% of the engine output

Correlations The best operating conditions for the engine prevail under even loading in the range of 60% to 90% of full load.

During idle or no-load operation, combustion in the combustion chamber is incomplete.

This may result in the forming of deposits in the combustion chamber, which will lead to increased soot emission and to increasing cylinder contamination.

There are no restrictions at loads > 15% of the full load, provided that the specified engine operating values are not exceeded.

Important remark for SCR operation

Long-term low-load operation may lead to an increase of the back pressure of the SCR system and initiate the regeneration. It may be required to adapt the engine load during the regeneration phase. See figure SCR regeneration areas.

If the automatic regeneration occurs more than once per day, the engine load must be adapted manually to reach sufficient temperatures for the regeneration process.

2.7.1 Low-load operation V28/33D STC

Sequential Turbocharging (STC) allows to operate the engine for extended periods in low-load operation.

Figure [Time limitation for low-load operation \(navy and ferry application\), Page 51](#) shows time-limited areas for low-load operation.

Range II: Operating range which is temporarily admissible e.g. during acceleration and manoeuvring.

After a phase of 12 respectively 48 hours in low-load operation, the load must be increased up to 70% of full load for 15 to 20 minutes.

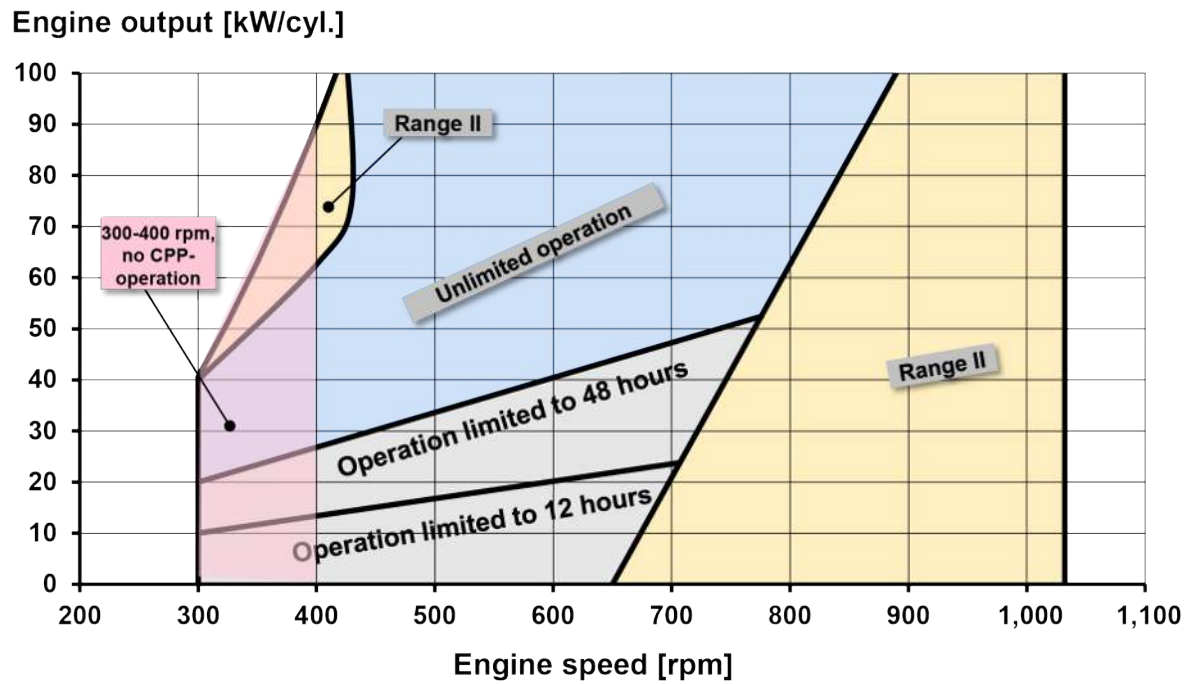


Figure 20: Time limitation for low-load operation (navy and ferry application)

2.8 Engine load reduction and engine stop

Sudden load shedding

For the sudden load shedding from 100% to 0% engine load, several requirements of the classification societies regarding the dynamic and permanent change of engine speed have to be fulfilled.

In case of a sudden load shedding and related compressor surging, check the proper function of the turbocharger silencer filter mat.

Recommended load reduction/stopping the engine

Figure [Engine ramping down, generally, Page 54](#) shows the shortest possible times for continuously ramping down the engine.

Even with the stated shortest possible times for continuously ramping down (Phase 1 and Phase 2) the requirements of ISO 8528-5 G2 will be fulfilled.

To limit the effort regarding regulating the media circuits and also to ensure an uniform heat dissipation it always should be aimed for longer ramping down times by taking into account the realistic requirements of the specific plant.

Before final engine stop, the engine has to be operated for a minimum of 1 minute in no-load operation.

Run-down cooling

In order to dissipate the residual engine heat, the system circuits should be kept in operation after final engine stop.

	Minimum operation time after final engine stop
Lube oil circuit	15 min.
HT circuit	15 min.
LT circuit ¹⁾²⁾	150 min
¹⁾ Also serves for compressor wheel cooling.	
²⁾ See accordingly for the layout of the LT cooling water pump section LT cooling water system, Page 216 .	

Table 25: System circuit operation time after engine stop

If for any reason the HT cooling water stand-by pump and/or the preheating unit is not in function, the engine has to be operated for 15 minutes at 0%-15% load before final stop, so that with the engine driven HT cooling water pump the heat will be dissipated.

If for any reason a LT cooling water stand-by pump is not in function, the engine has to be operated for 5 minutes at 0%-15% load before final stop, so that with the engine driven LT cooling water pump the heat in the TC will be dissipated.

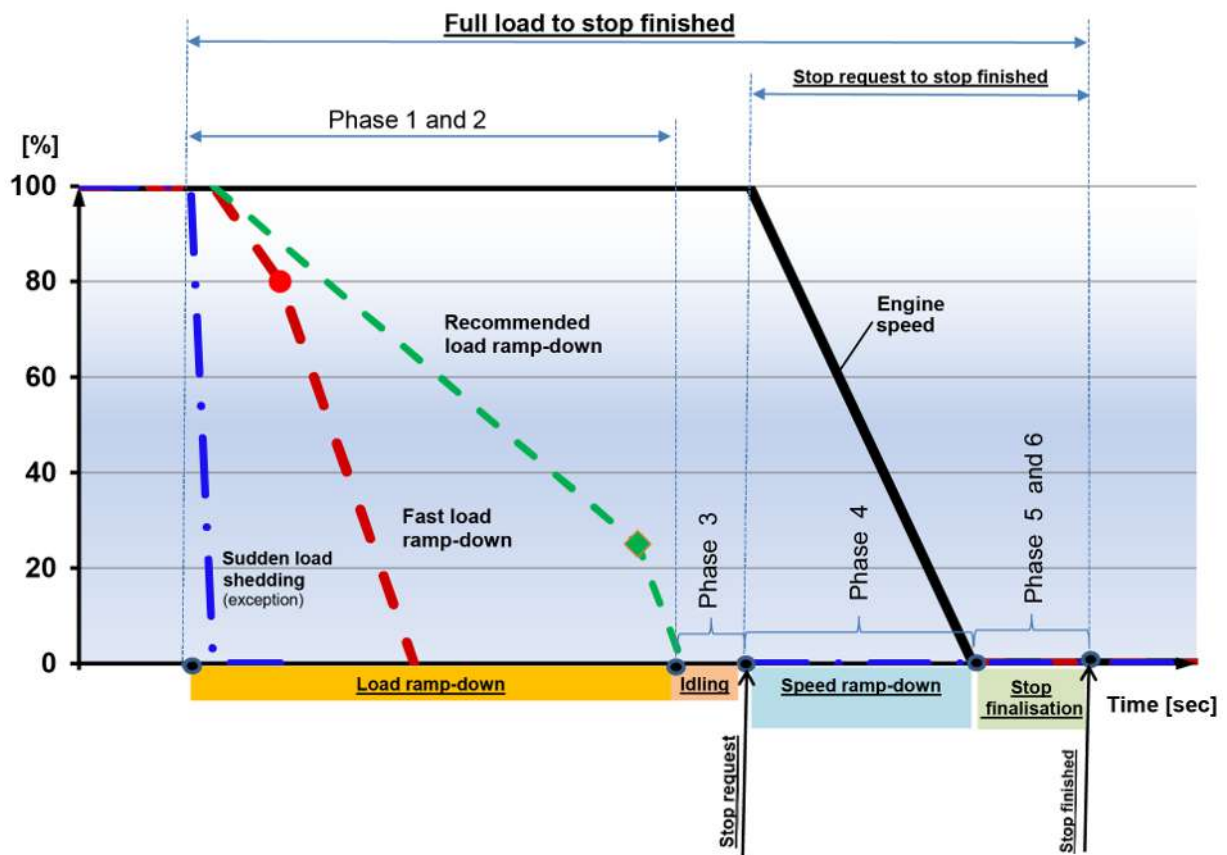


Figure 21: Engine ramping down, generally

Duration "Full load to stop finished"						
Phase	1	2	3	4	5 and 6	-
Designation	Load ramp-down	Load ramp-down	No-load operation	Speed ramp-down	5) SaCoS stop process finalisation 6) Run down cooling and lubrication ¹⁾	Total duration ≥
Speed [%]	100	100	100	100-0	0	-
Load [%]	100-80	80-0	0	0	0	-
Time [sec]	4	6	60	60	5) Active stand-by: 60 sec Otherwise: > 300 sec 6) 9,000 sec	5) 430 sec 6) 9,130 sec

¹⁾ Run down cooling, for details see table [System circuit operation time after engine stop, Page 53](#).

2.9 Engine load reduction as a protective safety measure

Requirements for the power management system/propeller control

In case of a load reduction request due to predefined abnormal engine parameter (e.g. high exhaust gas temperature, high turbine speed, high lube oil temperature) the power output (load) must be ramped down as fast as possible to $\leq 60\%$ load.

Therefore the power management system/propeller control has to meet the following requirements:

- After a maximum of 5 seconds after occurrence of the load reduction signal, the engine load must be reduced by at least 5%.
- Then, within the next time period of maximum 30 sec an additional reduction of engine load by at least 35% needs to be applied.
- The “Prohibited range” shown in figure [Engine load reduction as a protective safety measure, Page 55](#) has to be avoided.

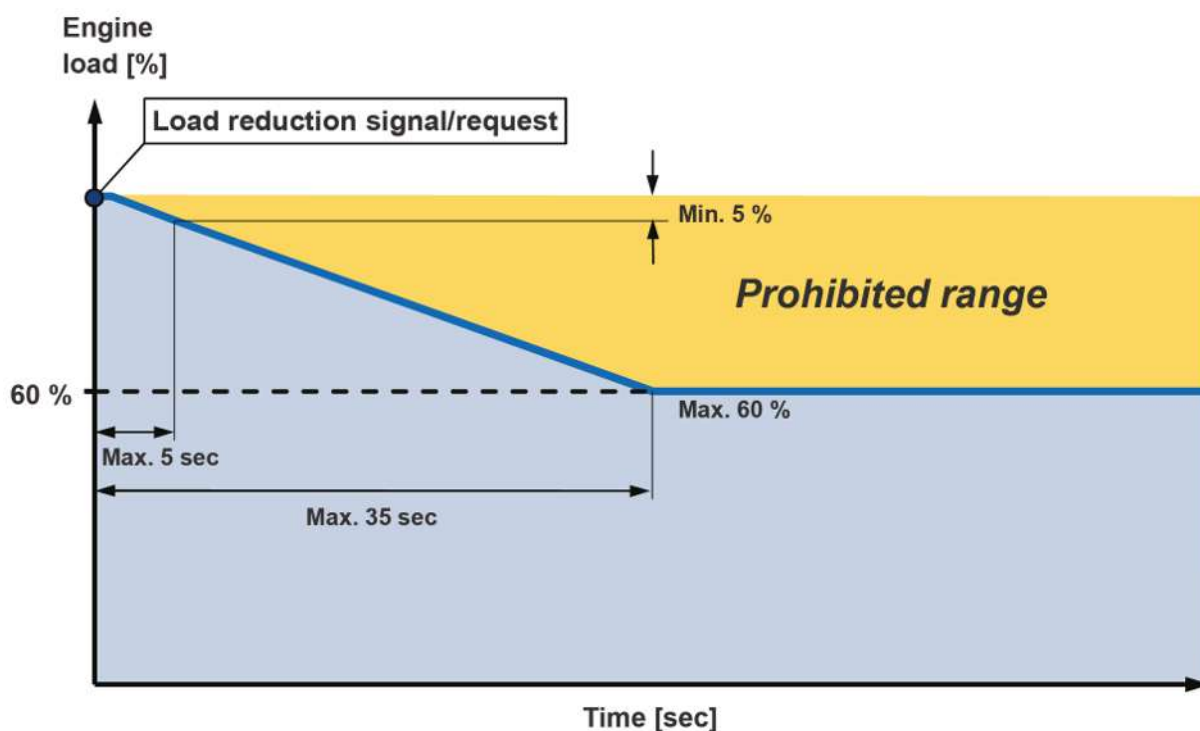


Figure 22: Engine load reduction as a protective safety measure

Run-down cooling

In order to dissipate the residual engine heat, the system circuits should be kept in operation after final engine stop.

	Minimum operation time after final engine stop
Lube oil circuit	15 min.
LT circuit ¹⁾	150 min.
HT circuit	15 min.

	Minimum operation time after final engine stop
1) Also serves for compressor wheel cooling.	

Table 26: System circuit operation time after engine stop

If for any reason the HT cooling water stand-by pump and/or the preheating unit is not in function, the engine has to be operated for 15 minutes at 0%-15% load before final stop, so that with the engine driven HT cooling water pump the heat will be dissipated.

If for any reason a LT cooling water stand-by pump is not in function, the engine has to be operated for 5 minutes at 0%-15% load before final stop, so that with the engine driven LT cooling water pump the heat in the TC will be dissipated.

2.10 Engine operation under arctic conditions

Arctic condition is defined as:

Air intake temperatures of the engine below 0°C.

If engines operate under arctic conditions (intermittently or permanently), the engine equipment and plant installation have to hold certain design features and meet special requirements. They depend on the possible minimum air intake temperature of the engine and the specification of the fuel used.

Minimum air intake temperature of the engine, t_x :

- Category 1
 $0^\circ\text{C} > t_x > -15^\circ\text{C}$
- Category 2
 $-15^\circ\text{C} \geq t_x > -50^\circ\text{C}$

Special engine design requirements

Special engine equipment required for arctic conditions category 1 and category 2, see section [Engine equipment for various applications, Page 36](#).

Engine equipment

SaCoS 5000

- SaCoS 5000 equipment is suitable to be stored at minimum ambient temperatures of -15°C .
- In case these conditions cannot be met, protective measures against climatic influences have to be taken for the following electronic components:
 - EDS Data box
 - TFT-touchscreen
 - Emergency switch module

These components have to be stored at places, where the temperature is above -15°C .

- A minimum operating temperature of $\geq 0^\circ\text{C}$ has to be ensured. The use of an optional electric heating is recommended.

See environmental conditions in section [Technical data – Environmental conditions, Page 149](#).

Plant installation

Engine intake air conditioning

- Cooling down of engine room due to cold ambient air can be avoided by supplying the engine directly from outside with combustion air. For this the combustion air must be filtered (see quality requirements in section [Specification of intake air \(combustion air\), Page 172](#)). Moreover a droplet separator and air intake silencer become necessary, see section [Intake air ducting in case of arctic conditions, Page 238](#). According to classification rules it may be required to install two air inlets from the exterior, one at starboard and one at portside.
- Cold intake air from outside is preheated in front of the cylinders in the charge air cooler. HT water serves as heat source. Depending on load and air temperature additional heat has then to be transferred to the HT circuit by a HT preheating module.

- It is necessary to ensure that the charge air cooler cannot freeze when the engine is out of operation (and the cold air is at the air inlet side). HT cooling water preheating will prevent this. Additionally it is recommended to prepare the combustion air duct upstream of the engine for the installation of a blanking plate, necessary to be installed in case of malfunction on the HT cooling water preheating system.

Category 1

- Charge air blow-off is activated at high engine load with low combustion air temperature. With a blow-off air duct installed in the plant, it can be re-circulated in the combustion air duct upstream of the engine. Alternatively, only if blow-off air is deviated downstream of the charge air coolers and is cold (depending on engine type), blow-off air can be directly released in the engine room. Then a blow-off air silencer installed in the plant becomes necessary.
- Alternatively engine combustion air and engine room ventilation air can be supplied together in the engine room, if heated adequately and if accepted by the classification company.

Category 2

- Contact Everllence.

Piping for charge air blow-off

To ensure a correct operation of the charge air blow-off, the following need to be considered:

- Charge air blow-off flap installed at plant
- Diameter of piping > DN100
- Admissible pressure loss in piping between engine and flap: < 500 mbar
- Admissible pressure loss in piping after flap: < 1,000 mbar

Hereby as additional information, the expected charge air blow-off amount (per cylinder) and temperature is stated, dependent on the intake air temperature before compressor.

Charge air blow-off amount quantity										
Intake air temperature before compressor [°C]		-55	-45	-35	-25	-20	-15	-10	-5	0
12V										
Orifice installed at engine [mm]		Project-specific	45	38	29	23	17	11	6	0
Max. blow-off mass flow 12V (100% engine load) [kg/s]			1.50	1.10	0.67	0.47	0.28	0.13	0.03	0
Max. blow-off temperature [°C] ¹⁾	Hot blow-off		125	140	155	163	171	178	185	191
16V										
Orifice installed at engine [mm]		Project-specific	45	35	30	22	15	7	0	
Max. blow-off mass flow 16V (100% engine load) [kg/s]			1.49	0.98	0.72	0.45	0.45	0.06	0	
Max. blow-off temperature [°C] ¹⁾	Hot blow-off		142	157	164	172	180	187	188	
20V										
Orifice installed at engine [mm]		Project-specific			46	40	34	25	13	0

Charge air blow-off amount quantity										
Intake air temperature before compressor [°C]		-55	-45	-35	-25	-20	-15	-10	-5	0
Max. blow-off mass flow 20V (100% engine load) [kg/s]					1.57	1.20	0.90	0.55	0.18	0
Max. blow-off temperature [°C] ¹⁾	Hot blow-off				159	169	176	184	192	193
Tolerances: ±5°C for temperature, ±4% for flow quantity.										
¹) Temperatures specified for insulation design are max. blow-off temperature at 0°C intake air										

Table 27: Charge air blow-off amount quantity

Admissible pressure loss piping	Between engine and flap	< 500 mbar
	After flap	< 1,000 mbar

Instruction for minimum admissible fuel temperature

- In general the minimum viscosity before engine of 1.5 cSt must not be undershoot.
- The fuel specific characteristic values “pour point” and “cold filter plugging point” have to be observed to ensure pumpability respectively filterability of the fuel oil.
- Fuel temperatures of $\leq -10^{\circ}\text{C}$ are to be avoided, due to temporarily embrittlement of seals used in the engines fuel oil system. As a result they may suffer a loss of function.

Minimum engine room temperature

- Ventilation of engine room.
The air of the engine room ventilation must not be too cold (preheating is necessary) to avoid the freezing of the liquids in the engine room systems.
- Minimum power house/engine room temperature for design $\geq +5^{\circ}\text{C}$.

Coolant and lube oil systems

- Coolant and lube oil system have to be preheated for each individual engine, see section [Starting conditions, Page 49](#).
See also the specific information regarding special arrangements for arctic conditions, see section [Lube oil system, Page 199](#) and [Water systems, Page 214](#).
- Design requirements for the external preheater of HT cooling water systems according to stated preheater sizes, see figure [Required preheater size to avoid heat extraction from HT system, Page 60](#).
- Maximum permissible antifreeze concentration (ethylene glycol) in the engine cooling water.
An increasing proportion of antifreeze decreases the specific heat capacity of the engine cooling water, which worsens the heat dissipation from the engine and will lead to higher component temperatures.
- If antifreeze agents must be used, consult Everllence beforehand. Antifreeze agents reduce the capacity of the coolant to absorb heat. In some cases the cooling effect of the coolant may be insufficient.
- For information regarding engine cooling water see section [Specification for engine supplies, Page 159](#).

Insulation

The design of the insulation of the piping systems and other plant parts (tanks, heat exchanger etc.) has to be modified and designed for the special requirements of arctic conditions.

Heat tracing

To support the restart procedures in cold condition (e.g. after unmanned survival mode during winter), it is recommended to install a heat tracing system in the pipelines to the engine.

Note:

A preheating of the lube oil has to be ensured. If the plant is not equipped with a lube oil separator (e.g. plants only operating on MGO) alternative equipment for preheating of the lube oil must be provided.

For plants taken out of operation and cooled down below temperatures of +5°C additional special measures are needed – in this case contact Everllence.

Heat extraction HT system and preheater sizes

After engine start, it is necessary to ramp up the engine to the below specified Range II to prevent too high heat loss and resulting risk of engine damage.

Thereby Range I must be passed as quick as possible to reach Range II. Be aware that within Range II low-load operation restrictions may apply.

If operation within Range I is required, the preheater size within the plant must be capable to preheat the intake air to the level, where heat extraction from the HT system is not longer possible.

Example 1:

- Operation at 20% engine load and –45°C intake air temperature wanted.
- Preheating of intake air from –45°C up to minimum –16.5°C required.
=> According diagram preheater size of 9 kW/cyl. required.
- Ensure that this preheater size is installed, otherwise this operation point is not permissible.

All preheaters need to be operated in parallel to engine operation until minimum engine load is reached.

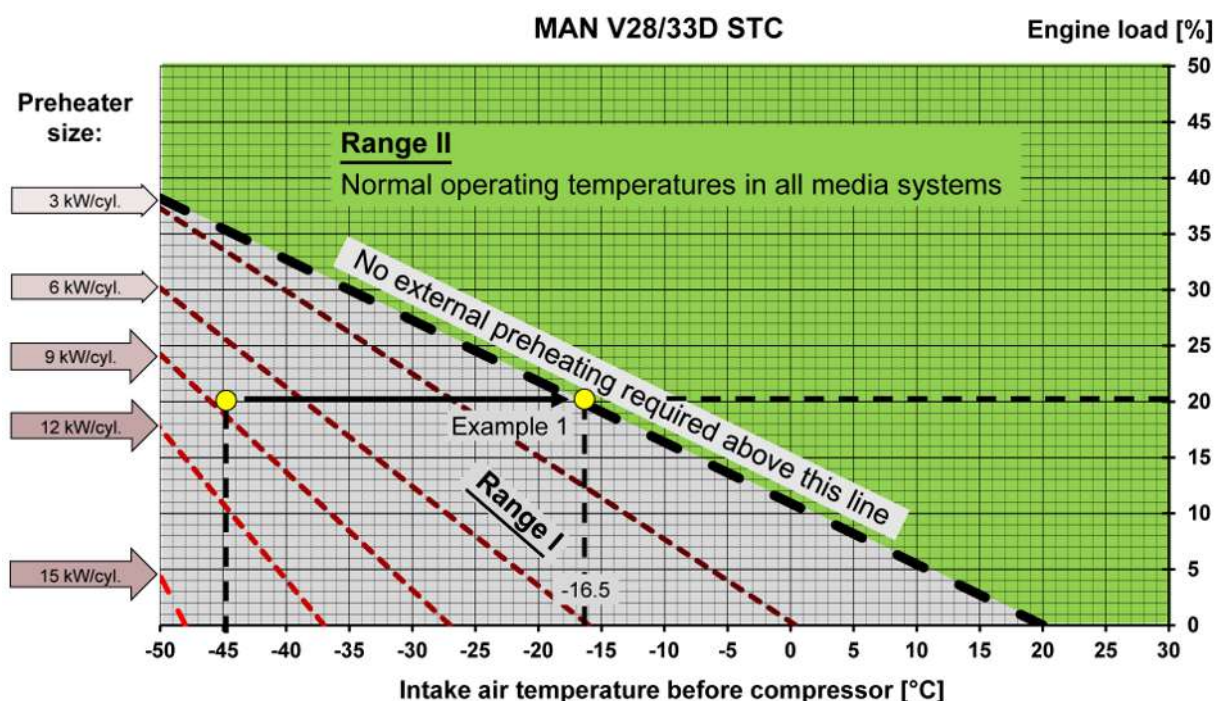


Figure 23: Required preheater size to avoid heat extraction from HT system

Important remark for SCR operation under arctic conditions

- Note that the SCR will be deactivated below -10°C intake air temperature.

2.11 Earthing measures of diesel engines

General

The use of electrical equipment on diesel engines requires precautions to be taken for protection against shock current and for equipotential bonding. These measures not only serve as shock protection but also for functional protection of electric and electronic devices (EMC protection, device protection in case of welding, etc.).

Earthing connections on the engine

Threaded bores M12, 17 mm deep, marked with the earthing symbol are provided in the engine foot on both ends of the engine.

It has to be ensured that earthing is carried out immediately after engine set-up. If this cannot be accomplished any other way, at least provisional earthing is to be effected right after engine set-up.

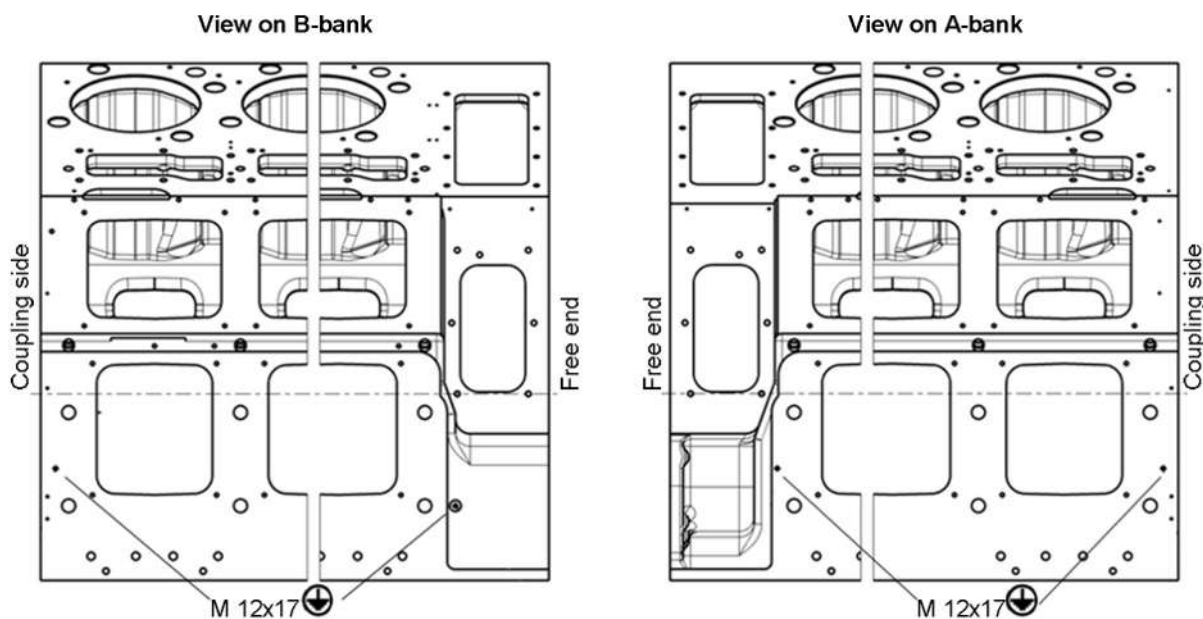


Figure 24: Earthing connection on engine

Earthing conductor

The nominal cross section of the earthing conductor (equipotential bonding conductor) has to be selected in accordance with DIN VDE 0100, part 540 (up to 1 kV) or DIN VDE 0141 (in excess of 1 kV).

Generally, the following applies:

The protective conductor to be assigned to the largest main conductor is to be taken as a basis for sizing the cross sections of the equipotential bonding conductors.

Earthing conductors have to be provided at two diagonally opposite points of engine.

Flexible conductors have to be used for the connection of resiliently mounted engines.

Execution of earthing

The earthing must be executed by the shipyard, since generally it is not scope of supply of Everllence.

Earthing strips are also not included in the Everllence scope of supply.

Additional information regarding the use of welding equipment

In order to prevent damage on electrical components, it is imperative to earth welding equipment close to the welding area, that is, the distance between the welding electrode and the earthing connection should not exceed 10 m.

2.12 Propeller operation

2.12.1 STC operating range for mechanical propulsion (FPP, water jet, CPP)

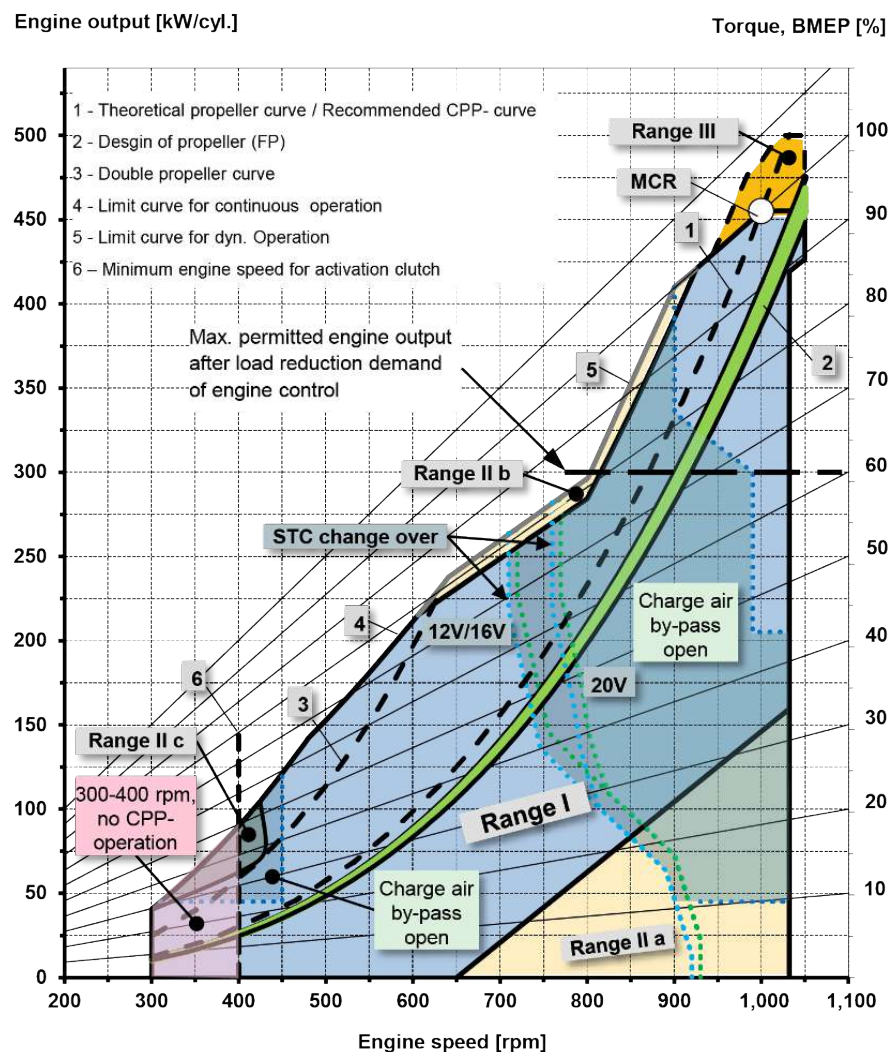


Figure 25: STC operating range for mechanical propulsion (FPP, water jet, CPP)

Note:

In rare occasions it might be necessary that certain engine speed intervals have to be barred for continuous operation.

For FPP applications as well as for applications using resilient mounted engines, the admissible engine speed range has to be confirmed (preferably at an early project phase) by a torsional vibration calculation, by a dimensioning of the resilient mounting, and, if necessary, by an engine operational vibration calculation.

MCR = Maximum continuous rating.

Operating ranges

Range I: Operating range for continuous operation.

Note:

Operation at higher power or lower speed than limited by the "limit curve for continuous operation" is only permitted for less than 1 minute.

Range II: Operating range which is temporarily (less than 1 minute) admissible e.g. during acceleration and manoeuvring (II a, II b and II c).

Range III: For engines with ICFN power definition ("Navy" load profile) as described in section [Power definition and load profile, Page 41](#).

Recommendation for manoeuvring

- For fast load response during manoeuvring we recommend to use left side of range I, before change from one TC to both TC (300 rpm up to max. 700 rpm)
- For CPP power trains with manoeuvring power requirements up to nominal power we recommend nominal speed operation

Design of propeller (FPP)

A new propeller must be designed to be operated within this range (2). Boundary conditions for the design are clean hull, calm weather, propeller light running inter alia.

The propeller design depends on type and application of the vessel. Therefore the determination of the installed propulsive power in the ship is always the exclusive responsibility of the yard. Determining the engine power: The energy demand or the energy losses from all at the engine additionally attached aggregates has to be considered (e.g. shaft alternators, gearboxes). That means, after deduction of their energy demand from the engine power the remaining engine power must be sufficient for the required propulsion power.

Design of water jet propulsion

A water jet propulsion must be designed such:

- Engine power of 455 kW/cyl. is reached in the range of 1,000 rpm to 1,050 rpm
- When taking into account the water jet propulsion tolerance with respect to rpm at 100% output, both the minimum and maximum rpm at 100% output are within the range of 1,000 rpm to 1,050 rpm (e.g. 100% output is reached at 1,015 rpm, and water jet propulsion tolerance is ± 15 rpm, then minimum rpm for 100% load is 1,000 rpm, maximum is 1,030 rpm)

Preferably, the minimum rpm is 1,000 rpm. This contributes to low SFOC of the engine.

Determining the engine power

The energy demand or the energy losses from all aggregates additionally attached to engine have to be considered (e.g. shaft alternators, gearboxes).

After deduction of their energy demand from the engine power, the remaining engine power must be sufficient for the required propulsion power.

IMO certification for V28/33D STC engines with operating range for fixed pitch propeller (FPP), water jet propulsion

Test cycle type E3 will be applied for the engine's certification for compliance with the NO_x limits according to NO_x technical code.

IMO certification for V28/33D STC engines with operating range for controllable pitch propeller (CPP)

Test cycle type E2 will be applied for the engine's certification for compliance with the NO_x limits according to NO_x technical code.

STC

The V28/33D STC engine is equipped with a sequentially turbocharging (STC) using two turbochargers, one of them being switched off at lower engine loads.

Within figure [STC operating range for mechanical propulsion \(FPP, water jet, CPP\), Page 63](#) the operating area with one turbocharger and with both turbochargers is stated.

The turbocharger arrangement is shown in figure [Overview flaps, Page 38](#).

2.12.2 General requirements for the CPP propulsion control

General	Pitch control of the propeller plant A distinction between constant-speed operation and combinator-curve operation has to be ensured. Failure of propeller pitch control: In order to avoid overloading of the engine upon failure of the propeller pitch control, the propeller pitch must be adjusted to a value, so that the resulting FPP-curve is covered by the allowed area for continuous operation within the operating diagram.
4–20 mA load indication from engine control	As a load indication a 4–20 mA signal from the engine control is supplied to the propeller control. Combinator-curve operation: The 4–20 mA signal has to be used for the assignment of the propeller pitch to the respective engine speed. The operation curve of engine speed and propeller pitch (for power range, see section STC operating range for mechanical propulsion (FPP, waterjet, CPP), Page 63) has to be observed also during acceleration/load increase and unloading. Acceleration/load increase The engine speed has to be increased prior to increasing the propeller pitch (see figure Example to illustrate the change from one load step to another, Page 66). When increasing propeller pitch and engine speed synchronously, the speed has to be increased faster than the propeller pitch. Automatic limitation of the rate of load increase must be implemented in the propulsion control.

Deceleration/unloading the engine

The engine speed has to be reduced later than the propeller pitch (see figure [Example to illustrate the change from one load step to another, Page 66](#)).

When decreasing propeller pitch and engine speed synchronously, the propeller pitch has to be decreased faster than the speed.

Example to illustrate the change from one load step to another

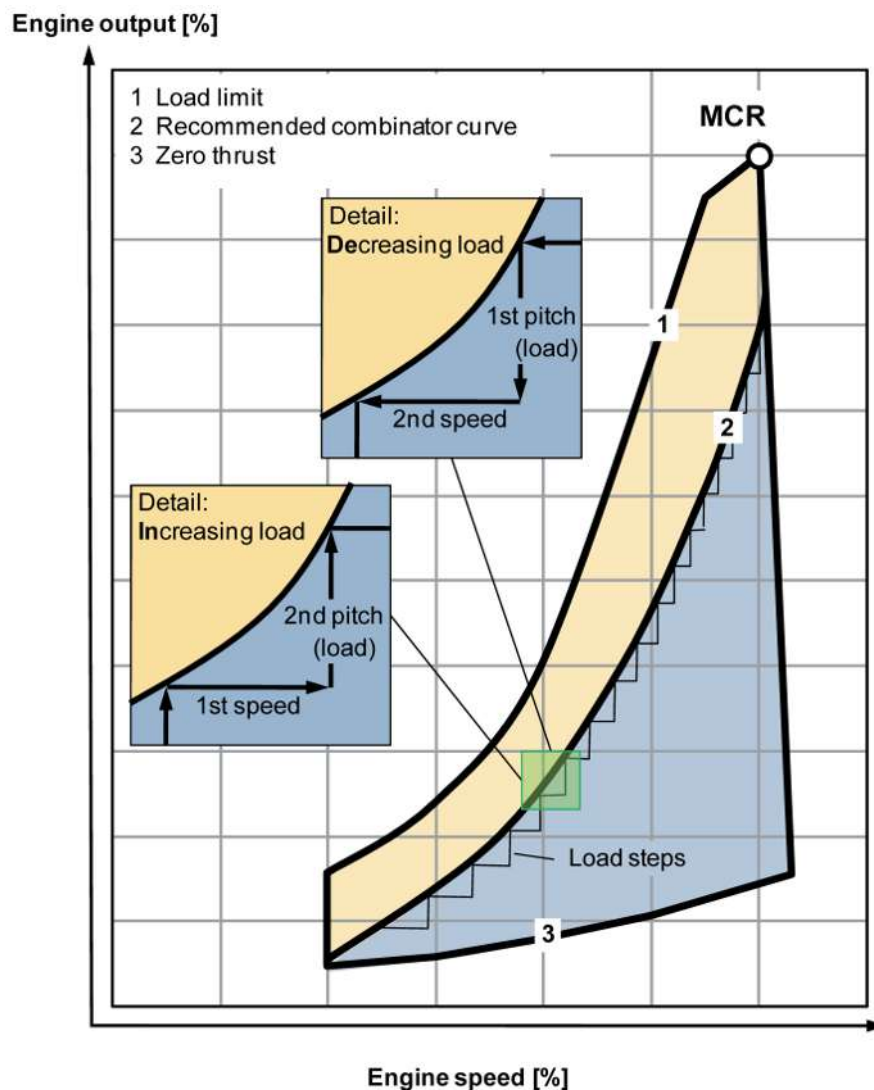


Figure 26: Example to illustrate the change from one load step to another

Windmilling protection

If a stopped engine (fuel admission at zero) is being turned by the propeller, this is called “windmilling”. The permissible period for windmilling is short, because windmilling can cause excessive wear of the engine bearings, due to poor lubrication at low propeller speed.

Single-screw ship

The propeller control has to ensure that the windmilling time is less than 40 sec.

Multiple-screw ship

The propeller control has to ensure that the windmilling time is less than 40 sec. In case of plants without shifting clutch, it has to be ensured that a stopped engine cannot be turned by the propeller.

For maintenance work a shaft interlock has to be provided for each propeller shaft.

Binary signals from engine control

Overload contact

The overload contact will be activated when the engine's fuel admission reaches the maximum position. At this position, the control system has to stop the increase of the propeller pitch. If this signal remains longer than the predetermined time limit, the propeller pitch has to be decreased.

Contact "Operation close to the limit curve"

This contact is activated when the engine is operated close to a limit curve (torque limiter, charge air pressure limiter, etc.). When the contact is activated, the control system has to stop the increase of the propeller pitch. If this signal remains longer than the predetermined time limit, the propeller pitch has to be decreased.

Propeller pitch reduction contact

This contact is activated when disturbances in engine operation occur, for example too high exhaust gas mean-value deviation. When the contact is activated, the propeller control system has to reduce the propeller pitch to 60% of the rated engine output, without change in engine speed.

In section Engine load reduction as a protective safety measure the requirements for the response time are stated.

The power range (see section [STC operating range for mechanical propulsion \(FPP, waterjet, CPP\), Page 63](#)) and the acceleration times (see section [Load application for mechanical propulsion \(FPP and CPP\), Page 68](#) and figure [Control lever setting and corresponding engine specific acceleration times \(for guidance\), Page 70](#)) have to be observed.

In section Engine load reduction as a protective safety measure the requirements for the response time are stated.

2.12.3 General requirements for the FPP propulsion control

In accordance to IACS "Requirements concerning MACHINERY INSTALLATIONS", M43, a single control device for each independent propeller has to be provided, with automatic performance preventing overload and prolonged running in critical speed ranges of the propelling machinery.

Operation of the engine according to the stated FPP operating range has to be ensured.

Load control of the propeller plant

As a load indication a 4–20 mA signal from the engines safety and control system is supplied to the propeller control system.

Windmilling protection

If a stopped engine (fuel admission at zero) is being turned by the propeller, this is called "windmilling". The permissible period for windmilling is short, because windmilling can cause, due to poor lubrication at low propeller speed, excessive wear of the engine bearings.

In case of risk that windmilling can appear for a longer period than 40 sec, the engine has to be protected by opening the clutch of the gearbox or/and a shaft breaking system activation at the propeller shaft by the propulsion control system.

For maintenance work a shaft interlock has to be provided for each propeller shaft.

Binary signals from engine control (SaCoS)

Overload contact

The overload contact will be activated when the fuel admission reaches the maximum position.

The propeller control has to reduce the rpm setpoint until contact will be deactivated again.

Reduction contact

This contact is activated when disturbances in engine operation occur, for example too high exhaust gas mean-value deviation. When the contact is activated, the propeller control system has to reduce the output demand to below 60% of the nominal output of the engine.

In section Engine load reduction as a protective safety measure the requirements for the response time are stated.

Operation close to the limit curves

This contact is activated when the engine is operated close to a limit curve (torque limiter, charge air pressure limiter...). When the contact is activated, the propeller control system has to pause with an increase of a load demand. In case the signal remains longer than the predetermined time limit, the output demand needs to be reduced.

Binary signals to engine control (SaCoS) from ECR or bridge

Override (binary signal by switch)

In case "Override" has been activated, "Stop" or "Reduce" demands of engine safety system will not be executed, but printed at the alarm printer.

Binary signals to engine control (SaCoS) from coupling control

Activation of clutch

To enable engine control (SaCoS) to act at the beginning of the clutch-in procedure a binary signal has to be provided.

2.12.4 Load application for mechanical propulsion (FPP and CPP)

Acceleration times for fixed pitch and controllable pitch propeller plants

General remark

Stated acceleration times in the following figure are valid for the engine itself. Depending on the project-specific propulsion train (moments of inertia, vibration calculation etc.) project-specific this may differ. Of course, the acceleration times are not valid for the ship itself, due to the fact, that the time constants for the dynamic behavior of the engine and the vessel may have a ratio of up to 1:100, or even higher (dependent on the type of vessel). The effect on the vessel must be calculated separately.

Propeller control


For remote controlled propeller drives for ships with unmanned or centrally monitored engine room operation in accordance to IACS "Requirements concerning MACHINERY INSTALLATIONS", M43, a single control device for each independent propeller has to be provided, with automatic performance preventing overload and prolonged running in critical speed ranges of the propelling machinery. Operation of the engine according to the relevant and specific operating range (e.g. Operating range for controllable pitch propeller

(CPP)) has to be ensured. In case of a manned engine room and manual operation of the propulsion drive, the engine room personnel are responsible for the soft loading sequence, before control is handed over to the bridge.

If the direction of the drive shaft is to be changed during maneuvering (applies in particular to fixed pitch propeller plants) the resulting jolt, the possibility of wind milling and operation in the permitted operating range of the engine needs to be considered. It should be aimed for the lowest possible rotational speed of the propeller shaft, when the rotation direction change is initiated. Already in the project planning and design phase the installation of a shaft brake should be considered.

Load control programme

The lower time limits for normal and emergency manoeuvres are given in our diagrams for application and shedding of load. We strongly recommend that the limits for normal manoeuvring are observed during normal operation. An automatic change-over to a shortened load programme is required for emergency manoeuvres. The final design of the programme should be jointly determined by all the parties involved, considering the demands for manoeuvring and the actual service capacity.

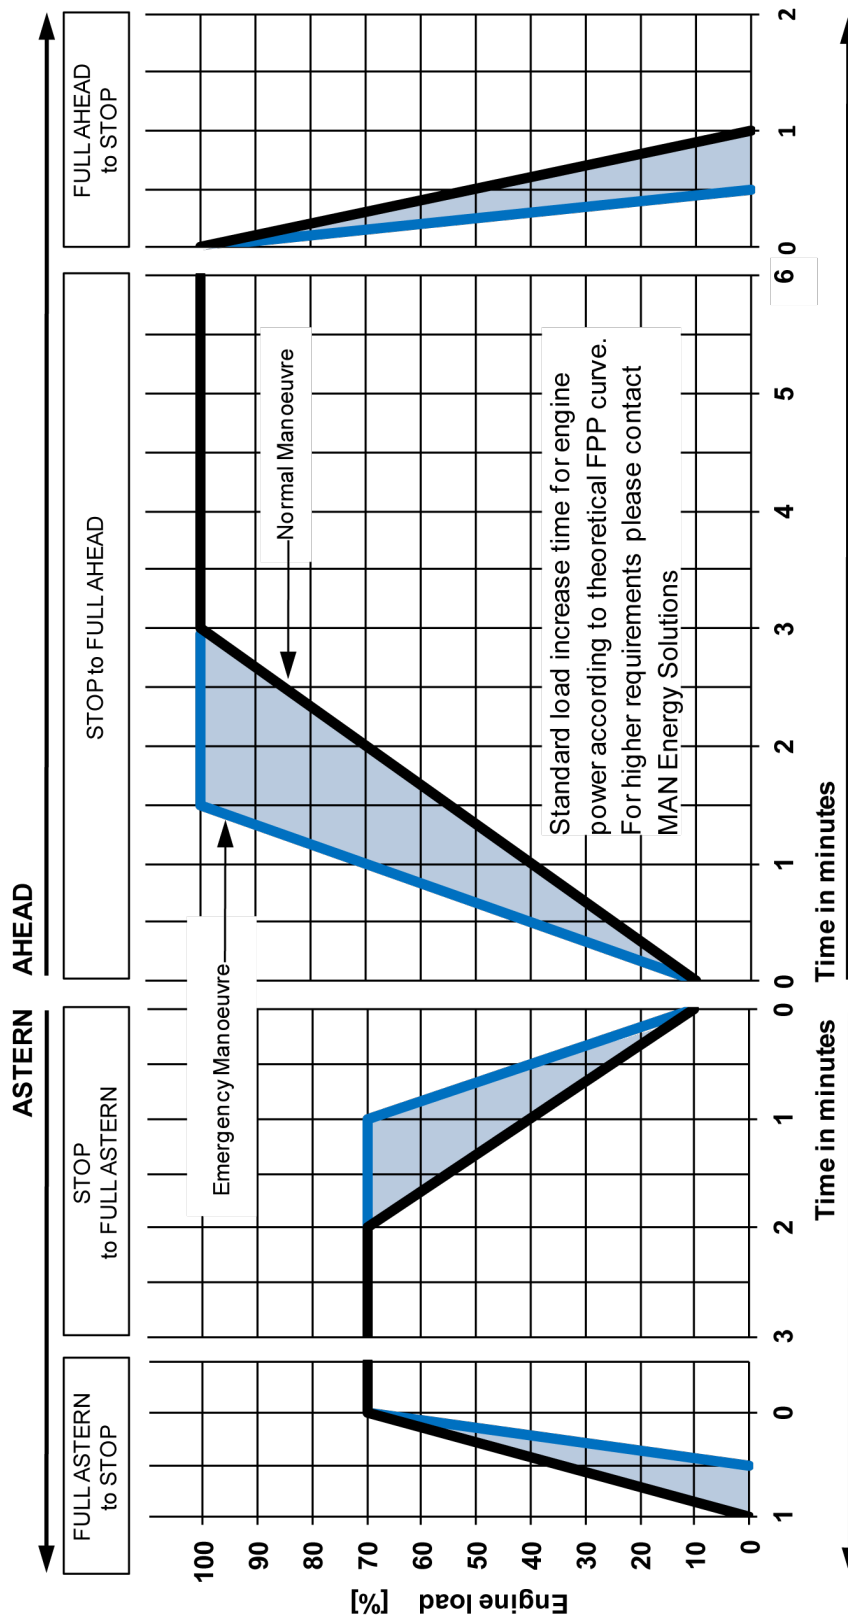

Time [min] with preheated engine (lube oil temperature minimum 40°C)
Engine speed should generally rise more quickly than pitch when loading and fall more slowly when unloading the engine.

Figure 27: Control lever setting and corresponding engine specific acceleration times (for guidance)

2.13 Fuel oil, urea, lube oil, starting air and control air consumption

2.13.1 Fuel oil consumption for emission standard: IMO Tier III

Note:

The engine's certification for compliance with the NO_x limits according to NO_x technical code will be done within the scope of supply of the factory acceptance test as member or parent engine for **IMO Tier II without SCR installation**. Accordingly the stated figures for the fuel oil consumption are without SCR installation.

The impact of the SCR installation on the fuel oil consumption depends on the plant layout and ambient conditions (see paragraph [Additions to fuel consumption, Page 73](#)).

All below stated fuel consumption values are for engines equipped with duplex paper lube oil filter.

Engine V28/33D STC – Mechanical propulsion with controllable pitch propeller (CPP), 455 kW/cyl., (ICN)

455 kW/cyl., 1,000 rpm

% Output	Spec. fuel consumption [g/kWh] with MGO and with all attached pumps ^{1) 2) 3)}				
	100 ⁴⁾	85	75	50	25
Speed (constant)	1,000 rpm				
12V28/33D STC	189.0	188.5	195.0	206.0	259.0
16V/20V28/33D STC	188.0	186.5	193.0	203.0	254.0
Speed (FPP-curve = recommended CPP-curve)	1,000 rpm	947 rpm	909 rpm (IMO: 910 rpm)	794 rpm (IMO: 800 rpm)	630 rpm
12V28/33D STC	189.0	186.0	187.0	197.0	201.5
16V/20V28/33D STC	188.0	184.0	185.0	194.0	198.5

¹⁾ Tolerance +5%.

Note: The additions to fuel consumption must be considered before the tolerance for warranty is taken into account.

²⁾ Based on reference conditions, see table [Reference conditions for fuel consumption, Page 74](#).

³⁾ Relevant for engine's certification for compliance with the NO_x limits according E2 Test cycle.

⁴⁾ Warranted fuel consumption at 100% MCR.

Table 28: Fuel consumption – Mechanical propulsion with controllable pitch propeller (CPP)³⁾

V28/33D STC – Mechanical propulsion with fixed pitch propeller (FPP), 455 kW/cyl., (ICN)

455 kW/cyl., 1,000 rpm

% Output	Spec. fuel consumption [g/kWh] with MGO and with all attached pumps ^{1) 2) 3)}				
	100 ⁴⁾	85	75	50	25
Speed (FPP-curve)	1,000 rpm	947 rpm	909 rpm (IMO: 910 rpm)	794 rpm (IMO: 800 rpm)	630 rpm
12V28/33D STC	189.0	186.0	196.0	199.0	201.5
16V/20V28/33D STC	188.0	183.5	194.0	196.0	198.5

¹⁾ Tolerance +5%.**Note:** The additions to fuel consumption must be considered before the tolerance for warranty is taken into account.²⁾ Based on reference conditions, see table [Reference conditions for fuel consumption, Page 74](#).³⁾ Relevant for engine's certification for compliance with the NO_x limits according E3 Test cycle.⁴⁾ Warranted fuel consumption at 100% MCR.Table 29: Fuel consumption – Mechanical propulsion with fixed pitch propeller (FPP)³⁾**Engine V28/33D STC – Mechanical propulsion with controllable pitch propeller (CPP), "Navy", 500 kW/cyl., (ICFN)**

500 kW/cyl., 1,032 rpm (ICFN), constant speed, for test cycle E2

% Output	Spec. fuel consumption [g/kWh] with MGO and with all attached pumps ^{1) 2) 3)}				
	100	85	75	50	25
Output [kW/cyl.] ⁴⁾	500 ⁵⁾	425	375	250	125
Speed [rpm]	1,032				
12V28/33D STC	194.0	193.5	198.0	207.0	263.0
16V/20V28/33D STC	192.0	190.5	196.0	204.0	258.0

¹⁾ Tolerance +5%.**Note:** The additions to fuel consumption must be considered before the tolerance for warranty is taken into account.²⁾ Based on reference conditions, see table [Reference conditions for fuel consumption, Page 74](#).³⁾ Relevant for engine's certification for compliance with the NO_x limits according E2 Test cycle.⁴⁾ IMO relevant load points.⁵⁾ For engines with ICFN power definition (Navy load profile) as described in section [Power definition and load profile, Page 41](#).Table 30: Fuel consumption – Mechanical propulsion with controllable pitch propeller (CPP), load profile "Navy"⁵⁾, constant speed

500 kW/cyl., 1,032 rpm (ICFN), FPP curve operation = recommended CPP curve

% Output	Spec. fuel consumption [g/kWh] with MGO and with all attached pumps ^{1) 2) 3)}					
	100	91 ⁴⁾	85	75	50	25
Output [kW/cyl.]	500 ⁵⁾	455	425	375	250	125
Speed [rpm]	1,032	1,000	978	938 (IMO: 939)	819 (IMO: 826)	650
12V28/33D STC	194.0	187.5	186.0	186.0	194.0	198.5
16V/20V28/33D STC	192.0	187.5	186.0	186.0	194.0	198.5

¹⁾ Tolerance +5%.

Note: The additions to fuel consumption must be considered before the tolerance for warranty is taken into account.

²⁾ Based on reference conditions, see table [Reference conditions for fuel consumption, Page 74](#).

³⁾ Relevant for engine's certification for compliance with the NO_x limits according E2 Test cycle.

⁴⁾ Warranted fuel consumption at MCR, 455 kW/cyl. at 1,000 rpm.

⁵⁾ For engines with ICFN power definition (Navy load profile) as described in section [Power definition and load profile, Page 41](#).

Table 31: Fuel consumption – Mechanical propulsion with controllable pitch propeller (CPP), load profile "Navy"⁵⁾, FPP curve operation = recommended CPP curve

Engine V28/33D STC – Mechanical propulsion with fixed pitch propeller (FPP), "Navy", 500 kW/cyl., (ICFN)

500 kW/cyl., 1,032 rpm (ICFN)

% Output	Spec. fuel consumption [g/kWh] with MGO and with all attached pumps ^{1) 2) 3)}					
	100	91 ⁴⁾	85	75	50	25
Output [kW/cyl.]	500 ⁵⁾	455	425	375	250	125
Speed [rpm]	1,032	1,000	978	938 (IMO: 939)	819 (IMO: 826)	650
12V28/33D STC	194.0	189.0	188.5	197.5	201.5	204.0
16V/20V28/33D STC	192.0	188.0	186.5	195.5	198.5	201.5

¹⁾ Tolerance +5%.

Note: The additions to fuel consumption must be considered before the tolerance for warranty is taken into account.

²⁾ Based on reference conditions, see table [Reference conditions for fuel consumption, Page 74](#).

³⁾ Relevant for engine's certification for compliance with the NO_x limits according E3 Test cycle.

⁴⁾ Warranted fuel consumption at MCR, 455 kW/cyl. at 1,000 rpm.

⁵⁾ For engines with ICFN power definition (Navy load profile) as described in section [Power definition and load profile, Page 41](#).

Table 32: Fuel consumption – Mechanical propulsion with fixed pitch propeller (FPP), load profile "Navy"⁵⁾

Additions to fuel consumption (g/kWh)

Additions to fuel consumption (g/kWh)	
For engines equipped with lube oil automatic filter instead of lube oil duplex paper filter	An addition of 0,31% to be calculated
For engines equipped with PTO	An addition of 0,5% to be calculated

Additions to fuel consumption (g/kWh)	
For exhaust gas back pressure after turbocharger > 50 mbar	Every additional 1 mbar (0.1 kPa) back pressure addition of 0.025 g/kWh to be calculated
In case a charge air blow-off device is installed and activated	Consult Everllence

Table 33: Additions to fuel consumption

Fuel oil consumption at idle running

Fuel oil consumption at idle running (kg/h)			
No. of cylinders, config.	12V	16V	20V
Speed 400 rpm	21	28	35

Table 34: Fuel oil consumption at idle running

Reference conditions for fuel consumption

According to ISO 15550; ISO 3046-1

Air temperature before turbocharger t_r	K/°C	298/25
Total atmospheric pressure p_r	kPa	100
Relative humidity ϕ_r	%	30
Exhaust gas back pressure after turbocharger ¹⁾	kPa	5
Engine type specific reference charge air temperature before cylinder $t_{bar}^{2)}$	K/°C	313/40
Temperature control of temperature turbine outlet by adjustable waste gate: Set point as minimum temperature for deactivated SCR	K/°C	563/290
Net calorific value NCV ³⁾	kJ/kg	42,700

¹⁾ Measured at 100% load, accordingly lower for loads < 100%.²⁾ Specified reference charge air temperature corresponds to a mean value for all cylinder numbers that will be achieved with 25°C LT cooling water temperature before charge air cooler (according to ISO).³⁾ Stated figures for DMA, DMB or HFO valid for fuel type fulfilling the stated quality requirements and without contents of FAME or synthetic fuels, that may result in low volumetric heat values.

Table 35: Reference conditions for fuel consumption V28/33D STC

IMO Tier II requirements:

For detailed information see section [Cooling water system, Page 214](#).

IMO: International Maritime Organization

MARPOL 73/78; Revised Annex VI-2008, Regulation 13

Tier II: NO_x technical code on control of emission of nitrogen oxides from diesel engines.**2.13.2 Urea consumption for emission standard IMO Tier III**

The table below shows indicative the urea consumption values for the reduction from IMO Tier II to IMO Tier III level according to MARPOL Annex VI – Regulation 13 for different engine types. The indicative values are based on

aqueous solution having an urea content of 40%, engine type related standard performance map, load point 100% MCR and DMA grade fuel. See also section [Specification of urea solution, Page 174](#).

Speed (rpm)	500/514	600	720/750	800	900	1,000
Urea consumption (g/kWh)	13.5	13.0	13.0	12.5	12.0	11.5

Table 36: Urea consumption

Note:

Urea consumption could be different for engines with specific load point optimisation. For more detailed information on expected level of urea consumption, contact Everllence with your project-specific request.

2.13.3 Lube oil consumption

455 kW/cyl. at 1,000 rpm or 500 kW/cyl. at 1,032 rpm

Specific lube oil consumption:

$$0.4 \text{ g/kWh}^{1)} \times \frac{100\%}{\text{load}\%} \times \frac{455 \text{ kW/cyl.}}{\text{nominal output per cyl.}}$$

Load%	Actual engine load	[%]
Nominal output per cyl.	Insert the nominal output per cyl.	[kW/cyl.]

¹⁾ The value stated above is without any losses due to cleaning of filter and centrifuge or lube oil charge replacement. Tolerance for warranty +20%.

Example:

For nominal output 455 kW/cyl. and 100% actual engine load: 0.40 g/kWh

For nominal output 500 kW/cyl. and 100% actual engine load: 0.36 g/kWh

2.13.4 Compressed air consumption – SCR system

Soot blowing and urea injection requires compressed air. Depending on the SCR reactor size the following volumes are permanent and in SCR operation required.

Mixing device	Engine power approximately	Mixing pipe	Permanent air consumption by sootblower	Additional air consumption in SCR operation by urea injection ^{1) 2)}
No.	kW	DN	Nm ³ /h ³⁾	Nm ³ /h ³⁾
1	0–1,000	500	3	9
2	1,001–2,000	600	3	12
3	2,001–3,000	800	3	23
4	3,001–4,200	1,000	3	37
5	4,201–5,400	1,100	3	46
6	5,401–6,800	1,200	3	50
7	6,801–8,500	1,400	4	64
8	8,501–10,500	1,500	4	90
9	10,501–13,000	1,600	4	112
10	13,001–20,000	2,100	5	140
11	20,001–21,600	2,300	5	210

¹⁾ Starting and shutdown of the SCR system can result in short-term higher compressed air consumption caused by cooling and scavenging phases.

²⁾ Tolerance: Quantity +10%.

³⁾ Nm³ corresponds to one cubic metre of gas at 20°C and 100.0 kPa abs.

Table 37: Compressed air consumption – SCR system

2.13.5 Starting air and control air consumption

Starting air consumption

No. of cylinders, config.		12V	16V	20V
Air consumption at minimum moment of inertia¹⁾				
Air consumption per start	Nm ^{3 2)}	1.4	1.5	1.6
Air consumption per slow turn without subsequent start ³⁾	Nm ^{3 2)}	1.4	1.5	1.6
Reference moment of inertia for stated air consumption figures	kgm ²	311	364	421
Air consumption at high moment of inertia¹⁾				
Air consumption per start	Nm ^{3 2)}	3.4	3.4	3.2
Air consumption per slow turn without subsequent start ³⁾	Nm ^{3 2)}	3.4	3.4	3.2
Reference moment of inertia for stated air consumption figures	kgm ²	2,300		
Starting system active in case of start ⁴⁾	sec	2		
Starting system active in case of slow turn without subsequent start ⁴⁾	sec	15		

¹⁾ The air consumption per starting manoeuvre/slow turn of the unit increases in relation to its total moment of inertia. Linear interpolation must be carried out between the stated figures to gain the relevant air consumption figures for the unit within the plant based on its total moment of inertia at start. Consider also the "Required minimum total moments of inertia" as stated within table [Moments of inertia/flywheel – Operation with variable speed, Page 114](#).

²⁾ Nm³ corresponds to one cubic metre of gas at 20°C and 100.0 kPa abs.

³⁾ Required for plants with power management system demanding automatic engine start. Slow turn only will be activated after a long period of engine standstill. This value states the air consumption for slow turn manoeuvre only, without the air consumption for the automatically activated engine start after the end of the slow turn manoeuvre.

⁴⁾ Stated time duration for activated starting system only relevant for layout of starting air system

For layout of the starting air system, note:

- Starting air pressure stated within section [Operating/service temperatures and pressures, Page 90](#).
- Maximum velocity (m/s) see section [External pipe dimensioning, Page 179](#).
- Consider multiple start of engines and the temporal distribution of events (e.g. activation of jet assist), if needed.
- See section [External compressed air system – Dimensioning starting air receivers, compressors, Page 235](#).

Table 38: Starting air consumption – V28/33D STC

Control air consumption

No. of cylinders, config.		12V	16V	20V
Control air consumption	[Nm³/h) ¹⁾	1.3		

¹⁾ Nm³ corresponds to one cubic metre of gas at 20°C and 100.0 kPa abs.

Table 39: Control air consumption – V28/33D STC

2.13.6 Recalculation of fuel consumption dependent on ambient conditions

In accordance to ISO standard ISO 3046-1 "Reciprocating internal combustion engines – Performance, Part 1: Declarations of power, fuel and lube oil consumptions, and test methods – Additional requirements for engines for general use" Everllence has specified the method for recalculation of fuel consumption for liquid fuel dependent on ambient conditions for single-stage turbocharged engines as follows:

$$\beta = 1 + 0.0006 \times (t_x - t_r) + 0.0004 \times (t_{bax} - t_{bar}) + 0.07 \times (p_r - p_x)$$

The formula is valid within the following limits:

Ambient air temperature	5°C–55°C
Charge air temperature before cylinder	25°C–75°C
Ambient air pressure	0.885 bar–1.030 bar

Table 40: Limit values for recalculation of liquid fuel consumption

$$b_x = b_r \times \beta \quad b_r = \frac{b_x}{\beta}$$

β	Fuel consumption factor
t_{bar}	Engine type specific reference charge air temperature before cylinder see table Reference conditions for fuel consumption, Page 74

	Unit	Reference	At test run or at site
Specific fuel consumption	[g/kWh]	b_r	b_x
Ambient air temperature	[°C]	t_r	t_x
Charge air temperature before cylinder	[°C]	t_{bar}	t_{bax}
Ambient air pressure	[bar]	p_r	p_x

Table 41: Recalculation of liquid fuel consumption – Units and references

Example

Reference values:

$$b_r = 200 \text{ g/kWh}, t_r = 25^\circ\text{C}, t_{bar} = 40^\circ\text{C}, p_r = 1.0 \text{ bar}$$

At site:

$$t_x = 45^\circ\text{C}, t_{bax} = 50^\circ\text{C}, p_x = 0.9 \text{ bar}$$

$$\beta = 1 + 0.0006 (45 - 25) + 0.0004 (50 - 40) + 0.07 (1.0 - 0.9) = 1.023$$

$$b_x = \beta \times b_r = 1.023 \times 200 = 204.6 \text{ g/kWh}$$

2.13.7 Influence of engine aging on fuel consumption

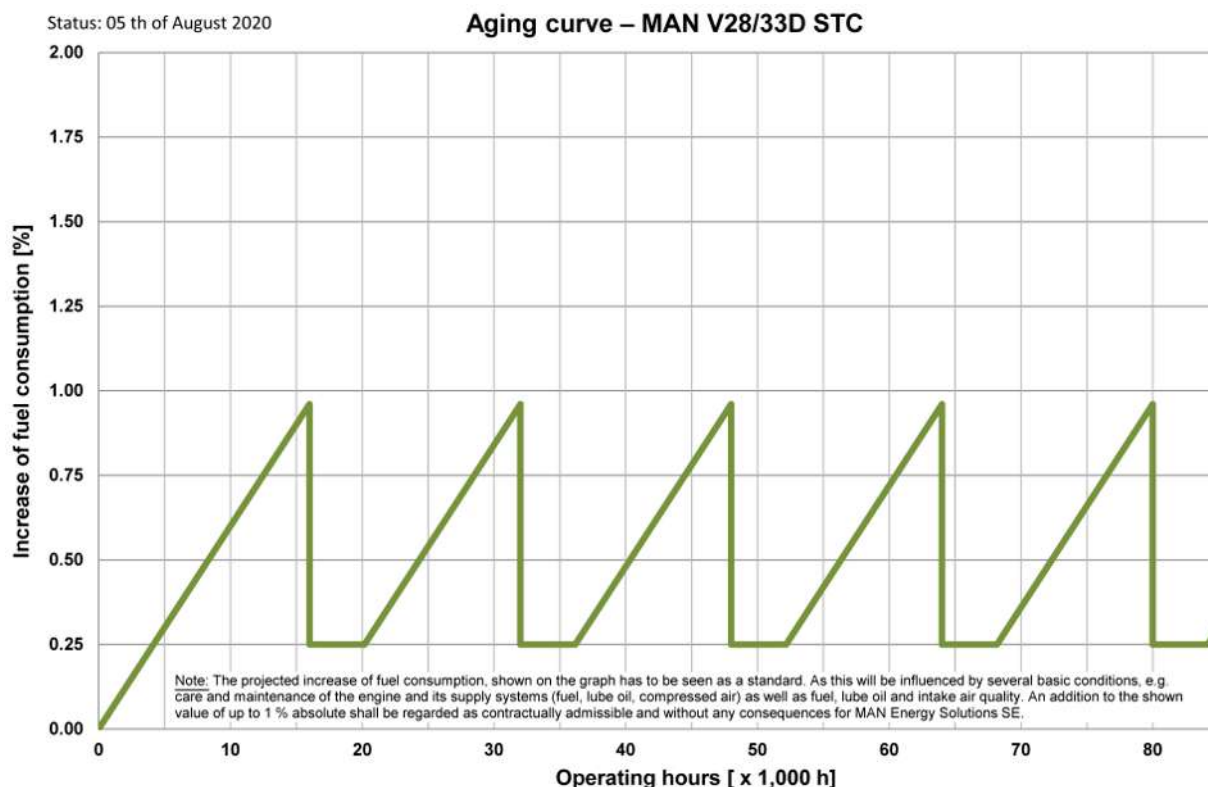


Figure 28: Influence of total engine running time and service intervals on fuel oil consumption

The fuel oil consumption will increase over the running time of the engine. Timely service can reduce or eliminate this increase. For dependencies see figure [Influence of total engine running time and service intervals on fuel oil consumption, Page 79](#).

2.14 Planning data 455 kW/cyl., CPP/FPP, IMO Tier II

2.14.1 Nominal values for cooler specification – 455 kW/cyl., CPP/FPP

455 kW/cyl.; 1,000 rpm, mechanical propulsion

Reference conditions: Tropics		
Air temperature	°C	45
Cooling water temp. before charge air cooler (LT stage)		38
Total atmospheric pressure	mbar	1,000
Relative humidity	%	60

Table 42: Reference conditions: Tropics

No. of cylinders, config.		12V	16V	20V
Engine output	kW	5,460	7,280	9,100
Speed	rpm	1,000		

No. of cylinders, config.		12V	16V	20V	
Engine output	kW	5,460	7,280	9,100	
Heat to be dissipated ¹⁾					
HT string: Charge air cooler (HT stage) Jacket cooling	kW	1,249 921	1,780 1,224	2,268 1,518	
LT string: Charge air cooler (LT stage) Lube oil cooler Turbocharger cooling		968 892 20	1,192 1,188 26	1,514 1,479 33	
Heat radiation (engine, based on engine room temp. 55°C)		117	155	194	
Flow rates ²⁾					
HT circuit (1. engine/2. charge air cooler HT stage)		m³/h	130 (130/65)	160 (160/75)	180 (180/75)
LT circuit (1. charge air cooler LT stage/2. lube oil cooler/3. compressor wheel casing cooling)			139 (54/135/4)	184 (108/180/4)	
Lube oil	105		130	155	
Seawater	220		290	360	
Pumps					
a) Attached pumps					
HT CW service pump at 4 bar, 1,000 rpm	m³/h	190			
LT CW service pump at 4 bar, 1,000 rpm		190			
Lube oil service pump at 7.5 bar, 1,000 rpm		132	179	220	
Fuel supply pump at 6.5 bar, 1,000 rpm		10.8			
Seawater pump at 3.5 bar, 1,000 rpm		300	380	460	
b) Free-standing pumps ³⁾					
HT CW pump (preheating and post-cooling)	m³/h	15	15	15	
Prelubrication pump		16.5–19.5	20.5–24.0	24.5–28.5	

¹⁾ Tolerance: +8% for rating coolers and heat radiation, +6% for central (HT-, LT- and lube oil system), -12% for heat recovery from HT- or LT- or lube oil system.

²⁾ Basic values for layout of the coolers.

³⁾ Tolerance of the pump delivery capacities must be considered by the manufacturers.

Table 43: Nominal values for cooler specification – 455 kW/cyl.; 1,000 rpm

Note:

You will find further planning datas for the listed subjects in the corresponding sections.

- Minimal heating power required for preheating HT cooling water see paragraph [MOD-004/HT cooling water preheating module, Page 219](#).

2.14.2 Flow scheme for cooler specification – 455 kW/cyl., CPP/FPP

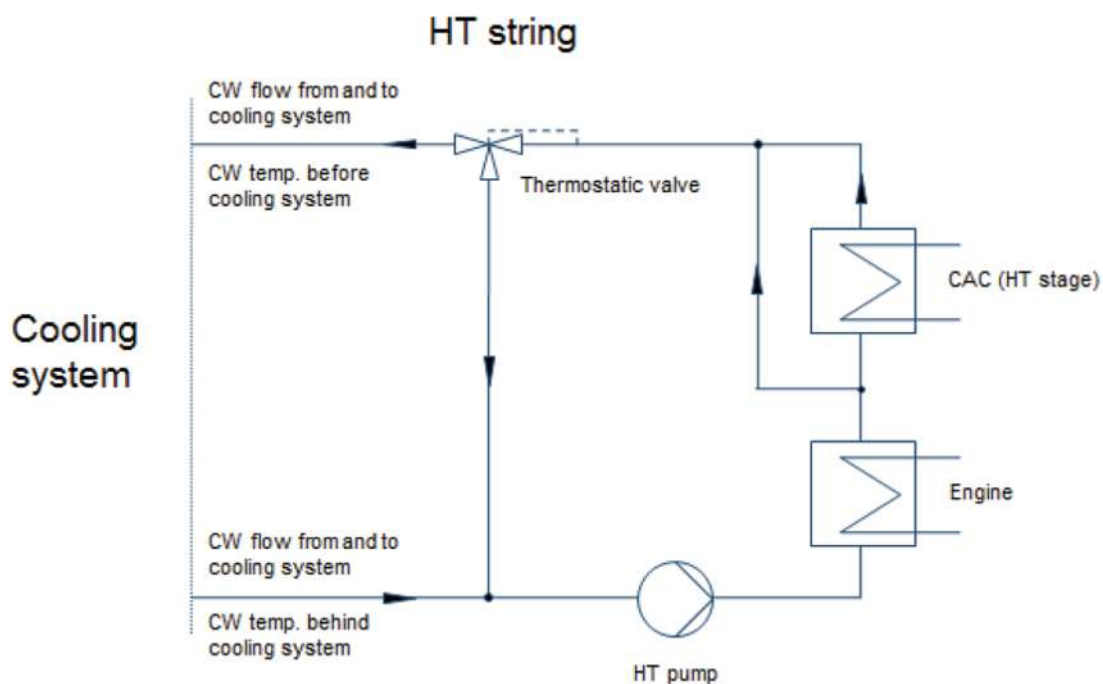


Figure 29: Flow scheme HT string

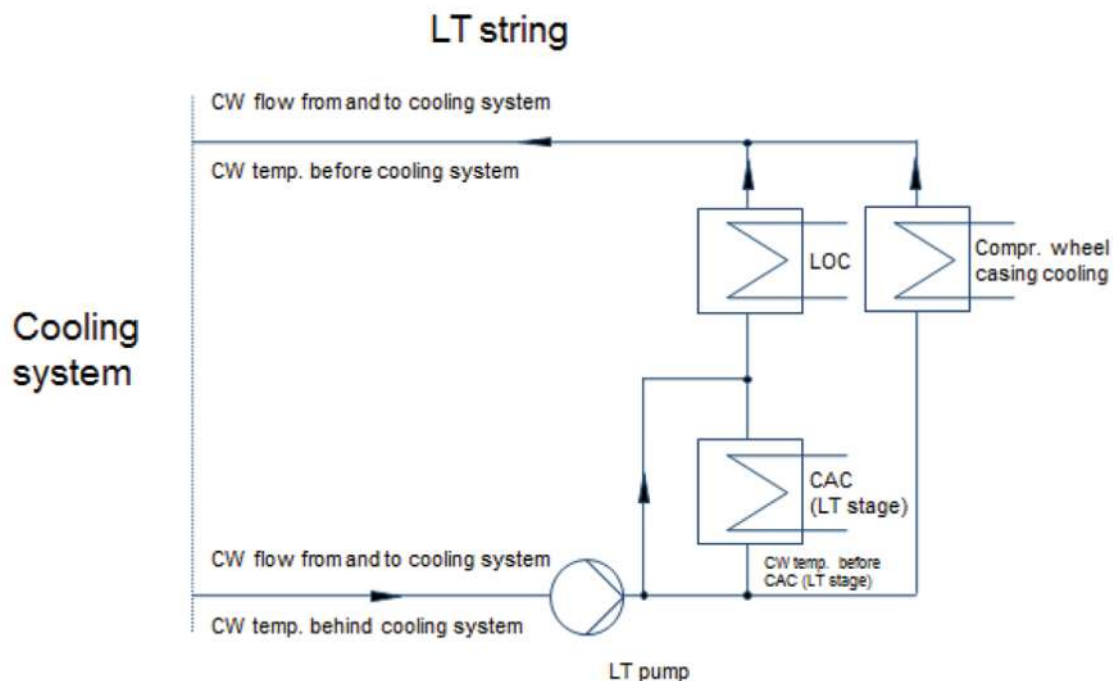


Figure 30: Flow scheme LT string

2.14.3 Temperature basis, nominal air and exhaust gas data – 455 kW/cyl., CPP/FPP

455kW/cyl.; 1,000 rpm, mechanic propulsion

Reference conditions: Tropics		
Air temperature	°C	45
Cooling water temp. before charge air cooler (LT stage)		38
Total atmospheric pressure	mbar	1,000
Relative humidity	%	60

Table 44: Reference conditions: Tropics

No. of cylinders, config.		12V	16V	20V
Engine output	kW	5,460	7,280	9,100
Speed	rpm	1,000		
Temperature basis				
HT cooling water temperature before cooling system ¹⁾	°C	85		
LT cooling water air cooler inlet		38 (setpoint 32°C) ²⁾		
Lube oil inlet engine		58 ³⁾		
Air data				
Temperature of charge air at charge air cooler outlet	°C	61.3	60.9	60.0
Air flow rate ⁴⁾	m³/h	32,859	43,812	54,768
	t/h	36.0	47.9	59.9
Charge air pressure (absolute)	bar abs	4.56	4.56	4.55
Air required to dissipate heat radiation (engine) (t ₂ – t ₁ = 10°C)	m³/h	37,428	49,905	62,381
Exhaust gas data ⁵⁾				
Volume flow (temperature turbocharger outlet) ⁶⁾	m³/h	68,974	91,912	114,775
Mass flow	t/h	37.1	49.4	61.8
Temperature at turbine outlet	°C	375	374	374
Heat content (190°C)	kW	2,068	2,752	3,427
Permissible exhaust gas back pressure	mbar	< 50		

¹⁾ HT cooling water flow first through water jacket and cylinder head, then through HT stage charge air cooler.

²⁾ For design see figure [External cooling water system diagram, Page 221](#).

³⁾ 50°C with lube oil outlet temperature control (e.g. with attached lube oil automatic filter).

⁴⁾ Under mentioned above reference conditions.

⁵⁾ Tolerances: ±15°C for temperature at turbine outlet, ±4% for flow quantity.

⁶⁾ Calculated based on stated temperature at turbine outlet and total atmospheric pressure according mentioned above reference conditions.

Table 45: Air and exhaust gas data – 455 kW/cyl.; 1,000 rpm

2.14.4 Load specific values at ISO conditions – 455 kW/cyl., CPP/FPP

455 kW/cyl.; 1,000 rpm, mechanical propulsion

Reference conditions: ISO		
Air temperature	°C	25
Cooling water temp. before charge air cooler (LT stage)		25
Total atmospheric pressure	mbar	1,000
Relative humidity	%	30

Table 46: Reference conditions: ISO

Engine output	%	100	85	75	50	25
	kW/cyl.	455	387	341	228	113
Speed	rpm	1,000	947	910	800	630
Heat to be dissipated ¹⁾						
Cooling water HT (jacket cooling + charge air cooler HT stage) ²⁾	kJ/kWh	1,196	1,119	1,174	1,027	1,316
Cooling water LT (charge air cooler LT stage, lube oil cooler, turbocharger cooling) ²⁾		1,042	1,051	1,110	1,040	1,329
Heat radiation		99	108	117	150	227
Air data						
Temperature of charge air: After compressor At charge air cooler outlet	°C	215.0 40.0	192.0 40.0	188.0 40.0	138.0 40.0	92.0 40.0
Air flow rate	kg/kWh	6.91	7.23	7.88	8.14	11.36
Charge air pressure (absolute)	bar abs	4.55	4.00	3.84	2.61	1.74
Exhaust gas data ³⁾						
Mass flow	kg/kWh	7.11	7.43	8.08	8.35	11.63
Temperature at turbine outlet	°C	331	315	311	357	374
Heat content (190°C)	kJ/kWh	1,081	998	1,049	1,505	2,306
Permissible exhaust back pressure	mbar	< 50	-			

¹⁾ Tolerance: +8% for rating coolers and heat radiation, +6% for central cooler (HT-, LT- and lube oil system), –12% for heat recovery from HT- or LT- or lube oil system (Tolerance refer to 100% engine output).

²⁾ The values of the particular numbers can differ depending on the charge air cooler specification.

³⁾ Tolerances: ±15°C for temperature at turbine outlet, ±4% for flow quantity (Tolerance refer to 100% engine output).

Table 47: Load specific values at ISO conditions – 455 kW/cyl.; 1,000 rpm

2.14.5 Load specific values at tropical conditions – 455 kW/cyl., CPP/FPP

455 kW/cyl.; 1,000 rpm, mechanical propulsion

Reference conditions: Tropics		
Air temperature	°C	45
Cooling water temp. before charge air cooler (LT stage)		38
Total atmospheric pressure	mbar	1,000
Relative humidity	%	60

Table 48: Reference conditions: Tropics

Engine output	%	100	85	75	50	25
	kW/cyl.	455	387	341	228	113
Speed	rpm	1,000	947	910	800	630
Heat to be dissipated ¹⁾						
Cooling water HT (jacket cooling + charge air cooler HT stage) ²⁾	kJ/kWh	1,497	1,404	1,475	1,296	1,666
Cooling water LT (charge air cooler LT stage, lube oil cooler, turbocharger cooling) ²⁾		1,197	1,236	1,313	1,399	1,701
Heat radiation		77	84	91	116	227
Air data						
Temperature of charge air: After compressor At charge air cooler outlet	°C	248.0 59.9	222.0 56.5	215.0 55.5	163.0 47.9	112.0 42.5
Air flow rate		kg/kWh	6.59	6.89	7.51	7.76
Charge air pressure (absolute)	bar abs	4.55	3.97	3.81	2.55	1.68
Exhaust gas data ³⁾						
Mass flow	kg/kWh	6.79	7.09	7.72	7.98	1.11
Temperature at turbine outlet	°C	374	354	349	392	406
Heat content (190°C)	kJ/kWh	1,356	1,260	1,327	1,754	2,602
Permissible exhaust back pressure	mbar	< 50	-			
¹⁾ Tolerance: +8% for rating coolers and heat radiation, +6% for central cooler (HT-, LT- and lube oil system), –12% for heat recovery from HT- or LT- or lube oil system (Tolerance refer to 100% engine output).						
²⁾ The values of the particular numbers can differ depending on the charge air cooler specification.						
³⁾ Tolerances: ±15°C for temperature at turbine outlet, ±4% for flow quantity (Tolerance refer to 100% engine output).						

¹⁾ Tolerance: +8% for rating coolers and heat radiation, +6% for central cooler (HT-, LT- and lube oil system), –12% for heat recovery from HT- or LT- or lube oil system (Tolerance refer to 100% engine output).

²⁾ The values of the particular numbers can differ depending on the charge air cooler specification.

³⁾ Tolerances: ±15°C for temperature at turbine outlet, ±4% for flow quantity (Tolerance refer to 100% engine output).

Table 49: Load specific values at tropical conditions – 455 kW/cyl.; 1,000 rpm

2.15 Planning data 500 kW/cyl., CPP/FPP, IMO Tier II

2.15.1 Nominal values for cooler specification – 500 kW/cyl., CPP/FPP

Load profile "Navy"

500 kW/cyl.; 1,032 rpm, (ICFN), mechanical propulsion

Reference conditions: Tropics		
Air temperature	°C	45
Cooling water temp. before charge air cooler (LT stage)		38
Total atmospheric pressure	mbar	1,000
Relative humidity	%	60

Table 50: Reference conditions: Tropics

No. of cylinders, config.		12V	16V	20V
Engine output	kW	6,000	8,000	10,000
Speed	rpm	1,032		
Heat to be dissipated ¹⁾				
HT string: Charge air cooler (HT stage) Jacket cooling	kW	1,465 1,092	2,094 1,451	2,669 1,799
LT string: Charge air cooler (LT stage) Lube oil cooler		1,093 949	1,338 1,262	1,698 1,572
Turbocharger cooling		22	29	36
Heat radiation (engine, based on engine room temp. 55°C)		120	160	200
Flow rates ²⁾				
HT circuit (1. engine/2. charge air cooler HT stage)	m³/h	134 (134/67)	165 (165/77)	186 (186/77)
LT circuit (1. charge air cooler LT stage/2. lube oil cooler/3. compressor wheel casing cooling)		143 (56/139/4)	190 (112/186/4)	
Lube oil		108	134	160
Seawater		227	300	370
Pumps				
a) Attached pumps				
HT CW service pump at 4 bar, 1,032 rpm	m³/h	196		
LT CW service pump at 4 bar, 1,032 rpm		196		
Lube oil service pump at 7.5 bar, 1,000 rpm		132	179	220
Fuel supply pump at 6.5 bar		10.8 at 1,000 rpm 11.1 at 1,032 rpm		

No. of cylinders, config.		12V	16V	20V
Engine output	kW	6,000	8,000	10,000
Seawater pump at 3.5 bar, 1,000 rpm		300	380	460
b) Free-standing pumps ³⁾				
HT CW pump (preheating and post-cooling)	m ³ /h	15	15	15
Prelubrication pump		16.5–19.5	20.5–24.0	24.5–28.5

¹⁾ Tolerance: +8% for rating coolers and heat radiation, +6% for central cooler (HT-, LT- and lube oil system), –12% for heat recovery from HT- or LT- or lube oil system.

²⁾ Basic values for layout of the coolers.

³⁾ Tolerance of the pump delivery capacities must be considered by the manufacturers.

Table 51: Nominal values for cooler specification – 500 kW/cyl.; 1,032 rpm

Note:

You will find further planning datas for the listed subjects in the corresponding sections.

- Minimal heating power required for preheating HT cooling water see paragraph [MOD-004/HT cooling water preheating module, Page 219](#).

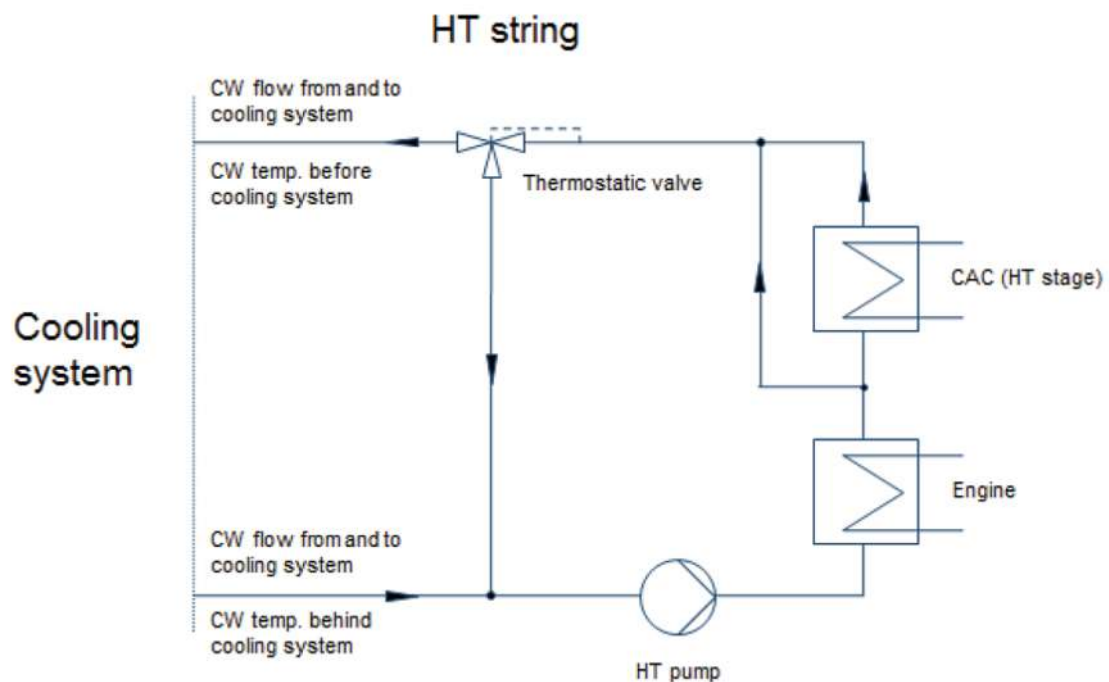
2.15.2 Flow scheme for cooler specification – 500 kW/cyl., CPP/FPP

Figure 31: Flow scheme HT string

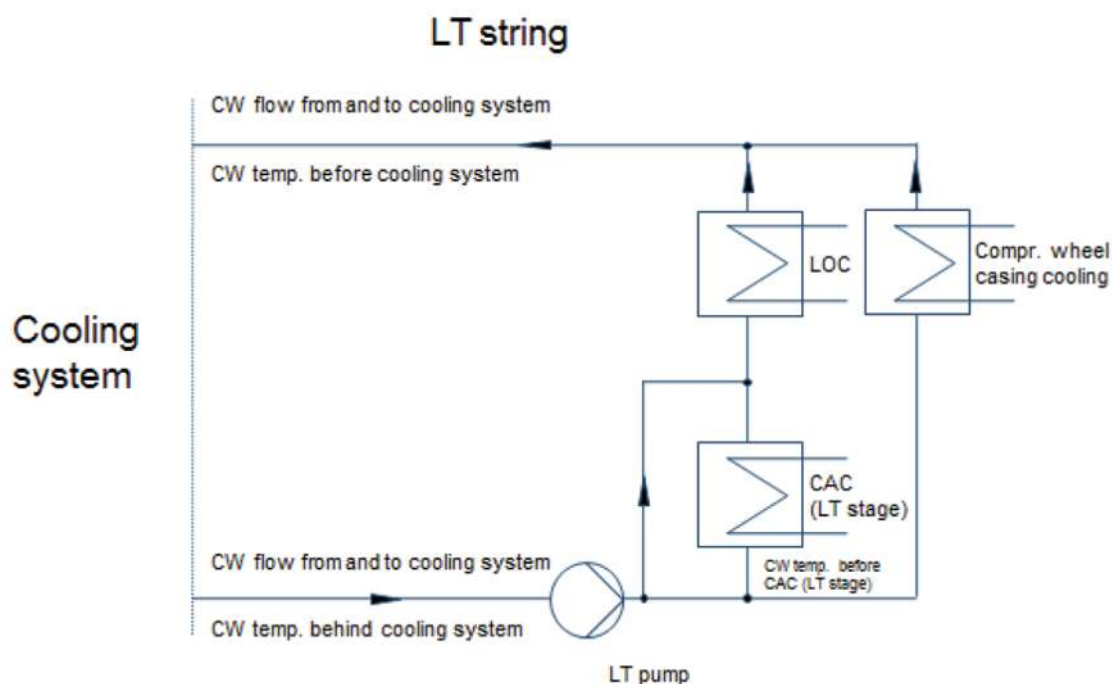


Figure 32: Flow scheme LT string

2.15.3 Temperature basis, nominal air and exhaust gas data – 500 kW/cyl., CPP/FPP

Load profile "Navy"

500 kW/cyl.; 1,032 rpm (ICFN), mechanic propulsion

Reference conditions: Tropics		
Air temperature	°C	45
Cooling water temp. before charge air cooler (LT stage)		38
Total atmospheric pressure	mbar	1,000
Relative humidity	%	60

Table 52: Reference conditions: Tropics

No. of cylinders, config.		12V	16V	20V
Engine output	kW	6,000	8,000	10,000
Speed	rpm	1,032		
Temperature basis				
HT cooling water temperature before cooling system ¹⁾	°C	85		
LT cooling water air cooler inlet		38 (setpoint 32°C) ²⁾		
Lube oil inlet engine		58 ³⁾		
Air data				
Temperature of charge air at charge air cooler outlet	°C	62.8	62.4	61.4
Air flow rate ⁴⁾	m³/h	34,955	46,608	58,264

No. of cylinders, config.		12V	16V	20V
Engine output	kW	6,000	8,000	10,000
	t/h	38.3	51.0	63.8
Charge air pressure (absolute)	bar abs	4.83	4.82	4.82
Air required to dissipate heat radiation (engine) ($t_2 - t_1 = 10^{\circ}\text{C}$)	m ³ /h	38,582	51,443	64,304
Exhaust gas data ⁵⁾				
Volume flow (temperature turbocharger outlet) ⁶⁾	m ³ /h	76,814	102,337	127,783
Mass flow	t/h	39.5	52.7	63.8
Temperature at turbine outlet	°C	404	404	403
Heat content (190°C)	kW	2,566	3,413	4,251
Permissible exhaust gas back pressure	mbar	< 50		

¹⁾ HT cooling water flow first through water jacket and cylinder head, then through HT stage charge air cooler.

²⁾ For design see figure [External cooling water system diagram, Page 221](#).

³⁾ 50°C with lube oil outlet temperature control (e.g. with attached lube oil automatic filter).

⁴⁾ Under mentioned above reference conditions.

⁵⁾ Tolerances: ±15°C for temperature at turbine outlet, ±4% for flow quantity.

⁶⁾ Calculated based on stated temperature at turbine outlet and total atmospheric pressure according mentioned above reference conditions.

Table 53: Air and exhaust gas data – 500 kW/cyl.; 1,032 rpm

2.15.4 Load specific values at ISO conditions – 500 kW/cyl., CPP/FPP

Load profile "Navy"

500 kW/cyl.; 1,032 rpm (ICFN), mechanical propulsion

Reference conditions: ISO		
Air temperature	°C	25
Cooling water temp. before charge air cooler (LT stage)		25
Total atmospheric pressure	mbar	1,000
Relative humidity	%	30

Table 54: Reference conditions: ISO

Engine output	%	100	85	75	50	25
	kW/cyl.	500	425	375	250	125
Speed	rpm	1,032	978	939	826	650
Heat to be dissipated¹⁾						
Cooling water HT (jacket cooling + charge air cooler HT stage) ²⁾	kJ/kWh	1,286	1,187	1,235	1,111	1,375
Cooling water LT (charge air cooler LT stage, lube oil cooler, turbocharger cooling) ²⁾		1,058	1,074	1,141	1,191	1,508
Heat radiation		93	102	110	141	214

Engine output	%	100	85	75	50	25
	kW/cyl.	500	425	375	250	125
Air data						
Temperature of charge air:	°C					
After compressor		233	207	201	154	103
At charge air cooler outlet		40.0	40.0	40.0	40.0	40.0
Air flow rate	kg/kWh	6.83	7.32	8.02	8.48	11.73
Charge air pressure (absolute)	bar abs	4.80	4.31	4.15	2.93	1.91
Exhaust gas data³⁾						
Mass flow	kg/kWh	7.03	7.52	8.23	8.69	12.00
Temperature at turbine outlet	°C	354	318	313	327	354
Heat content (190°C)	kJ/kWh	1,248	1,035	1,085	1,279	2,115
Permissible exhaust back pressure	mbar	-	< 50	-		

¹⁾ Tolerance: +8% for rating coolers and heat radiation, +6% for central cooler (HT-, LT- and lube oil system), -12% for heat recovery from HT- or LT- or lube oil system (Tolerance refer to 100% engine output).

²⁾ The values of the particular numbers can differ depending on the charge air cooler specification.

³⁾ Tolerances: ±15°C for temperature at turbine outlet, ±4% for flow quantity (Tolerance refer to 100% engine output).

Table 55: Load specific values at ISO conditions – 500 kW/cyl.; 1,032 rpm

2.15.5 Load specific values at tropical conditions – 500 kW/cyl., CPP/FPP

Load profile "Navy"

500 kW/cyl.; 1,032 rpm (ICFN), mechanical propulsion

Reference conditions: Tropics		
Air temperature	°C	45
Cooling water temp. before charge air cooler (LT stage)		38
Total atmospheric pressure	mbar	1,000
Relative humidity	%	60

Table 56: Reference conditions: Tropics

Engine output	%	100	85	75	50	25
	kW/cyl.	500	425	375	250	125
Speed	rpm	1,032	978	939	826	650
Heat to be dissipated¹⁾						
Cooling water HT (jacket cooling + charge air cooler HT stage) ²⁾	kJ/kWh	1,609	1,488	1,548	1,398	1,742
Cooling water LT (charge air cooler LT stage, lube oil cooler, turbocharger cooling) ²⁾		1,190	1,239	1,326	1,398	1,425
Heat radiation		72	80	86	109	167

Engine output	%	100	85	75	50	25
	kW/cyl.	500	425	375	250	125
Air data						
Temperature of charge air:	°C					
After compressor		266	237	231	179	123
At charge air cooler outlet		61.9	58.2	57.8	50.0	43.7
Air flow rate	kg/kWh	6.51	6.98	7.65	8.09	11.19
Charge air pressure (absolute)	bar abs	4.82	4.30	4.13	2.87	1.85
Exhaust gas data ³⁾						
Mass flow	kg/kWh	6.72	7.18	7.86	8.31	11.47
Temperature at turbine outlet	°C	400	359	353	362	386
Heat content (190°C)	kJ/kWh	1,538	1,315	1,338	1,546	2,429
Permissible exhaust back pressure	mbar	< 50	-			
¹⁾ Tolerance: +8% for rating coolers and heat radiation, +6% for central cooler (HT-, LT- and lube oil system), -12% for heat recovery from HT- or LT- or lube oil system (Tolerance refer to 100% engine output).						
²⁾ The values of the particular cylinder numbers can differ depending on the cooler specification.						
³⁾ Tolerances: ±15°C for temperature at turbine outlet, ±4% for flow quantity (Tolerance refer to 100% engine output).						

Table 57: Load specific values at tropical conditions – 500 kW/cyl.; 1,032 rpm

2.16 Operating/service temperatures and pressures

Ambient air

	Min.	Max.
Ambient air temperature (outside vessel)	0°C ¹⁾	45°C ²⁾
¹⁾ Conditions below this temperature are defined as "arctic conditions" – see section Engine operation under arctic conditions, Page 57 . ²⁾ In accordance with power definition. A reduction in power is required at higher temperatures.		

Table 58: Ambient air

Engine room air

	Min.	Max.
Engine room air temperature	0°C recommended: 5°C ¹⁾	55°C ²⁾
¹⁾ Recommendation given to avoid any possibility for ice formation. In general it can be assumed that the air temperature in the area of the engine and attached components will be 5–10 K above the ambient air temperature outside the engine room. ²⁾ Air temperatures at the engine > 55°C are not permissible.		

Table 59: Engine room air

Intake air (conditions before compressor of turbocharger)

	Connection number in- ternal media schemata "Charge air and exhaust gas diagram"	Min.	Max.
Intake air temperature compressor inlet	6101, 6102, TE6100	0°C ¹⁾	45°C ²⁾
Intake air pressure compressor inlet	-	-20 mbar	-

¹⁾ Conditions below this temperature are defined as "arctic conditions" – see section [Engine operation under arctic conditions, Page 57](#). External intake air supply to be applied in this case.

²⁾ In accordance with power definition. A reduction in power is required at higher temperatures/lower pressures.

Table 60: Intake air (conditions before compressor of turbocharger)

Charge air (conditions within charge air pipe before cylinder)

	Connection number in- ternal media schemata "Charge air and exhaust gas diagram"	Min.	Max.
Charge air temperature at charge air cooler inlet	TE6170	-	280°C
Charge air temperature at charge air cooler outlet / cylinder inlet ¹⁾	TE6180	15°C	65°C
Charge air pressure at charge air cooler inlet	PT6170	-	5.0 bar (absolute)
Charge air pressure at charge air cooler outlet / cylinder inlet ¹⁾	PT6180	-	4.9 bar (absolute)

¹⁾ Aim for a higher value in conditions of high air humidity (to reduce condensate amount).

Table 61: Charge air (conditions within charge air pipe before cylinder)

HT cooling water – Engine

	Connection number in- ternal media schemata "Cooling water system"	Min.	Max.
HT cooling water temperature engine inlet – Preheated before start	3121, TE3170	40°C	68°C
HT cooling water temperature at jacket cooling outlet ²⁾	TE3180	68°C	80°C ³⁾
HT cooling water temperature engine outlet ¹⁾	3111, TE3190	79°C	95°C
HT cooling water pressure engine inlet, at nominal speed, nominal value 4 bar ⁴⁾	3121, PT3170	0.9 bar	5.5 bar
Pressure loss engine (total, for nominal flow rate)	-	-	1.35 bar
Only for information:	-		
+ Pressure loss engine (without charge air cooler)		0.3 bar	0.5 bar
+ Pressure loss HT piping engine		0.2 bar	0.45 bar
+ Pressure loss charge air cooler (HT stage)		0.2 bar	0.4 bar
Pressure rise attached HT cooling water pump (attached as standard)	-	0.4 bar	5.0 bar

	Connection number internal media schemata "Cooling water system"	Min.	Max.
¹⁾ Regulated temperature. ²⁾ SaCoS 5000 measuring point is jacket cooling outlet of the engine. ³⁾ Operation at alarm level. ⁴⁾ SaCoS 5000 measuring point is jacket cooling inlet.			

Table 62: HT cooling water – Engine

HT cooling water – Plant

		Min.	Max.
Permitted pressure loss of external HT system (plant)	-	-	1.50 bar
Cooling water expansion tank			
+ Pre-pressure due to expansion tank at suction side of cooling water pump	-	0.45 bar	0.95 bar
+ Pressure loss from expansion tank to suction side of cooling water pump	-	-	0.1 bar

Table 63: HT cooling water – Plant

LT cooling water – Engine

	Connection number internal media schemata "Cooling water system"	Min.	Max.
LT cooling water temperature charge air cooler inlet (LT stage)	3221, TE4170	32°C ¹⁾	38°C ²⁾
LT cooling water temperature charge air cooler outlet	TE4180	-	60°C
LT cooling water pressure charge air cooler inlet (LT stage), at nominal speed, nominal value 4 bar	3221, PT4170	0.8 bar	5.5 bar
Pressure loss charge air cooler (LT stage, for nominal flow rate)	-	-	0.6 bar
Pressure rise attached LT cooling water pump (attached as standard)	-	0.4 bar	4.6 bar
¹⁾ Regulated temperature. ²⁾ In accordance with power definition. A reduction in power is required at higher temperatures/lower pressures.			

Table 64: LT cooling water – Engine

LT cooling water – Plant

	Connection number internal media schemata "Cooling water system"	Min.	Max.
Permitted pressure loss of external LT system (plant)	-	-	1.70 bar

	Connection number internal media schemata "Cooling water system"	Min.	Max.
Cooling water expansion tank			
+ Pre-pressure due to expansion tank at suction side of cooling water pump	-	0.45 bar	0.95 bar
+ Pressure loss from expansion tank to suction side of cooling water pump	-	-	0.1 bar

Table 65: LT cooling water – Plant

Seawater

		Min.	Max.
Seawater pressure seawater cooler inlet (if attached)	-	-	4.0 bar

Table 66: Seawater

Lube oil

	Connection number internal media schemata "Lubricating oil diagram"	Min.	Max.
Lube oil temperature engine inlet	2101, TE2170	50°C	68°C ¹⁾
Lube oil temperature engine inlet – Preheated before start ²⁾	2101, TE2170	20°C	55°C ³⁾
Lube oil temperature engine inlet – Preheated in case of stand-by operation ⁴⁾	2101, TE2170	40°C	55°C ³⁾
Lube oil pressure, at nominal speed (during engine operation)			
– Lube oil pump outlet	-	-	8.0 bar
– Engine inlet	2101, TE2170	2.0 bar ⁵⁾	6.0 bar
– Turbocharger inlet	PT2570	1.3 bar	2.2 bar
Prelubrication/postlubrication (duration ≤ 10 min) lube oil pressure			
– Engine inlet	2101, PT2170	0.3 bar	5 bar
– Turbocharger inlet	PT2570	0.2 bar	2.2 bar
Prelubrication/postlubrication (duration > 10 min) lube oil pressure			
– Engine inlet	2101, PT2170	0.3 bar	0.6 bar
– Turbocharger inlet	PT2570	0.2 bar	0.6 bar

¹⁾ Operation at alarm level.²⁾ Preheating required if minimum temperature +5°C of lube oil can not be kept.³⁾ If a higher temperature of the lube oil will be reached in the system, it is important at an engine start to reduce it as quickly as possible below alarm level to avoid a start failure.⁴⁾ See accordingly section [External lube oil system, Page 205](#).⁵⁾ Operation at alarm level at a speed of < 600 rpm.

Table 67: Lube oil

Fuel

	Connection number in- ternal media schemata "Fuel system"	Min.	Max.
Fuel temperature engine inlet – MGO (DMA) according ISO 8217, DIN EN590 or equivalent fuel	5201, TE5070	–10°C ¹⁾	45°C ²⁾
Fuel viscosity engine inlet – MGO (DMA) according ISO 8217, DIN EN590 or equivalent fuel	-	1.5 cSt	6.0 cSt
Fuel pressure before engine driven supply pump	-	–0.4 bar	0.5 bar ³⁾
Fuel pressure engine inlet	5201, PT5070	1.9 bar	7.0 bar
Fuel pressure engine inlet in case of black out (only for engine start idling)	5201, PT5070	0.2 bar	-
¹⁾ Maximum viscosity not to be exceeded. "Pour point" and "Cold filter plugging point" have to be observed.			
²⁾ Not allowed to fall below minimum viscosity.			
³⁾ Pressure loss of piping included.			

Table 68: Fuel

Compressed air in the starting air system

	Connection number in- ternal media schemata "Pressure air system"	Min.	Max.
Starting air pressure within vessel/pressure regulating valve in- let 12V	7101, PT7170	15.0 bar	37.0 bar ^{1) 2)}
Starting air pressure within vessel/pressure regulating valve in- let 16V	7101, PT7170	17.0 bar	37.0 bar ^{1) 2)}
Starting air pressure within vessel/pressure regulating valve in- let 20V	7101, PT7170	19.0 bar	37.0 bar ^{1) 2)}
Recommended air pressure	-	–	39.0 bar
¹⁾ Valid for current attached 40 bar air starter. For previous version of 30 bar air starter a pressure reducer 40/30 bar is necessary, that has to be installed 5 m before engine connection "starting motor" (7107).			
²⁾ For layout of the starting air system, note:			
- Starting air consumption and start duration stated within section Starting air and control air consumption, Page 77. - Maximum velocity (m/s) see section External pipe dimensioning, Page 179 - consider multiple start of engines, if needed.			

Table 69: Compressed air in the starting air system

Compressed air in the control air system

	Connection number in- ternal media schemata "Pressure air system"	Min.	Max.
Control air pressure engine inlet – Recommended	7102, PT7400 7102, PT7400	6.0 bar 6.5 bar	9.0 bar -
Control air pressure for turning gear – Recommended	7102, PT7400 7102, PT7400	8.0 bar 8.2 bar	9.0 bar -

Table 70: Compressed air in the control air system

Crankcase pressure (engine)

	Connection number in- ternal media schemata "Lubrication oil diagram"	Min.	Max.
Pressure within crankcase	2841	-2.5 mbar	0.0 mbar

Table 71: Crankcase pressure (engine)

		Setting
Safety valve attached to the crankcase (opening pressure)	-	50–100 mbar

Table 72: Safety valve

Polar blow-off – Plant

		Min.	Max.
Permitted pressure loss of piping system for blow-off (plant)	-	-	50.0 mbar ¹⁾

¹⁾ 5% of air flow rate engine to be assumed for blow-off amount.

Table 73: Charge air blow-off for ignition pressure limitation (plant)

Exhaust gas

	Connection number in- ternal media schemata "Charge air and exhaust gas diagram"	Min.	Max.
Exhaust gas pressure turbine inlet	-	-	4.0 bar (absolute)
Exhaust gas temperature turbine inlet	TE6575	-	630°C
Exhaust gas temperature turbine inlet at alarm level	TE6575	-	640°C
Exhaust gas temperature turbine outlet (normal operation un- der tropic conditions)	6511, 6512, TE6592	-	450°C
Exhaust gas temperature turbine outlet (emergency operation – STC function out of order at low load)	6511, 6512, TE6592	-	550°C
Minimum exhaust gas temperature after recooling due to ex- haust gas heat utilisation	-	190°C ¹⁾	-
Exhaust gas back pressure after turbocharger (static)	6511, 6512	-	50 mbar ²⁾

	Connection number in- ternal media schemata "Charge air and exhaust gas diagram"	Min.	Max.
¹⁾ To avoid sulfur corrosion in the exhaust gas line (plant). ²⁾ If this value is exceeded by the total exhaust gas back pressure of the designed exhaust gas line, sections Derating, definition of P_{Operating}, Page 43 and Increased exhaust gas pressure due to exhaust gas after treatment installations, Page 45 need to be considered.			

Table 74: Exhaust gas

Note:

Operating pressures without further specification are below/above atmospheric pressure.

2.17 Leakage rate

Max. leak rate (clean fuel)	Burst leak rate in case of pipe break (for max. 1 min)
l/h per cyl.	l/min
DMA	
8.0	4.0

Table 75: Leakage rate

Note:

- The values given in this table are average values; there may be deviations in individual measurements, e.g. due to fuel temperature, fuel inlet pressure, wear condition of the high-pressure pump, etc.
- High flow rates of dirty leakage oil will only occur in case of a pipe break and should occur for short time only. An alarm will be activated (< 1 min) and the operator must take actions. Special considerations have to be taken for the layout of single engine plants. This leakage can be reused, if the entire fuel treatment of separation and filtration is done.
- The operating leakage (clean) consists out of the operating leakage amount of the high-pressure pumps, plus the operating leakage injector, which occur during normal operation due to their function. This leakage can be reused, if the entire fuel treatment of separation and filtration is done.
- All other leakage amounts (dirt fuel oil from filters or from engine drains) have to be discharged into the sludge tank.

2.18 Filling volumes

Cooling water, fuel oil and oil volume of engine ¹⁾					
No. of cylinders			12	16	20
On engine oil system with deep oil sump, 815 mm	High oil level (eng. running)	litres	1,010	1,300	1,600
	Low oil level (eng. running)		845	1,093	1,352
On engine oil system with low oil sump, 550 mm	High oil level (eng. running)		1,015	1,280	1,525
	Low oil level (eng. running)		850	1,070	1,275
On engine jacket (HT) water ²⁾			625	762	899
On engine (LT) water ²⁾			506	592	678
On engine fuel oil system ²⁾			12	15	18

¹⁾ The given values are for guidance only and may differ depending on the customer chosen engine specification.

²⁾ Be aware: This is just the amount inside the engine. By this amount the level in the service or expansion tank will be lowered when media systems are put in operation after first filling.

Table 76: Cooling water, fuel oil and oil volume of engine

Service tanks/expansion tanks	Installation height ¹⁾	Minimum effective capacity		
	m	m ³		
No. of cylinders		12	16	20
Expansion tank, cooling water HT circuit	4.5–9.5	0.15		
Expansion tank, cooling water LT circuit	4.5–9.5	0.15		
Fuel service tank	–4.0–6.0	according to classification rules		

¹⁾ Installation height refers to tank bottom and crankshaft centre line.

Table 77: Service tanks/expansion tanks capacities

2.19 Venting amount of crankcase and turbocharger

A ventilation of the engine crankcase and the turbochargers is required, as described in section [Crankcase vent, Page 212](#).

For the layout of the ventilation system guidance is provided below:

Due to normal blow-by of the piston ring package small amounts of combustion chamber gases get into the crankcase and carry along oil mist.

- The amount of crankcase blow-by air is approximately 0.1% of the engine's air flow rate.

In addition, the sealing air of the turbocharger needs to be vented.

- The amount of turbocharger blow-by air is approximately:
 - For single-stage turbocharged engines 0.2% of the engine's air flow rate. (Accordingly see [Planning data, Page 79](#)).
 - For two-stage turbocharged engines 0.4% of the engine's air flow rate. (Accordingly see [Planning data, Page 79](#)).
- The temperature of the crankcase and turbocharger blow-by air is approximately 15 K higher than the oil temperature at the engine's oil inlet.

- The density of the crankcase and turbocharger blow-by air is 1.0 kg/m³ at the condition of approximately 70°C (343 K) and 1,013 mbar (assumption for calculation).

2.20 Exhaust gas emission

2.20.1 Maximum permissible NO_x emission limit value IMO Tier II and IMO Tier III

IMO Tier III: Engine in standard version¹

Rated speed	1,000 rpm	1,032 rpm
NO _x ^{1) 2) 3)}		
IMO Tier II cycle E2/E3	8.98 g/kWh ⁴⁾	8.92 g/kWh ⁴⁾
IMO Tier III cycle E2/E3	2.26 g/kWh ⁴⁾	2.25 g/kWh ⁴⁾

Note:

The engine's certification for compliance with the NO_x limits will be carried out during factory acceptance test according engine group concept.

¹⁾ Cycle values, operation on DM grade fuel (marine distillate fuel: MGO) according ISO 8217, based on a LT charge air cooling water temperature of 32°C at 25°C reference seawater temperature.

²⁾ Calculated as NO₂.

E2: Test cycle for "constant-speed main propulsion application" including electric propulsion and all controllable pitch propeller installations.

E3: Test cycle for "propeller-law-operated main and propeller-law-operated auxiliary engine" application.

³⁾ Based on a LT charge air cooling water temperature of 32°C at 25°C seawater temperature.

⁴⁾ Maximum permissible NO_x emissions for marine diesel engines according to IMO Tier II:

$130 \leq n \leq 2,000 \rightarrow 44 * n^{-0.23}$ g/kWh (n = rated engine speed in rpm)

IMO Tier III:

$130 \leq n \leq 2,000 \rightarrow 9 * n^{-0.2}$ g/kWh (n = rated engine speed in rpm).

Table 78: Maximum permissible NO_x emission limit value

¹ Marine engines are guaranteed to meet the requirements of MARPOL Annex VI, regulations for the prevention of air pollution from ships, as amended.

2.20.2 Smoke emission index (FSN)

Smoke index FSN for engine loads $\geq 25\%$ load well below limit of visibility (0.4 FSN).

Valid for:

- Distillate fuel according to ISO 8217 or RM-grade fuel, fulfilling the stated quality requirements.
- 50 mbar exhaust gas back pressure (at 100% output).

Note:

An increased exhaust gas back pressure will also increase the FSN figure. To be taken into account for ≥ 80 mbar exhaust gas back pressure.

SCR regeneration phase

Dependent on the ambient conditions during the regeneration phase of the SCR the smoke emission index may be increased.

2.20.3 Exhaust gas – possible components and visibility

The exhaust gas of reciprocating internal combustion engines is composed of numerous constituents. These are derived from either the combustion air and fuel and lube oil used, or they are reaction products, formed during the combustion process. Only some of these are to be considered as harmful substances.

The following listed exhaust gas components need to be seen as a general overview – the presence and amount of the singular component depends in large extends on the engine type, combustion process and fuel type.

Nitrogen N_2

Nitrogen (N_2) is with approximately 73–75 vol-% the main constituent of the exhaust gas.

Oxygen O_2

Approximately 21 vol-% of the ambient air is Oxygen (O_2).

Carbon dioxide CO_2

Carbon dioxide (CO_2) is a product of combustion.

Water vapour H_2O

The water in the exhaust comes from the combustion of the fuel and, to a lesser extent, from the moisture in the intake air. In diesel operation, the water vapour content is approximately 6 vol-%, in gas operation approximately 10 vol-%.

Inert gases Ar, Ne, He, etc.

Inert gases, such as Ar, Ne, He, etc., are constituents of the ambient air with a volume fraction of approximately 0.9 vol-%.

Sulphur oxides SO_x

Sulphur oxides (SO_x) are formed by the combustion of the sulphur contained in the fuel. The sulphur content in the fuel determines the SO_2 content in the exhaust gas.

Nitrogen oxides NO_x ($NO + NO_2$)

The high temperatures prevailing in the combustion chamber of an internal combustion engine cause the chemical reaction of nitrogen (contained in the combustion air as well as in some types of fuel) and oxygen (contained in the combustion air) to form nitrogen oxides (NO_x).

Carbon monoxide CO

Carbon monoxide (CO) is formed during incomplete combustion.

Hydrocarbons HC

The hydrocarbons (HC) contained in the exhaust gas are composed of a multitude of various organic compounds as a result of incomplete combustion.

Particulate matter PM

Particulate matter (PM) consists of soot (elemental carbon) and ash.

Methanol CH_3OH

Methanol only occurs in methanol operation as result of incomplete combustion.

Formaldehyde CH_2O

Formaldehyde (CH_2O) is a gas known by its pungent smell. Its proportion in the exhaust gas depends on the fuel and the degree of combustion. If the proportion of formaldehyde (CH_2O) is high, it can be removed by an oxidation catalyst – this is only necessary for gas or methanol operation.

Nitrous oxide N_2O

Nitrous oxide (N_2O) is a gas that only might occur in relevant quantity in ammonia (NH_3) operation.

Visibility of the exhaust gas

The visibility of exhaust gas highly depends on ambient conditions and the observer's line of sight to the exhaust gas, background and the sun. The exhaust gas can either be seen or not depending on the ambient temperature, wind velocity, diameter and height of the chimney and the colouring of the background. It can be black, blue, brown, yellow or white depending on the components present in the exhaust gas. Black or gray exhaust gas is mainly due to the presence of carbon particles. A blue appearance is usually due to droplets resulting from the incomplete combustion of fuel or lubricating oil. A yellow or brown appearance can be caused by the presence of NO_2 in the exhaust gas. White exhaust gas may be caused by condensed water and/or liquid fuel.

Smoke types	Possible contribution
White smoke	H_2O
Yellow/ brown smoke	NO_2
Blue smoke	SO_3 , SO_4 , lube oil
Black smoke	Carbon particles

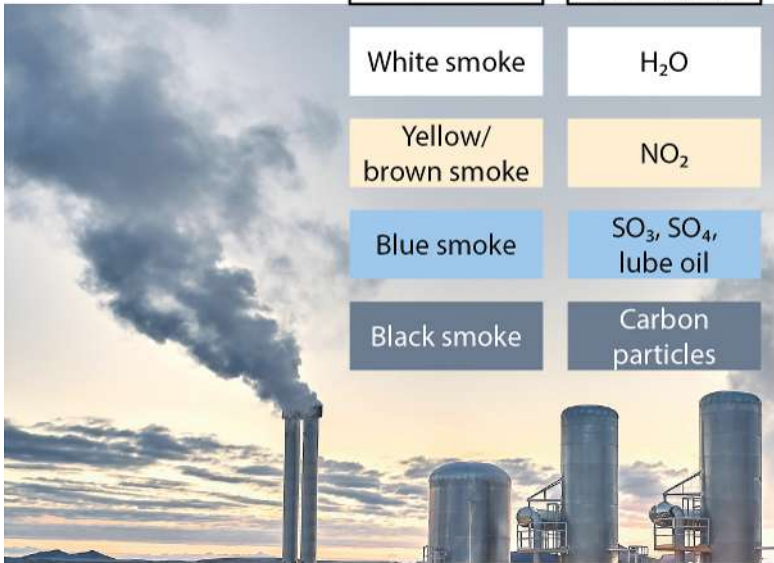


Figure 33: Possible components of the exhaust gas – Visibility

2.20.4 Emission-related installation instruction for engines

Position of the exhaust gas sampling points

The sampling position shall be fitted:

- At least 10 times the diameter of the exhaust pipe after the outlet of the engine, turbocharger or last after-treatment device
- In a straight pipe segment:
 - With an inlet path length before sampling position of at least 5 times the diameter of the exhaust pipe after last bending/obstruction/diameter deviation
 - With a path length after sampling position of at least 2 times the diameter of the exhaust pipe
- At least 5 times the diameter of the exhaust pipe before end of exhaust pipe
- Sufficiently close to the engine to ensure that the exhaust gas temperature at the sampling position will be minimum 180°C

If this is not attainable, a deviation of these requirements is acceptable if:

- justified by good engineering practice
- an incorrect measurement is not expected

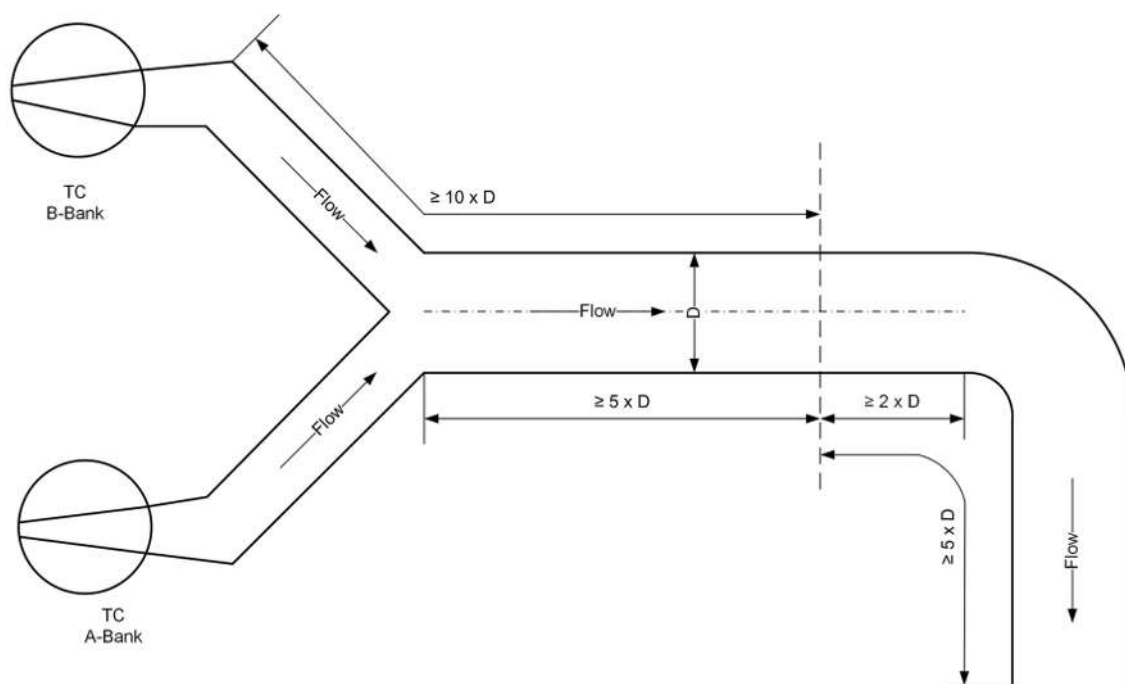


Figure 34: Position of sampling points (exemplary)

In the case an engine has distinct groups of manifolds, it is permissible to acquire a sample from each group individually and calculate an average exhaust emission. In this case, each sampling point must be designed as mentioned above.

The exhaust gas upstream the sampling point shall be free of any dilution from surrounding air or contamination from other exhaust gas systems.

Accessibility and working area at sampling point

The sampling point shall be accessible in a save way also during engine operation. In case the sampling point is covered by an insulation, the position shall be clearly visible marked on the insulation. The Insulation shall be designed in a way that it is easy to remove and to install again.

If necessary, a step has to be established.

There shall be enough space to place and operate the measurement equipment.

Requirements regarding the working area:

- Minimum space requirements: about 2-m width, 2-m depth, 2-m height
- Sufficient floor load capacity (at least 200 kg per m²)
- Temperature at this working area should be within +5°C to + 40°C and well ventilated
- Not subjected to excessive vibrations
- If needed weather protection for personnel and equipment against sun, wind and rain

Depending on the measurement equipment it should be considered that during the measurements following items are available at the working area:

- Adequate lighting and ventilation
- Power supply
- Pressurised air (instrument quality, oil free)
- Lifting devices for raising and lowering the equipment, if necessary

Exhaust pipe connection

- 1 piece of pipe thread inner diameter G 3" (use for particulate measurements)
- 2 pieces of pipe thread inner diameter G ½" (use for gaseous emission measurements or for smoke number measurement)

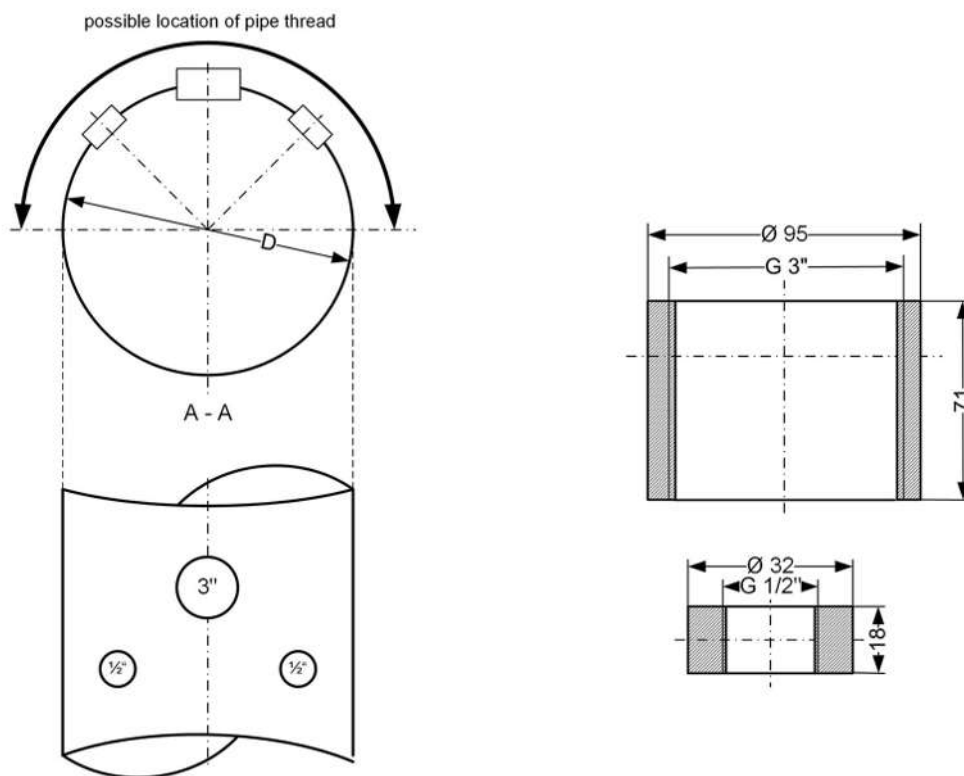


Figure 35: Sampling point, details

Installation of pipe thread G 3" and G 1/2"

To establish an airtight connection, the pipe threads shall be welded at the exhaust gas pipe. In case of a horizontal orientated exhaust gas pipe the position shall be in the upper half of the exhaust gas pipe in radial direction to the centre line and easy to access.

When the sampling points are not in use, a pipe plug shall close the pipe threads.

2.21 Noise

2.21.1 Airborne noise

Sound pressure level L_p

Measurements

Approximately 20 measuring points at 1 metre distance from the engine surface are distributed evenly around the engine according to ISO 6798. The noise at the exhaust outlet is not included, but provided separately in the following sections.

Octave level diagram

The expected sound pressure level L_p is approximately 110 dB(A) at 100% load.

The octave level diagram below represents an envelope of averaged measured spectra for comparable engines at the testbed and is a conservative spectrum consequently. No room correction is performed. The data will change depending on the acoustical properties of the environment.

Blow-off noise

Blow-off noise is not considered in the measurements, see below.

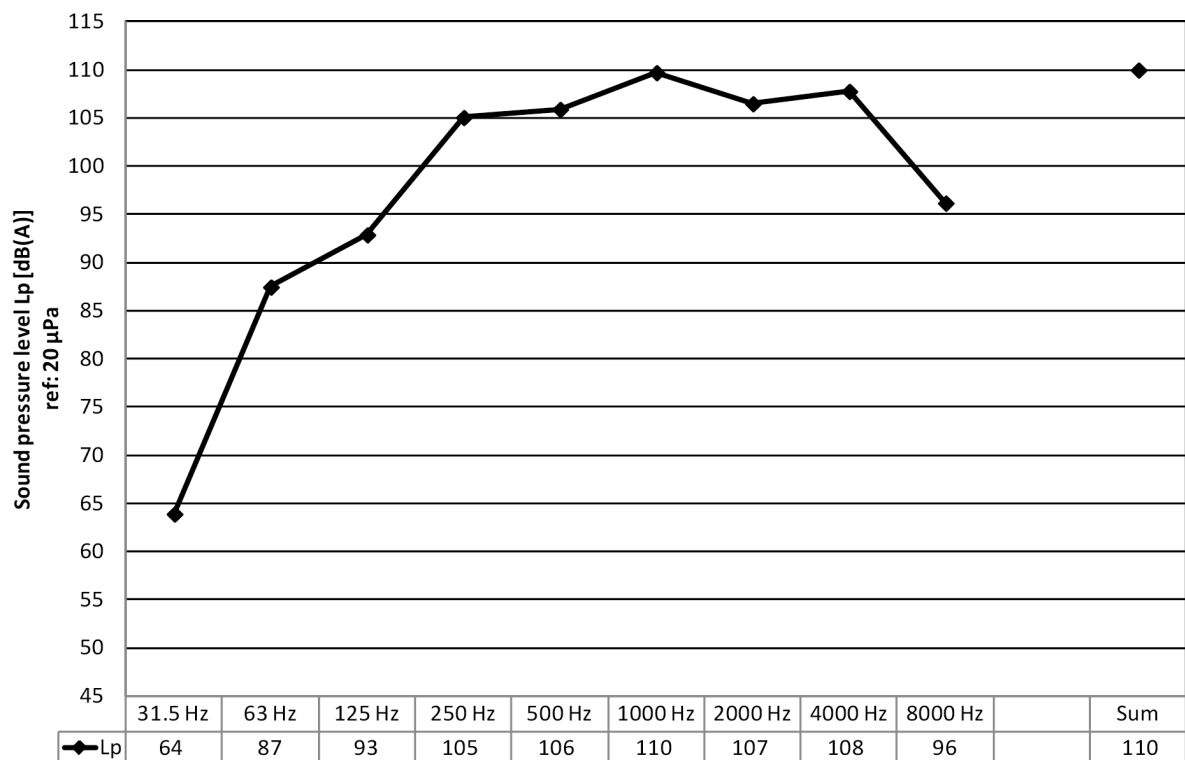


Figure 36: Airborne noise – Sound pressure level L_p – Octave level diagram

2.21.2 Intake noise

Sound power level L_w

Measurements

The (unsilenced) intake air noise is determined based on measurements at the turbocharger test bed and on measurements in the intake duct of typical engines at the test bed.

Octave level diagram

The expected sound power level L_w of the unsilenced intake noise in the intake duct is below 146 dB at 100% MCR.

The octave level diagram below represents an envelope of averaged measured spectra for comparable engines and is a conservative spectrum consequently. The data will change depending on the acoustical properties of the environment.

Charge air blow-off noise

Charge air blow-off noise is not considered in the measurements, see below.

These data are required and valid only for ducted air intake systems. The data are not valid if the standard air filter silencer is attached to the turbocharger.

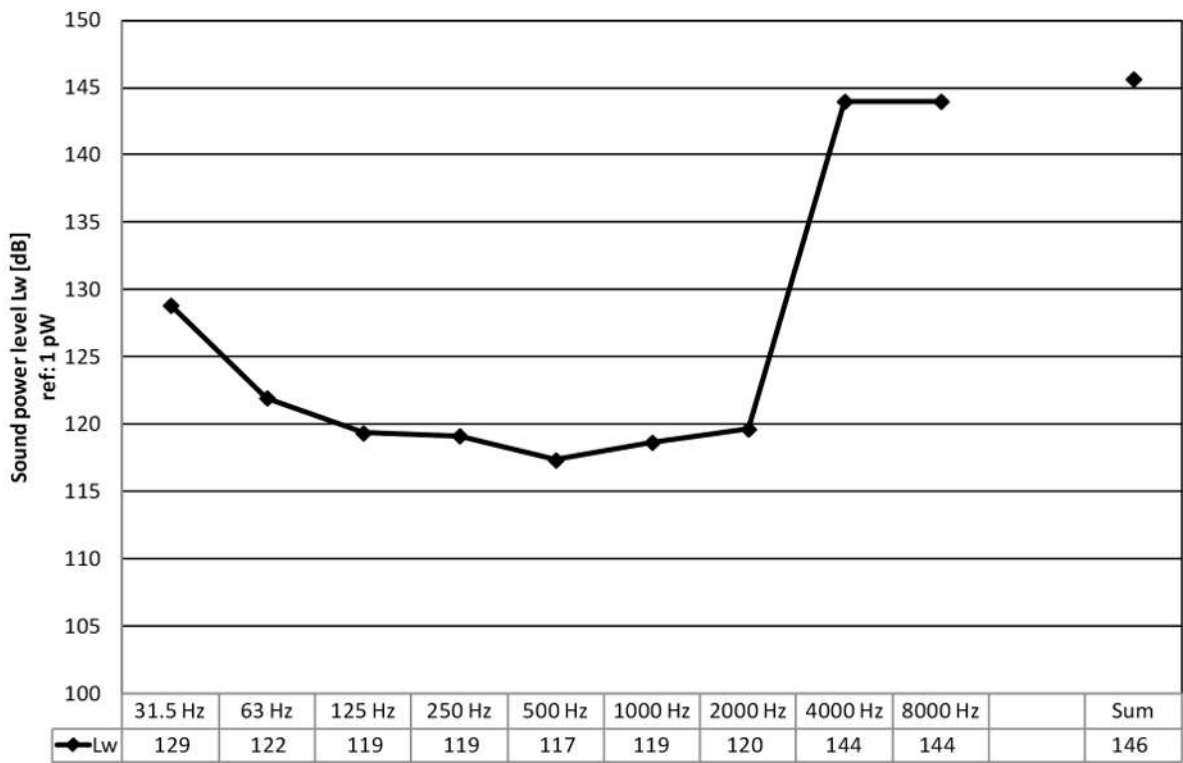


Figure 37: Unsilenced intake noise – Sound power level L_w – Octave level diagram

2.21.3 Exhaust gas noise

Measurements

The (unsilenced) exhaust gas noise is measured according to internal Everllence guidelines at several positions in the exhaust duct.

Octave level diagram

The sound power level L_w of the unsilenced exhaust gas noise in the exhaust pipe is shown at 100% MCR.

The octave level diagram below represents an envelope of averaged measured spectra for comparable engines and is a conservative spectrum consequently. The data will change depending on the acoustical properties of the environment.

Acoustic design

To ensure an appropriate acoustic design of the exhaust gas system, the yard, Everllence, supplier of silencer and where necessary acoustic consultant have to cooperate.

Blow-off noise

Blow-off noise is not considered in the measurements, see below.

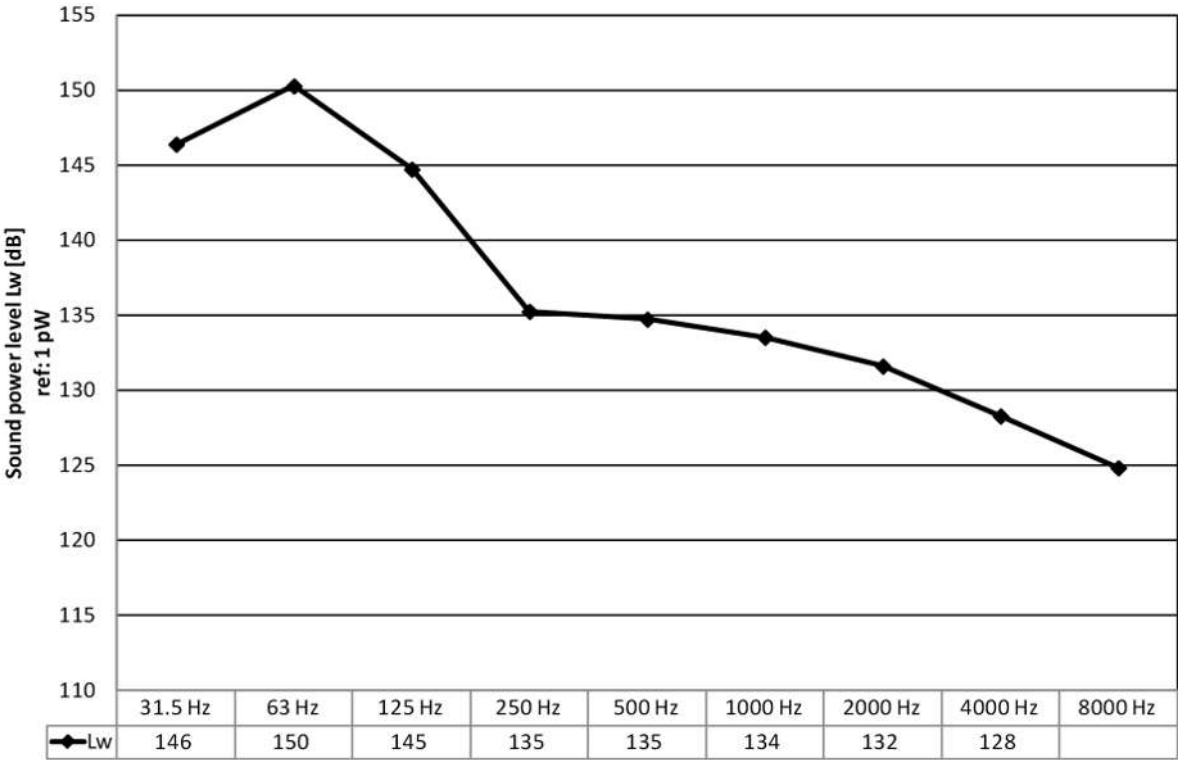


Figure 38: Unsilenced exhaust gas noise – Sound power level Lw – Octave level diagram

2.21.4 Blow-off noise example

Sound power level L_w

Measurements

The (unsilenced) charge air blow-off noise is measured according to DIN 45635, part 47 at the orifice of a duct.

Throttle body with bore size 135 mm

Expansion of charge air from 3.4 bar to ambient pressure at 42°C

Octave level diagram

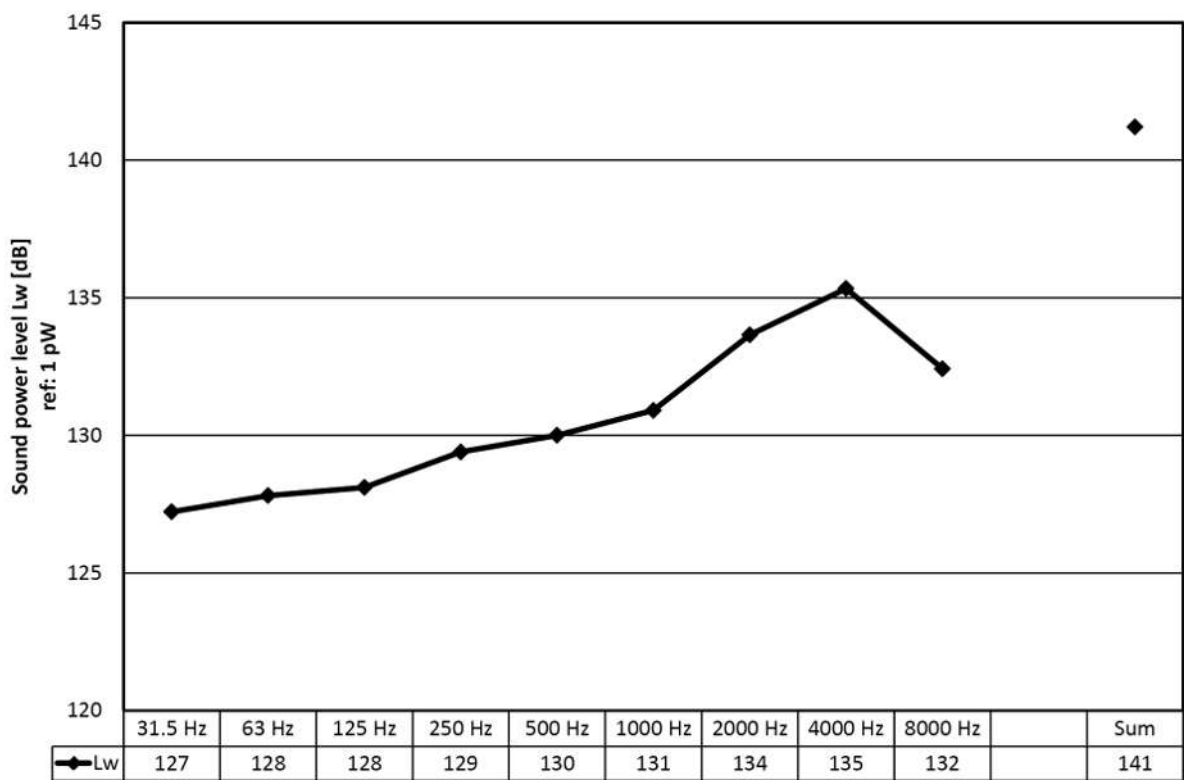


Figure 39: Unsilenced charge air blow-off noise – Sound power level L_w – Octave level diagram

2.21.5 Noise and vibration – Impact on foundation

Noise and vibration is emitted by the engine to the surrounding (see figure [Noise and vibration – Impact on foundation, Page 108](#)). The engine impact transferred through the engine mounting to the foundation is focused subsequently.

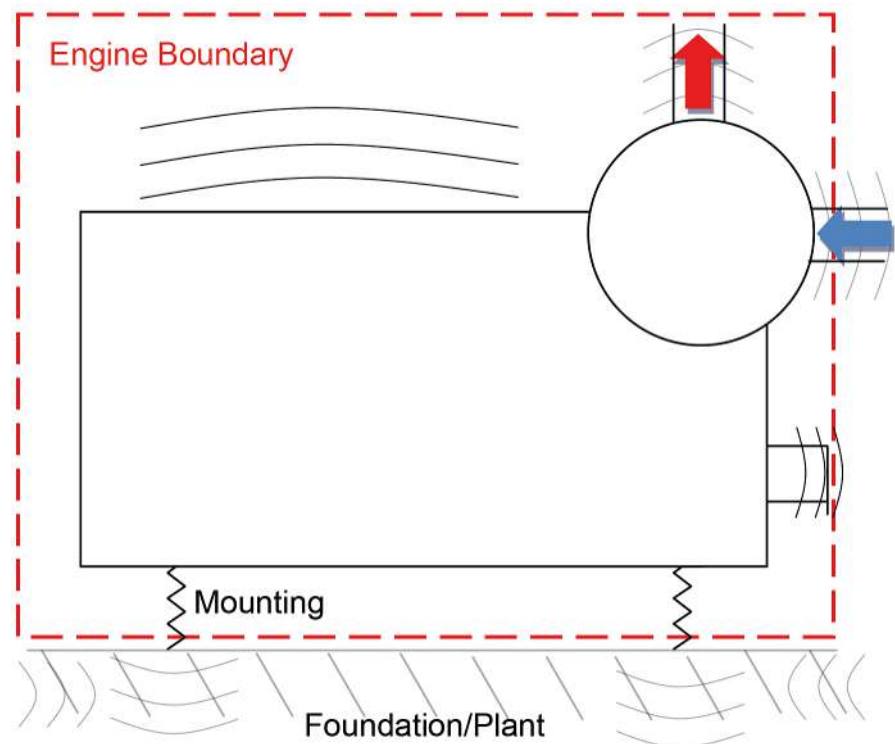


Figure 40: Noise and vibration – Impact on foundation

The foundation is excited to vibrations in a wide frequency range by the engine and by auxiliary equipment (from engine or plant). The engine is vibrating as a rigid body. Additionally, elastic engine vibrations are superimposed. Elastic vibrations are either of global (e.g. complete engine bending) or local (e.g. bending engine foot) character. If the higher frequency range is involved, the term "structure borne noise" is used instead of "vibrations".

Mechanical engine vibrations are mainly caused by mass forces of moved drive train components and by gas forces of the combustion process. For structure borne noise, further excitations are relevant as well, e.g. impacts from piston stroke and valve seating, impulsive gas force components, alternating gear train meshing forces and excitations from pumps.

For the analysis of the engine noise- and vibration-impact on the surrounding, the complete system with engine, engine mounting, foundation and plant has to be considered.

Engine related noise and vibration reduction measures cover e.g. counterbalance weights, balancing, crankshaft design with firing sequence, component design etc. The remaining, inevitable engine excitation is transmitted to the surrounding of the engine – but not completely in case of a resilient engine mounting, which is chosen according to the application-specific requirements. The resilient mounting isolates engine noise and vibration from its surrounding to a large extend. Hence, the transmitted forces are considerably reduced compared with a rigid mounting. Nevertheless, the engine itself is vibrating stronger in the low frequency range in general – especially when driving through mounting resonances.

In order to avoid resonances, it must be ensured that eigenfrequencies of foundation and coupled plant structures have a sufficient safety margin in relation to the engine excitations. Moreover, the foundation has to be designed as stiff as possible in all directions at the connections to the engine. Thus, the

foundation mobility (measured according to ISO 7262) has to be as low as possible to ensure low structure borne noise levels. For low frequencies, the global connection of the foundation with the plant is focused for that matter. The dynamic vibration behaviour of the foundation is mostly essential for the mid frequency range. In the high frequency range, the foundation elasticity is mainly influenced by the local design at the engine mounts. E.g. for steel foundations, sufficient wall thicknesses and stiffening ribs at the connection positions shall be provided. The dimensioning of the engine foundation also has to be adjusted to other parts of the plant. For instance, it has to be avoided that engine vibrations are amplified by alternator foundation vibrations. Due to the scope of supply, the foundation design and its connection with the plant is mostly within the responsibility of the costumer. Therefore, the customer is responsible to involve Everllence for consultancy in case of system-related questions with interaction of engine, foundation and plant. The following information is available for Everllence customers, some on special request:

- Residual external forces and couples (Project Guide)
Resulting from the summation of all mass forces from the moving drive train components. All engine components are considered rigidly in the calculation. The residual external forces and couples are only transferred completely to the foundation in case of a rigid mounting, see above.
- Static torque fluctuation (Project Guide)
Static torque fluctuations result from the summation of gas and mass forces acting on the crank drive. All components are considered rigidly in the calculation. These couples are acting on the foundation dependent on the applied engine mounting, see above.
- Mounting forces (project-specific)
The mounting dimensioning calculation is specific to a project and defines details of the engine mounting. Mounting forces acting on the foundation are part of the calculation results. Gas and mass forces are considered for the excitation. The engine is considered as one rigid body with elastic mounts. Thus, elastic engine vibrations are not implemented.
- Reference measurements for engine crankcase vibrations according to ISO 10816-6 (project-specific)
- Reference test bed measurements for structure borne noise (project-specific)
Measuring points are positioned according to ISO 13332 on the engine feet above and below the mounting elements. Structure borne noise levels above elastic mounts mainly depend on the engine itself. Whereas structure borne noise levels below elastic mounts strongly depend on the foundation design. A direct transfer of the results from the test bed foundation to the plant foundation is not easily possible – even with the consideration of test bed mobilities. The results of test bed foundation mobility measurements according to ISO 7626 are available as a reference on request as well.
- Dynamic transfer stiffness properties of resilient mounts (supplier information, project-specific)

Beside the described interaction of engine, foundation and plant with transfer through the engine mounting to the foundation, additional transfer paths need to be considered. For instance with focus on the elastic coupling of the drive train, the exhaust pipe, other pipes and supports etc. Besides the engine, other sources of noise and vibration need to be considered as well (e.g. auxiliary equipment, propeller, thruster).

2.22 Vibration

2.22.1 Torsional vibrations

Data required for torsional vibration calculation

Everllence calculates the torsional vibrations behaviour for each individual engine plant of their supply to determine the location and severity of resonance points. If necessary, appropriate measures will be taken to avoid excessive stresses due to torsional vibration. These investigations cover the ideal normal operation of the engine (all cylinders are firing equally) as well as the simulated emergency operation (misfiring of the cylinder exerting the greatest influence on vibrations, acting against compression). Besides the natural frequencies and the modes also the dynamic response will be calculated, normally under consideration of the 1st to 24th harmonic of the gas and mass forces of the engine.

Beyond that also further exciting sources such as propeller, pumps etc. can be considered if the respective manufacturer is able to make the corresponding data available to Everllence.

If necessary, a torsional vibration calculation will be worked out which can be submitted for approval to a classification society or a legal authority.

To carry out the torsional vibration calculation following particulars and/or documents are required.

General

- Type of propulsion (mechanical propulsion)
- Arrangement of the whole propulsion system including all engine-driven equipment
- Definition of the operating modes
- Maximum power consumption of the individual working machines

Engine

- Rated output, rated speed
- Kind of engine load (fixed pitch propeller, controllable pitch propeller, combinator curve, operation with reduced speed at excessive load)
- Kind of mounting of the engine (can influence the determination of the flexible coupling)

Flexible coupling

- Make, size and type
- Rated torque (Nm)
- Possible application factor
- Maximum speed (rpm)
- Permissible maximum torque for passing through resonance (Nm)
- Permissible shock torque for short-term loads (Nm)
- Permanently permissible alternating torque (Nm) including influencing factors (frequency, temperature, mean torque)

- Permanently permissible power loss (W) including influencing factors (frequency, temperature)
- Dynamic torsional stiffness (Nm/rad) including influencing factors (load, frequency, temperature), if applicable
- Relative damping (ψ) including influencing factors (load, frequency, temperature), if applicable
- Moment of inertia (kgm^2) for all parts of the coupling
- Dynamic stiffness in radial, axial and angular direction
- Permissible relative motions in radial, axial and angular direction, permanent and maximum

Clutch coupling

- Make, size and type
- Rated torque (Nm)
- Permissible maximum torque (Nm)
- Permanently permissible alternating torque (Nm) including influencing factors (frequency, temperature, mean torque)
- Dynamic torsional stiffness (Nm/rad)
- Damping factor
- Moments of inertia for the operation conditions, clutched and declutched
- Course of torque versus time during clutching in
- Permissible slip time (s)
- Slip torque (Nm)
- Maximum permissible engagement speed (rpm)

Gearbox

- Make and type
- Torsional multi mass system including the moments of inertia and the torsional stiffness, preferably related to the individual speed; in case of related figures, specification of the relation speed is required
- Gear ratios (number of teeth, speeds)
- Possible operating conditions (different gear ratios, clutch couplings)
- Permissible alternating torques in the gear meshes

Shaft line

- Drawing including all information about length and diameter of the shaft sections as well as the material
- Alternatively torsional stiffness (Nm/rad)

Propeller

- Kind of propeller (water jet propulsion, fixed pitch or controllable pitch propeller)
- Moment of inertia in air (kgm^2)
- Moment of inertia in water (kgm^2); for controllable pitch propellers also in dependence on pitch; for twin-engine plants separately for single- and twin-engine operation
- Relation between load and pitch
- Number of blades

- Diameter (mm)
- Possible torsional excitation in % of the rated torque for the 1st and the 2nd blade-pass frequency

Pump

- Kind of pump (e.g. dredging pump)
- Drawing of the pump shaft with all lengths and diameters
- Alternatively, torsional stiffness (Nm/rad)
- Moment of inertia in air (kgm²)
- Moment of inertia in operation (kgm²) under consideration of the conveyed medium
- Number of blades
- Possible torsional excitation in % of the rated torque for the 1st and the 2nd blade-pass frequency
- Power consumption curve

Water jet propulsion

- Kind of water jet propulsion
- Moment of inertia in air (kgm²)
- Moment of inertia in water (kgm²); for twin-engine plants separately for single- and twin-engine operation
- Number of blades
- Diameter (mm)
- Possible torsional excitation in % of the rated torque for the 1st and the 2nd blade-pass frequency

2.23 Requirements for power drive connection (static)

2.23.1 Limit values of masses to be coupled after the engine

Evaluation of permissible theoretical bearing loads

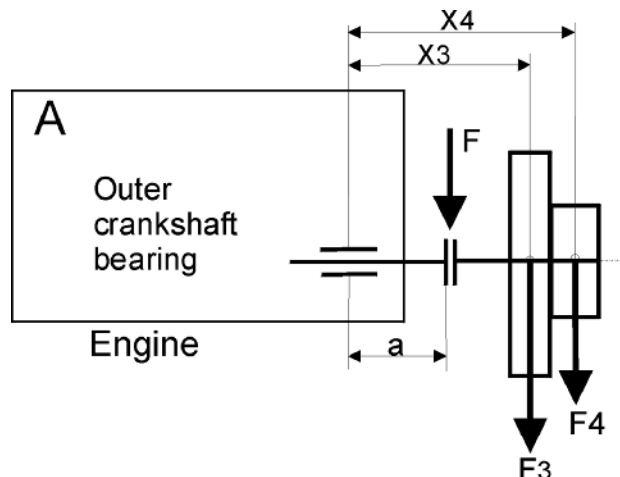


Figure 41: Case A: Overhung arrangement

$$M_{\max} = F \cdot a = F_3 \cdot x_3 + F_4 \cdot x_4$$

F_3	Flywheel weight
F_4	Coupling weight acting on the engine, including reset forces
a	Distance between end of coupling flange and centre of outer crankshaft bearing

1. Standard engine – Main power drive connection at coupling side

Engine	Distance a	$M_{\max} = F \cdot a$
	mm	kNm
V engine	300	8.2 ¹⁾

¹⁾ Inclusive of couples resulting from restoring forces of the coupling.

Table 79: Example calculation – Coupling side

2. Optional – Main power drive connection at counter coupling side (100% PT0)

Engine	Distance a	$M_{\max} = F \cdot a$
	mm	kNm
V engine	592.6	23.2 ¹⁾

¹⁾ Inclusive of couples resulting from restoring forces of the coupling.

Table 80: Example calculation – Counter coupling side

3. Optional – Auxiliary PTO at counter coupling side (main power drive connection at coupling side)

Engine	Distance a	$M_{\max} = F \cdot a$
	mm	kNm
V engine	810.0	6.0 ¹⁾
¹⁾ Inclusive of couples resulting from restoring forces of the coupling.		

Table 81: Example calculation – For auxiliary PTO on counter coupling side

Note:

For main power drive connection related values see case 1.

Note:

Stated values only for orientation – need to be clarified project specific and may be limited due to the torsional vibration calculation or special service conditions.

Note:

Masses which are connected downstream of the engine in the case of an overhung or rigidly coupled, arrangement result in additional crankshaft bending stress, which is mirrored in a measured web deflection during engine installation.

Provided the limit values for the masses to be coupled downstream of the engine (permissible values for $M_{\max}$ and $F_{1\max}$) are complied with, the permitted web deflections will not be exceeded during assembly.

Observing these values ensures a sufficiently long operating time before a re-alignment of the crankshaft has to be carried out.

2.23.2 10% PTO – Maximum torque and requirements screw connection

In case main power drive connection is at coupling side, on counter coupling side a PTO might be used if stated requirements are met.

Screw strength class	8.8	10.9	12.9
Number/standard	12 * DIN 931-M33		
Min. screw-in-depth	25 mm	28 mm	30 mm
Tightening torque	1,400 Nm	2,000 Nm	2,350 Nm
Max. torque at PTO	38 kNm	55 kNm	64 kNm

Note:

Stated values only for orientation – needs to be clarified project specific.

2.24 Requirements for power drive connection (dynamic)

2.24.1 Moments of inertia – Crankshaft, damper, flywheel

455 kW/cyl.; 1,000 rpm (ICN), 500 kW/cyl.; 1,032 rpm (ICFN)

Operation with variable speed

$a_{\text{mot}} = 80\%/sec$

Marine main engines				
No. of cylinders, config.	Engine			Required minimum total moment of inertia ¹⁾ J _{Total min}
	Maximum continuous rating	Moment of inertia crankshaft + damper J ₁	Moment of inertia flywheel J ₂	
	[kW]	[kgm ²]	[kgm ²]	[kgm ²]
n = 1,000 rpm				
12V	5,460	221	89.5	622
16V	7,280	274	89.5	830
20V	9,100	328	93.0	1,037
n = 1,032 rpm				
12V	6,000	221	89.5	642
16V	8,000	274	89.5	856
20V	10,000	328	93.0	1,070
1) Required minimum moment of inertia of engine, flywheel and arrangement after flywheel in total.				

Table 82: Moments of inertia/flywheel – Operation with variable speed

For flywheels dimensions see section [Flywheel arrangement, Page 119](#).

2.24.2 Balancing of masses – Firing order

Certain cylinder numbers have unbalanced forces and couples due to crank diagram. These forces and couples cause dynamic effects on the foundation. Due to a balancing of masses the forces and couples are reduced. In the following tables the remaining forces and couples are displayed.

V engine

Rotating crank balance: 85%

No. of cylinders, config.	Residual external couples				
	M _{rot} (kNm)	M _{osc 1st order} (kNm)		M _{osc 2nd order} (kNm)	
		Engine speed 1,000 rpm			
Direction		vertical	horizontal	vertical	horizontal
12V	0		0		0
16V					
20V					

Table 83: Residual external couples

The external mass forces are equal to zero.

M_{rot} is eliminated by means of balancing weights on resiliently mounted engines.

Firing order: Counted from coupling side

No. of cylinders, config.	Firing interval	Clockwise rotation (viewed from engine coupling side)
12V	68°; 52°	B1-A5-B5-A3-B3-A6-B6-A2-B2-A4-B4-A1
16V	38°; 52°	B1-A5-B5-A2-B2-A6-B6-A8-B8-A4-B4-A7-B7-A3-B3-A1
20V	20°; 52°	B1-A4-B4-A2-B2-A5-B5-A8-B8-A10-B10-A7-B7-A9-B9-A6-B6-A3-B3-A1

Table 84: Firing interval – Clockwise rotation

No. of cylinders, config.	Firing interval	Counterclockwise rotation (viewed from engine coupling side)
12V	68°; 52°	A1-B4-A4-B2-A2-B6-A6-B3-A3-B5-A5-B1
16V	38°; 52°	A1-B3-A3-B7-A7-B4-A4-B8-A8-B6-A6-B2-A2-B5-A5-B1
20V	20°; 52°	A1-B3-A3-B6-A6-B9-A9-B7-A7-B10-A10-B8-A8-B5-A5-B2-A2-B4-A4-B1

Table 85: Firing interval – Counter clockwise rotation

2.24.3 Static torque fluctuation

General

The static torque fluctuation is the summation of the torques acting at all cranks around the crankshaft axis taking into account the correct phase-angles. These torques are created by the gas and mass forces acting at the crankpins, with the crank radius being used as the lever. An rigid crankshaft is assumed.

The values T_{max} and T_{min} listed in the following table(s) represent a measure for the reaction forces of the engine. The reaction forces generated by the torque fluctuation are dependent on speed and cylinder number and give a contribution to the excitations transmitted into the foundation see figure [Static torque fluctuation, Page 117](#) and the table(s) in this section. According to different mountings these forces are reduced.

In order to avoid local vibration excitations in the vessel, it must be ensured that the natural frequencies of important part structures (e.g. panels, bulk-heads, tank walls and decks, equipment and its foundation, pipe systems) have a sufficient safety margin (if possible $\pm 30\%$) in relation to all engine excitation frequencies.

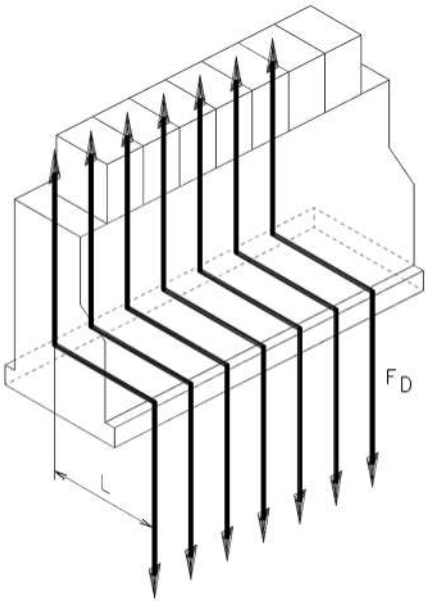


Figure 42: Static torque fluctuation

$$F_D \times L \times z = \frac{T_{max} - T_{min}}{2}$$

L Distance between foundation bolts

z Number of cylinders

2026-02-24 - 6.2

Static torque fluctuation and exciting frequencies

Example to declare abbreviations

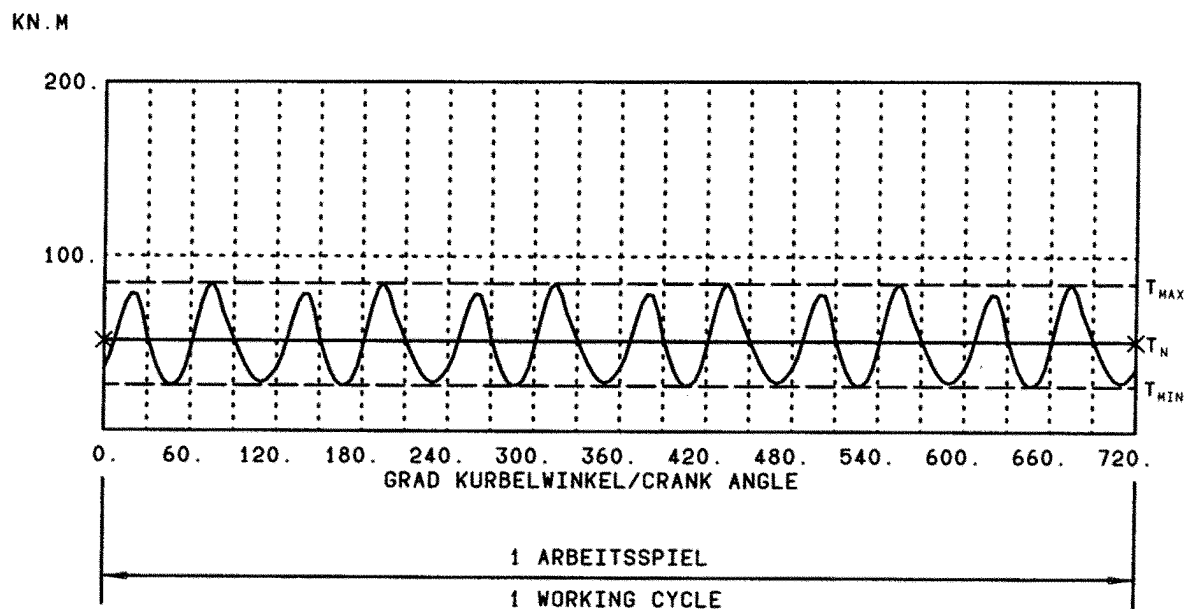


Figure 43: Example to declare abbreviations


No. of cylinders, config.	Output	Speed	T_n	T_{max}	T_{min}	Main exciting components		
	kW	rpm	kNm	kNm	kNm	Order	Frequency ¹⁾	$\pm T$
12V	5,460	1,000	52.1	86.4	26.0	3.0	50	8.2
						6.0	100	22.9
16V	7,280		69.5	97.5	40.6	4.0	66.7	18.8
						8.0	133.3	10.2
20V	9,100	1,032	86.9	128.2	40.3	5.0	83.3	48.6
						10.0	166.7	0.8
12V	6,000		55.5	89.6	29.0	3.0	51.6	9.6
						6.0	103.2	24.0
16V	8,000		74.0	100.6	45.0	4.0	68.8	21.4
						8.0	137.6	8.7
20V	10,000		92.5	134.6	45.1	5.0	86.0	49.0
						10.0	172.0	0.6

¹⁾ Exciting frequency of the main harmonic components.

Table 86: Static torque fluctuation and exciting frequencies


2.25 Power transmission

2.25.1 Flywheel arrangement

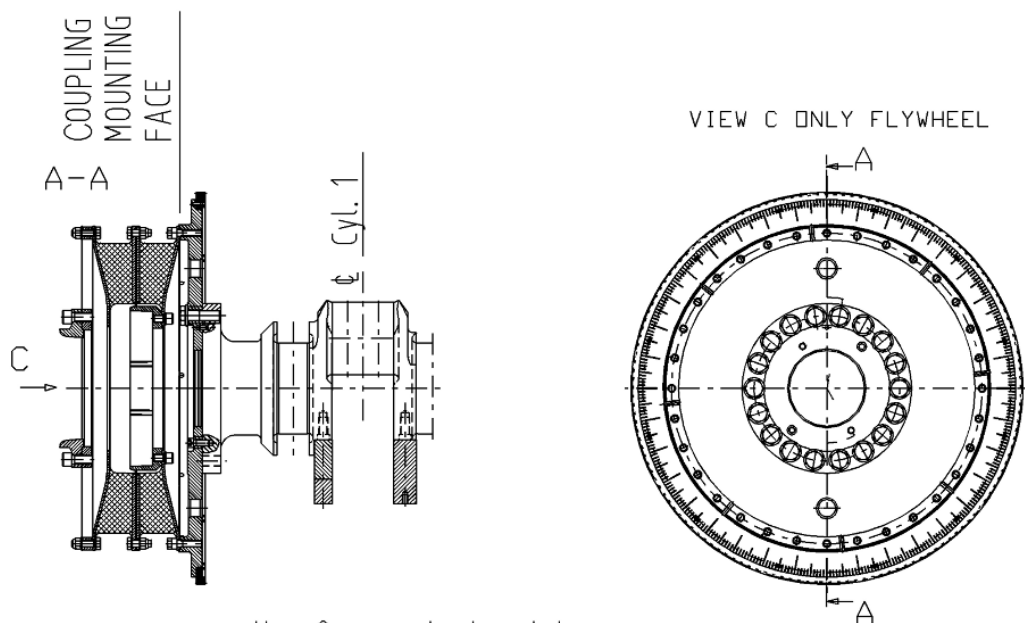

Use for project only!

Final dimensions of flywheel and flexible coupling will result from clarification of technical details of drive and from the result of the torsional vibration calculation.
Flywheel diameter must not be changed!

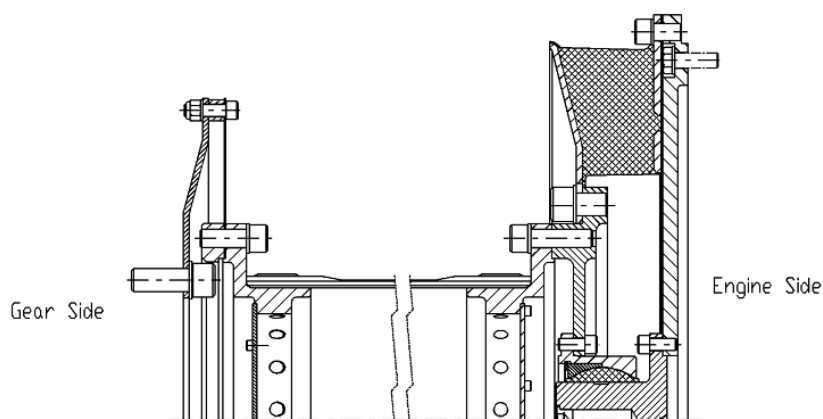

EXAMPLE OF TYPICAL
COUPLING COMBINATION

Figure 44: Example of flywheel arrangement with flexible coupling

Note:

The flexible coupling will be part of Everlence supply and thus we will produce a contract specific flywheel/coupling/driven machine arrangement drawing giving all necessary installation dimensions. Final dimensions of flywheel and

flexible coupling will result from clarification of technical details of drive and from the result of the torsional vibration calculation. Flywheel diameter must not be changed.

2.26 Foundation

2.26.1 General requirements for engine foundation

Plate thicknesses

The stated material dimensions are recommendations, calculated for steel plates. Thicknesses smaller than these are not permissible. When using other materials (e.g. aluminium), a sufficient margin has to be added.

Top plates

Before or after having been welded in place, the bearing surfaces should be machined and freed from rolling scale. Surface finish corresponding to Ra 3.2 peak-to-valley roughness in the area of the chocks shall be accomplished.

The thickness given is the finished size after machining.

Downward inclination outwards, not exceeding 0.7%.

Prior to fitting the chocks, clean the bearing surfaces from dirt and rust that may have formed. After the drilling of the foundation bolt holes, spotface the lower contact face normal to the bolt hole.

Foundation girders

The distance of the inner girders must be observed. We recommend that the distance of the outer girders (only required for larger types) is observed as well.

The girders must be aligned exactly above and underneath the tank top.

Floor plates

No manholes are permitted in the floor plates in the area of the box-shaped foundation. Welding is to be carried out through the manholes in the outer girders.

Top plate supporting

Provide support in the area of the frames from the nearest girder below.

Dynamic foundation requirements

The eigenfrequencies of the foundation and the supporting structures, including GenSet weight (without engine) shall be higher than 20 Hz. Occasionally, even higher foundation eigenfrequencies are required. For further information refer to section [Noise and vibration – Impact on foundation, Page 107](#).

Note:

The requirements of the respective classification society have to be considered in addition.

2.26 Foundation



Figure 45: General arrangement

2.26.3 Resilient seating

General

The vibration of the engine causes dynamic effects on the foundation. These effects are attributed to the pulsating reaction forces due to the fluctuating torque. Additionally, in engines with certain cylinder numbers these effects are increased by unbalanced forces and couples brought about by rotating or reciprocating masses which – considering their vector sum – do not equate to zero.

The direct resilient support makes it possible to reduce the dynamic forces acting on the foundation, which are generated by every reciprocating engine and may – under adverse conditions – have harmful effects on the environment of the engine.

With respect to large engines (bore > 400 mm) Everllence offers two different versions of the resilient mounting (one using conical – the other inclined sandwich elements).

The inclined resilient mounting was developed especially for ships with high comfort demands, e.g. passenger ferries and cruise vessels. This mounting system is characterised by natural frequencies of the resiliently supported engine being lower than approximately 7 Hz. The resonances are located away from the excitation frequencies related to operation at nominal speed.

For average demands of comfort, e.g. for merchant ships, and for smaller engines (bore < 400 mm) mountings using conical mounts can be judged as being fully sufficient. Because of the stiffer design of the elements the natural frequencies of the system are significantly higher than in case of the inclined resilient mounting. The natural frequencies of engines mounted with this kind of mounts are lower than approximately 18 Hz. The vibration isolation is thus of lower quality. It is however, still considerably better than a rigid or semi resilient engine support.

The appropriate design of the resilient support will be selected in accordance with the demands of the customer, i.e. it will be adjusted to the special requirements of each plant.

In both versions the supporting elements will be connected directly to the engine feet by special brackets.

The number, rubber hardness and distribution of the supporting elements depend on:

- The weight of the engine
- The centre of gravity of the engine
- The desired natural frequencies

Where resilient mounting is applied, the following has to be taken into consideration when designing a propulsion plant:

- Resilient mountings always feature several resonances resulting from the natural mounting frequencies. In spite of the endeavour to keep resonances as far as possible from nominal speed the lower bound of the speed range free from resonances will rarely be lower than 70% of nominal speed for mountings using inclined mounts and rarely lower than 85% for mountings using conical mounts. It must be pointed out that these percentages are only guide values. The speed interval being free from resonances may be larger or smaller. These restrictions in speed will mostly require the deployment of a controllable pitch propeller.

- Between the resiliently mounted engine and the rigidly mounted gearbox or alternator, a flexible coupling with minimum axial and radial elastic forces and large axial and radial displacement capacities should be provided.
- The media connections (compensators) to and from the engine must be highly flexible whereas the fixations of the compensators on the one hand with the engine and on the other hand with the environment must be realised as stiff as possible.
- For the inclined resilient support, provision for stopper elements has to be made because of the sea-state-related movement of the vessel. In the case of conical mounting, these stoppers are integrated in the element.
- In order to achieve a good vibration isolation, the lower brackets used to connect the supporting elements with the ship's foundation are to be fitted at sufficiently rigid points of the foundation. Influences of the foundation's stiffness on the natural frequencies of the resilient support of the engine will not be considered in the mounting design calculation.
- The yard must specify with which inclination related to the plane keel the engine will be installed in the ship. The inclination must be defined and communicated before entering the dimensioning process.

This page is intentionally left blank

3 Data Logging Solutions

3.1 Data Logging - General Information

Variants	Everllence offers two remote connectivity solutions (as Data Logging Cabinets): ▪ DLCB: Data Logging Cabinet Basic ▪ DLC+: Data Logging Cabinet Plus
DLC+ versus DLC Basic	DLC Basic ▪ Only usable in condition with non IACS UR-E27 requirements ▪ Log operational data and send it to CEON when connected online (read only) ▪ Solution enables Digital Service: – PrimeServ Assist DLC+ ▪ Solution classified according to IACS UR-E27 and IEC 62443-3-3 requirements ▪ Read and write access to operational data and parameters for SaCoS 5000 and SaCoSone modules ▪ Upgrade, update and advanced analytics capability (interactive remote access) ▪ Remote commissioning support ▪ Customer Reporting Tool (optional) ▪ Solution enables Digital Services: – PrimeServ Assist – PrimeServ Assist Stealth – Everllence Asset+
Localisation	The DLCB or DLC+ is part of the equipment off engine.
Connection	The DLCB or DLC+ component is an element of the SaCoS network architecture, implementing secure, encrypted communication channels for interconnection with Everllence digital services. This ensures authenticated data exchange and supports the delivery of digital remote services in compliance with network security standards.

3.2 Data Logging Cabinet Plus (DLC+)

Description	The Data Logging Cabinet Plus is used for maintaining SaCoS components (backup/restore), on-site data logging and diagnostic and to connect to Everllence Digital Services. Intelligent and for security hardened components are installed in the Data Logging Cabinet Plus. The Data Logging Cabinet Plus enables through secure hardware and software the deployment locally or, on demand, over the air of the comprehensive Everllence Digital Services. Everllence Digital Services include engine remote monitoring of operational data and diagnostics, troubleshooting and advice from Everllence engineers and also software and security updates in a safe manner.
-------------	---

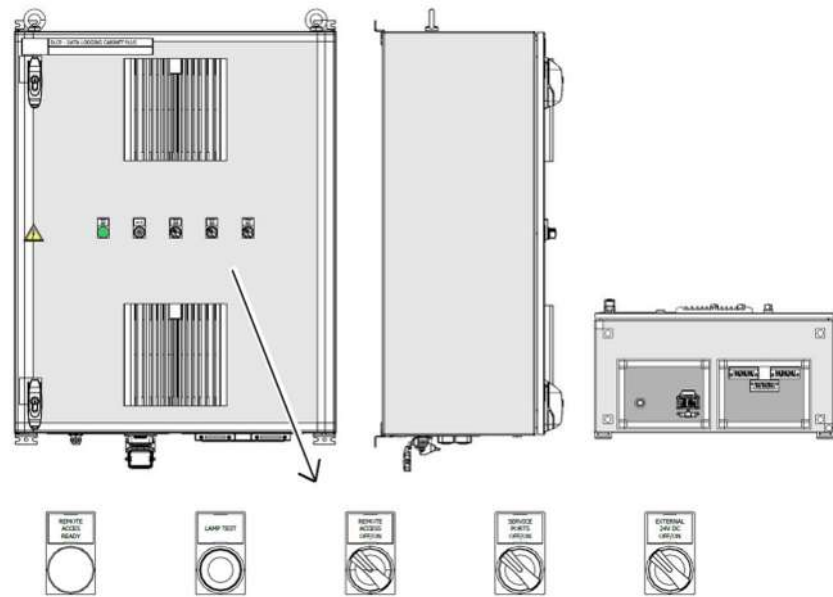


Figure 46: Data Logging Cabinet Plus (DLC+)

Power supply

The DLC+ can be connected either to 24V DC or to 230/115 VAC (50 / 60 Hz).

Dimensions and weights

Dimensions (H x W x D)	1000x800x400 mm
Weight	up to 100 kg, depending on configuration

Environmental conditions

- Ambient air temperature: +5 °C to +45 °C
- Relative humidity: < 96 %
- Vibrations: < 0.7 g

Design

- Cable entries: From below, through cabinet base
- Accessible by front door(s), doors with locks
- Opening angle: 90°
- Standard colour: Light grey (RAL7035)
- Ingress protection: IP54

Installation requirements

The cabinet is designed for installation in engine rooms or engine control rooms.

The cabinet must be installed at a location suitable for service inspection.

Do not install the cabinet close to heat-generating devices.

3.3 Data Logging - Additional Information

- For details on data logging, such as:
 - Description of what data is logged
 - Description of access rights
 - Analysis of data
 - Description of which tools are required
- Digital Services:
 - PrimeServ Assist

- PrimeServ Assist Stealth
 - Everllence Asset+
- etc., contact Everllence

This page is intentionally left blank

4 Engine automation

4.1 SaCoS 5000 system overview

The engine is equipped with the latest generation of Everllence' engine control- and safety system SaCoS 5000 (**S**afety and **C**ontrol **S**ystem) for four-stroke diesel- and gas engines. The engine control- and safety system is responsible for complete engine operation, control, alarming and safety. All sensors and actuators are wired to the engine-attached units. The whole system design has a modular and flexible topology. The interface to the SaCoS engine room automation is done by an Interface Cabinet, see section [SaCoS Engine Room Automation, Page 191](#). The SaCoS 5000 design is based on highly reliable and approved components as well as modules specially designed for installation on 4-stroke medium speed engines. The used components are harmonised to an homogenous system. The system has already been tested and parameterised in the factory, the final parameterisation takes place at the customer. During engine installation, only the bus connections, the power supply and safety-related signal cables between the units/modules on engine and the cabinets are to be laid, as well as connections to external modules, electrical motors on the engine and parts on site.

The Control Modules and the Injection Module are integrated in the Control Unit (CU). The Display Module and Gateway Communication Module are integrated in the Interface Cabinet (IC), the cabinet has an ingress protection of IP65.

Abbreviation	Name	Function
DML	Display Module L	The 12.1"-touchscreen is used for operation of the engine and the visualisation of all operating values.
GCM	Gateway Communication Module	Provides the communication interface to an external system.
IM	Injection Module	Provides the complete fuel injection control functionality.
CM	Control Module	Offers a variety of different input/output functionalities to achieve basic control functionalities, e. g. as engine control.

Table 87: SaCoS 5000 module types

System bus

The system bus connects all the modules together and forms the basis of the data exchange between the SaCoS modules. Data communication is guaranteed at all times as the connection is made redundant. In this way, modules can access the redundant measured values from other modules if their own sensor should fail. I/O extensions are connected to modules via a non-redundant bus.

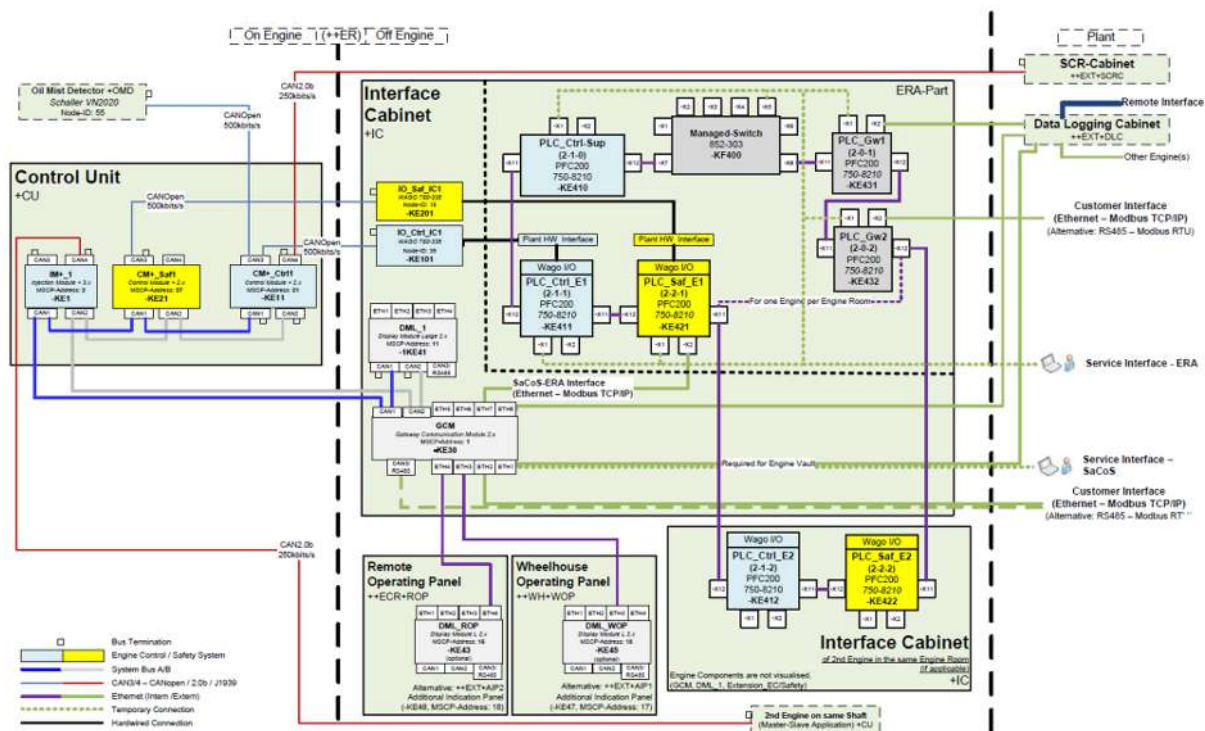


Figure 47: System bus

4.1.1 Cybersecurity guidelines

4.1.1.1 Terms, abbreviations and definitions

Term, abbreviation	Definition
CEON	Everllence service for recording engine data
Data	Data
DLC	Data logging cabinet (DLCB / DLC+)
DLC+	Data Logging Cabinet Plus (enable data logging functionality as well as additional services / remote support / update possibilities)
DLCB	Data Logging Cabinet Basic (enable data logging functionality)
DM	Display module
ER	Engine room
ECR	Engine control room
eToken	SaCoS 5000 security token SaCoSone security token (Thales Group eToken 5110+)
ExG-MM	Exchange Gateway Monitoring Module is an industrial PC used as a jump host / data logger / toolbox

Term, abbreviation	Definition
ExG-EDM	Exchange Gateway EDM Module is an industrial PC used for Electronic Device Management for over-the-air updates
EXPERT	Everllence tool for SaCoS parameterisation
G(C)M	Gateway (Communication) Module
IAS	Integrated alarm system (see also “customer network”)
IC	Interface cabinet
LOP	Local operating panel
PMS	Power management system
RDP	Remote desktop protocol
ROC	Remote operation centre
ROP	Remote operating panel (see also WOP, wheel operating panel)
SaCoS	Safety and Control System
SCR	Selective catalytic reduction
SCR SL	SCR Single Line system (medium speed)
SCR ML	SCR Multi Line system (high speed / 175D)
SDI	SaCoSone device image
Toolbox	(Virtual) device for parameterisation and backup/restore of SaCoS
WBM	Web-based management

Table 88: Terms, abbreviations, and definitions

4.1.1.2 System Overview

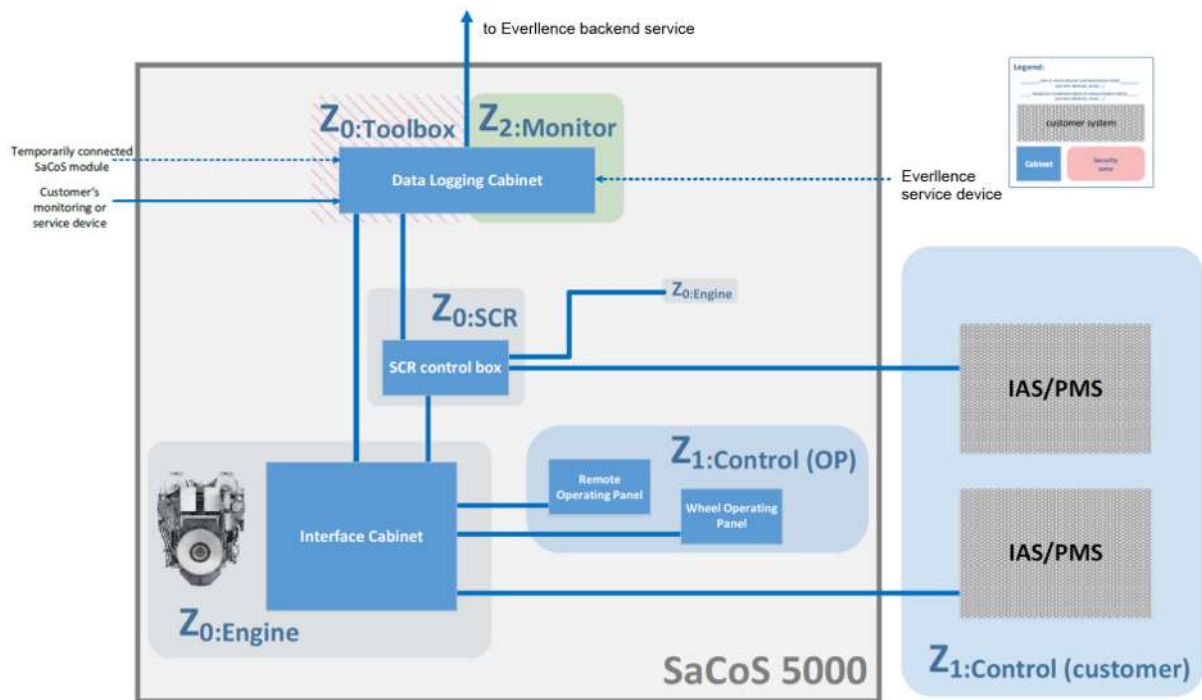


Figure 48: SaCoS 5000 with SCR and DLC: Zones and connections (simplified)

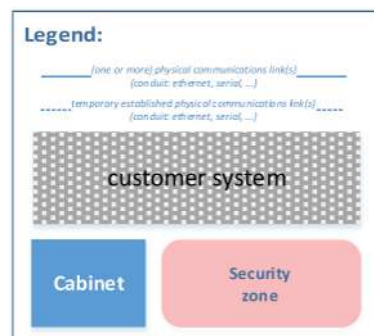


Figure 49: SaCoS 5000 with SCR and DLC: Zones and connections (simplified) – Legend

Fig. SaCoS 5000 with SCR and DLC: Zones and connections (simplified): Shows a simplified overview of the SaCoS 5000 system (with SCR and DLC), and some of the relevant zones and connections.

Fig. SaCoS 5000 with SCR and DLC: Zones and connections (simplified) – Legend:

Shows the legend for the simplified overview of the SaCoS 5000 system (with SCR and DLC).

The system is divided into the following main security zones:

- **Z_{0:Engine}**: Devices in this zone implement the main functionality of the engine control system.
- **Z_{0:SCR}**: Devices in this zone implement the SCR functionality and enable local monitoring and control of the SCR system.

- **Z_{1:Control(OP)}**: This zone contains the control panels (including, for example, the ROP and WOP) that enable local monitoring and control of the engine control system.
- **Z_{1:Control(customer)}**: This zone contains the ship's integrated alarm and/or power management system(s) (IAS/PMS).
- **Z_{2:Monitor}**: This zone (available only on systems with DLC) contains virtualized and physical devices that implement local/remote monitoring and logging of control system data. With DLC+, it is also possible to obtain limited, secure, and interactive access to the jump host (also called ExG-MM in SaCoS) and use the described functionality. For this, the user can connect to the system with their own device via the designated network port in the DLC+.
- **Z_{0:Toolbox}**: This zone (available only on systems with DLC+) contains virtualized and physical devices that enable local/remote system parameterization, including restoring system backups to SaCoS modules that are temporarily connected to the DLC+ for this purpose. To gain limited, secure, and interactive access to the jump host (ExG-MM) in the DLC+ and to use the described functionality, the user can connect to the system with their own device via the designated network port in the DLC+.

The majority of the devices making up the control system are installed in locked control cabinets or units. These must be set up in restricted locations such as engine rooms (ER) and engine control rooms (ECR).

4.1.1.3 Physical security of SaCoS

Due to their design, some SaCoS devices and communication links must be physically protected against unauthorised access at all times (i.e., including during commissioning). Only authorised and authenticated personnel may have access to these devices and connections. Such access must be logged.

The security of these protections should be assessed by the customer, taking into account the system context, system purpose, system location, assumptions about current and future threats to the customer's business, and applicable regulations.

4.1.1.4 Secure access and storage of SaCoS data

It is necessary to keep the data created by or for SaCoS secure and protected against access by third parties.

4.1.1.5 Secure use of the ExG-MM in the DLC+

It is the customer's responsibility to use the ExG-MM securely in accordance with the guidelines in the operating instructions.

4.1.1.6 Securing Z1:Control(Customer)

Z_{1:Control(Customer)} must be a trusted network in the sense of IACS UR E27.

A compromised SaCoS can also pose a threat to customer networks and devices, and infect or compromise the customer systems within them. The operator/integrator can implement additional measures such as installing additional network security devices to protect against this threat.

4.1.1.7 Maintaining network segmentation

Network segmentation is one of SaCoS's key protection measures. Therefore, the network structure set up by Everllence must not be changed.

Specifically, the following guidelines should be adhered to:

- Individual network segments must not be bridged (e.g. by connecting a device to several segments at the same time, connecting network switches from different segments to each other, or connecting devices from one segment to other segments).
- No additional devices may be connected to the SaCoS network segments.
- The physical switches on the DLC+ that enable and disable the remote network connection of Everllence service staff to the ExG-MM for remote maintenance (designation on the cabinet), as well as the ExG-MM network access to the GCM and DM (designation on the cabinet) for parameterisation, must normally be in the "disabled" position. Access should only be activated temporarily, only when required, only by authorised staff, and should be switched off again as soon as possible after completion of the work. Remote access (remote) to ExG-MM may only be enabled upon explicit and authenticated request from Everllence. Only those physical switches that are necessary for the functionality or activity actually required should be activated.

4.1.1.8 Preparation for security incidents

Residual risks may remain even if the present guidelines are followed. The customer should prepare for possible security incidents in order to be able to react to them quickly. This includes the creation of an *incident response plan*, which should address the following points, among others:

- Obtain spare parts to replace SaCoS modules that have failed or been compromised due to an attack.
- If changes are made to the system (e.g. parameterisation of the system), these changes should be saved accordingly.
- Report the security incident to Everllence via a secure channel and follow the instructions.
- Save all data relevant to the cause (may require assistance from the engine manufacturer's 1st level support). This includes, but is not limited to, the access logs and general audit logs generated by the customer, customer devices, and the plant.
- Analyse the data and take steps to address the vulnerability that led to the incident.

The customer is also instructed to monitor the system for indications of a possible security incident to the extent possible.

4.1.1.9 Safe disposal

The customer is responsible for the security of potentially sensitive data when disposing of the devices.


4.1.1.10 User account management

The operator and service personnel are responsible for managing the access data for SaCoS devices.

4.1.1.11 Security Incident Report

The security incidents concerning SaCoS should be reported to Everllence PrimeServ.

4.1.2 Equipment on engine and off engine

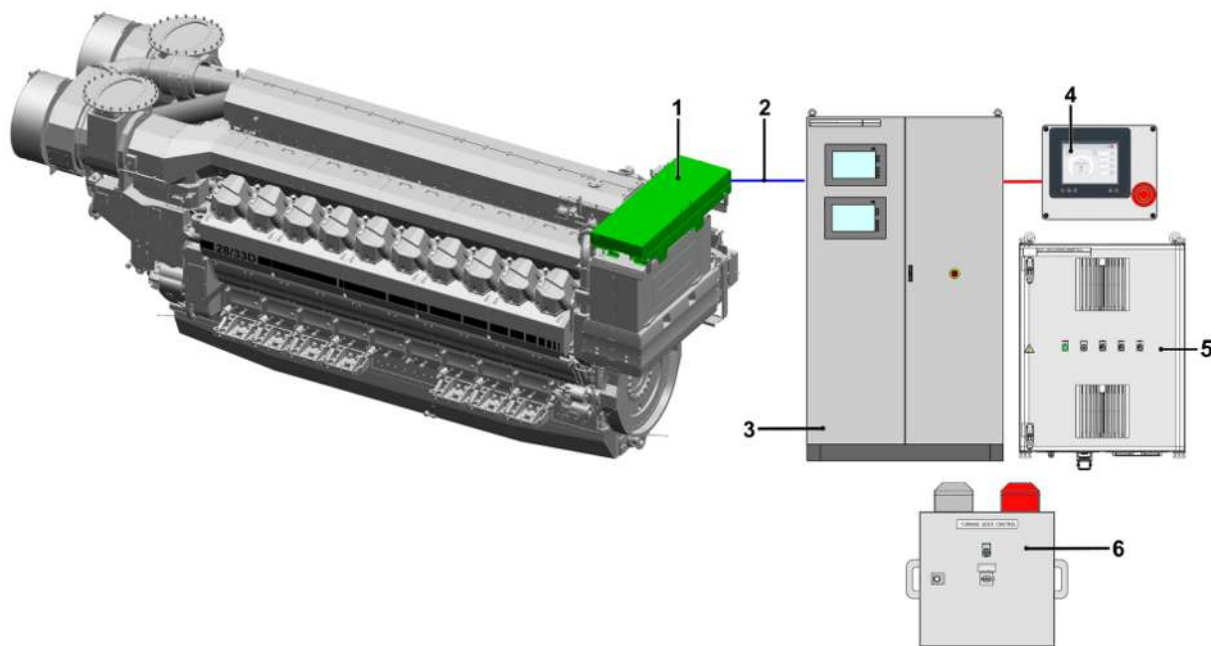

- | | |
|---|--|
| <p>1 Control Unit</p> <p>2 System bus</p> <p>3 Interface Cabinet with integrated Local Operating Panel</p> <p>4 ROP/WOP, optional</p> | <p>5 Data Logging Cabinet (example view), for more information, see chapter Data Logging Solutions, Page 125</p> <p>6 Turning Gear Cabinet</p> <p>7 Power Supply Cabinet, optional (not shown)</p> |
|---|--|

Figure 50: System Overview

Control Unit

The Control Unit is mounted on the engine cushioned against vibration.

It includes two identical, highly integrated Control Modules: One for safety functions and the other for engine control and alarming. The modules work independently of each other and collect engine measuring data by means of separate sensors.

The Control Unit also includes a highly integrated Injection Module, which is responsible for speed control and rail injection.



The Interface Cabinet is a floor-standing cabinet that optionally will be equipped with an air condition. The Interface Cabinet represents the communication interface between SaCoS 5000, the respective master system control and the engine room automation. For this purpose, the Interface Cabinet features a Gateway Communication Module with input and output channels as well as various interfaces like an interface to the Digital Services, Data Logging Cabinet and Remote Operating Panel.

If necessary, the Interface Cabinet houses the power units of the loads attached to the engine (such as starters for pumps, etc., depending upon engine type).



Figure 53: Gateway Communication Module

The 400 V AC - if necessary - is fed into the Interface Cabinet and has to be provided for each Interface Cabinet separately by the customer.

The 230 V AC supply voltage for cabinet lighting/cabinet heating/cabinet ventilation and cabinet air conditioning is fed into the Interface Cabinet and has to be provided for each Interface Cabinet separately by the customer or the Power Supply Cabinet (optional).

The 24 V DC power supply is ensured via the customer or via the Power Supply Cabinet (optional).

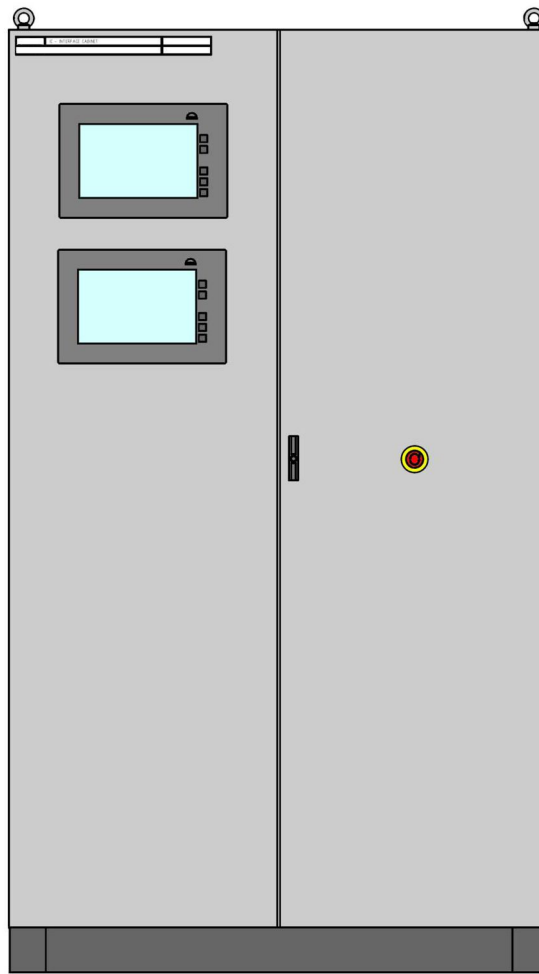


Figure 54: Interface Cabinet

The Interface Cabinet is equipped with a display module, optionally with two display modules. The display module enables complete control of the engine. The interface cabinet is fitted with an additional emergency stop button for manual emergency stops.



Figure 55: Display Module

Remote Operating Panel/Wheelhouse Operating Panel (optional)

The Remote Operating Panel/Wheelhouse Operating Panel serves for engine operation from a control room. The Remote Operating Panel/Wheelhouse Operating Panel has the same functions as the Local Operating Panel.

The ROP/WOP is also equipped with an emergency stop button and a buzzer. In addition, the WOP is equipped with an override button.

From this operating device it is possible to transfer the engine operation functions to a superordinated automation system.

The panel can be delivered as loose supply for installation in the control room desk.

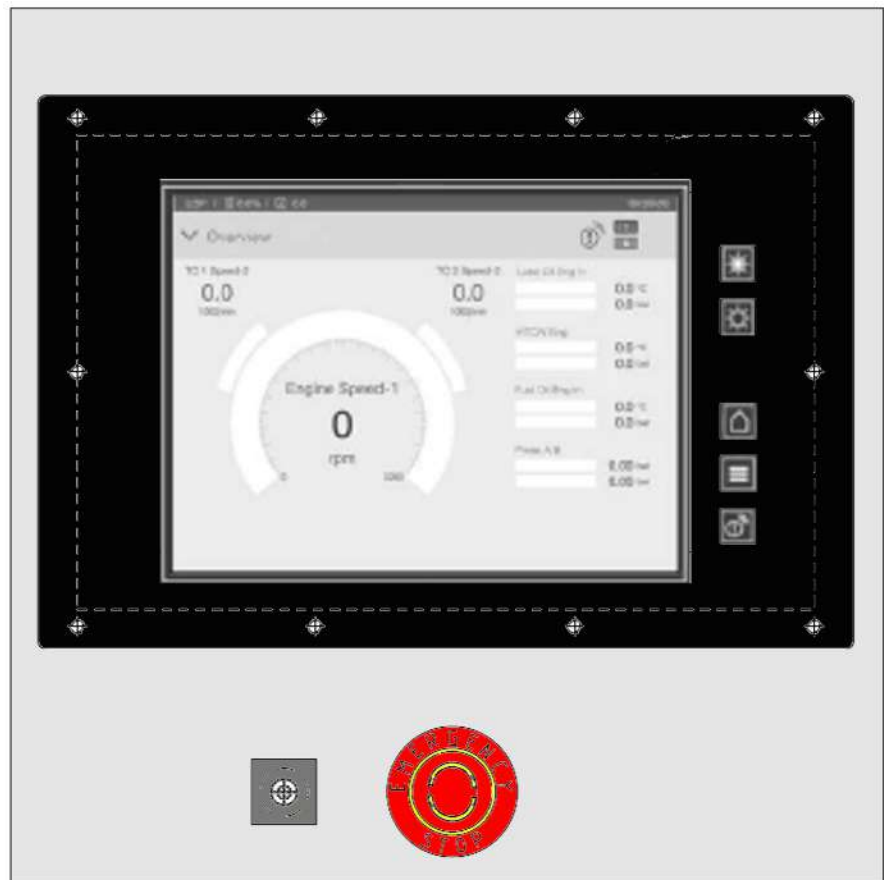


Figure 56: Remote Operating Panel

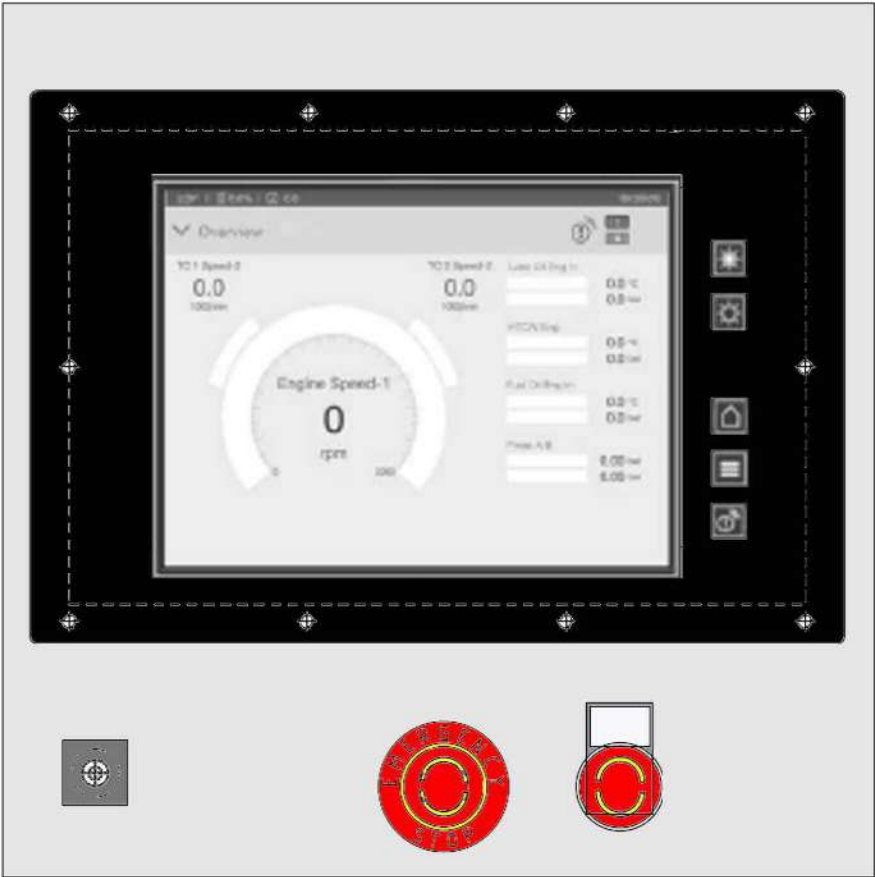


Figure 57: Wheelhouse Operating Panel

Turning Gear Control

The mobile Turning Gear Control contains the control system for turning operation.

The 230 VAC (optional 115 VAC) power supply is fed in via the Interface Cabinet.

The TGC is hard-wired to the Control and Injection Unit.

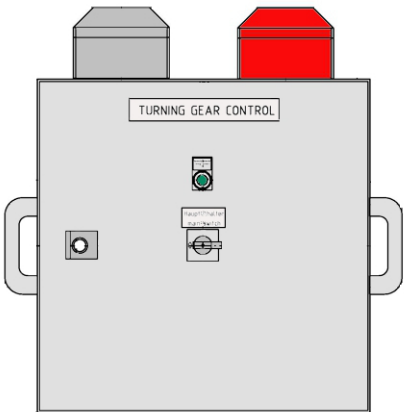


Figure 58: Turning Gear Control

2026-02-24 - 6.2

Power Supply Cabinet (optional)

For the 24 V DC power supply Everllence offers a Power Supply Cabinet with uninterrupted power supply or without uninterrupted power supply.



Figure 59: Power Supply Cabinet

4.2 Power supply and distribution

The plant has to provide electric power for SaCoS 5000. An uninterrupted 24 V DC power supply is required for SaCoS 5000.

For marine main engines, a redundant power supply is required which must be provided by two individual supply networks:

- At least one of the power supplies must be uninterruptable (UPS).
- Both feeds must be decoupled from each other (e.g. with power diodes or MOSFETs) in the positive line so that they cannot interfere with each other.
- The minus conductors must be connected to each other to prevent voltage doubling in the event of a double earth fault (see DIN EN 50156-1).

If the Power Supply Cabinet from Everllence is used, the Power Supply Cabinet will handle this requirements.

According to classification requirements it must be designed to guarantee the power supply to the connected systems for a sufficiently long period if both supply networks fail.

For the power supply Everllence offers a Power Supply Cabinet with uninterrupted power supply or without uninterrupted power supply.

If the Power Supply Cabinet is not used, the customer's infed must take over the tasks of the Power Supply Cabinet. The following must also be noted:

- The back-up fuses specified in the circuit diagram must be provided for the SaCoS 5000 components (nominal current and tripping characteristics must be observed).
- The short-circuit breaking capacity of the back-up fuses must be sufficiently large.

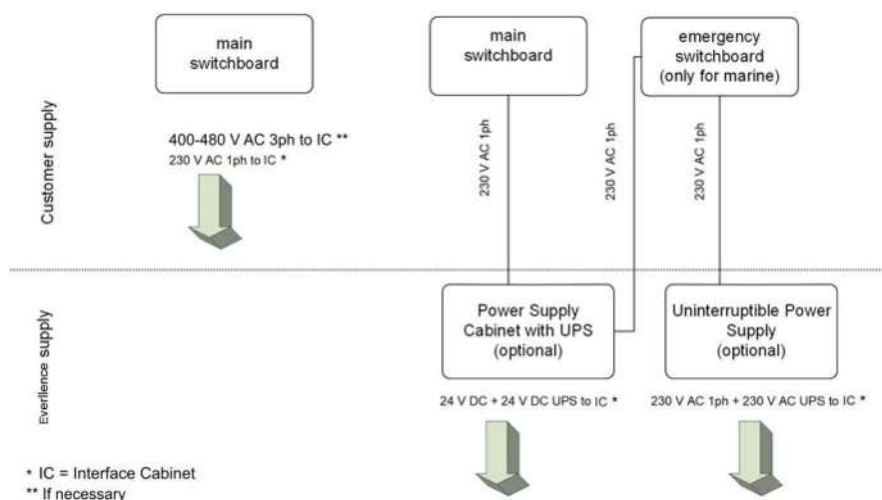


Figure 60: Supply diagram with Power Supply Cabinet and UPS

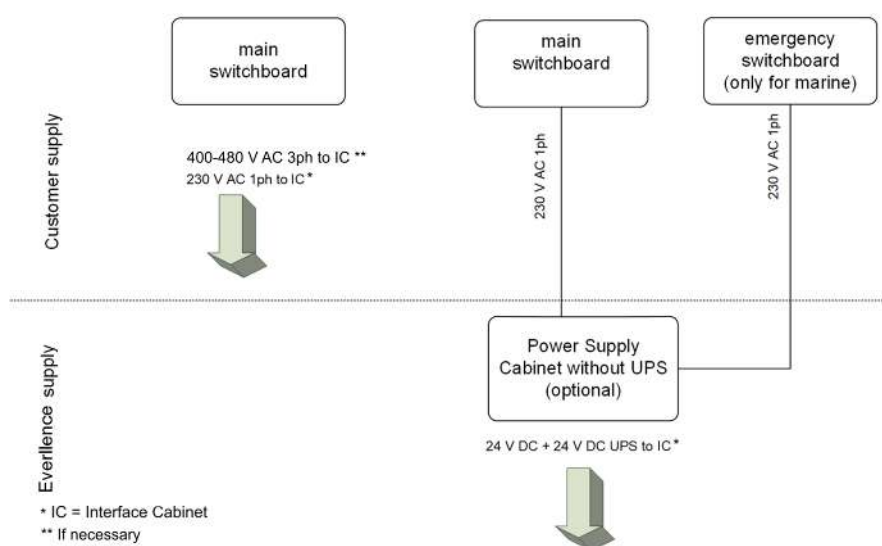


Figure 61: Supply diagram with Power Supply Cabinet

Required power supplies

Consumer	Voltage	Notes
Interface Cabinet	230 V 50/60 Hz	Light/socket, cooling device, heater
	24 V DC	All SaCoS components in the Interface Cabinet and on the engine
	400–480 V 50/60 Hz *	Power supply for consumers on engine

Table 89: Required power supplies

* If necessary.

For the Data Logging Cabinet, see chapter [Data Logging Solutions, Page 125](#).

Galvanic isolation

A fault in an IT mains (see IEC 60364-1) affects the entire galvanic island formed by the IT network. If different engines are fed from galvanically connected power supplies, then a fault in one of the engines can also affect all other engines. It is therefore the subject of the system risk assessment to determine whether engines may be galvanically connected to each other. It is strongly recommended not to supply multiple engines from galvanically connected power supplies in order to limit the impact of errors and facilitate troubleshooting. For the same reason, the power supplies of the engines must be galvanically isolated from the power supplies for other parts of the system.

4.3 Operation**Control station changeover**

The operation and control can be done from both operating panels. Selection and activation of the control stations is possible at the Local Operating Panel. On the displays, all the measuring points acquired by means of SaCoS 5000 can be shown in clearly arranged drawings and figures. It is not necessary to install additional speed indicators separately.

The operating rights can be handed over from the Remote Operating Panel to another Remote Operating Panel or to an external automatic system. Therefore a handshake is necessary.

For applications with Integrated Automation Systems (IAS) also the functionality of the Remote Operating Panel can be taken over by the IAS.

Operating modes

For alternator applications:

- Droop (5-percent speed increase between nominal load and no load)

For propulsion engines:

- Isochronous
- Master/Slave Operation for operation of two engines on one gear box

The operating mode is pre-selected via the SaCoS interface and has to be defined during the application period.

Details regarding special operating modes on request.

Speed setting

The speed setting can be done either by means of binary contacts (e.g. for synchronisation) or by an active 4 – 20 mA analogue signal alternatively. The signal type for this is to be defined in the project planning period.

4.4 Functionality

Safety functions

The safety system monitors all operating data of the engine and initiates safety actions, e.g. load reduction request or engine shutdown, in case any limit values are exceeded.

Safety stop category	Properties	To external	
Manual Emergency Stop <i>ManEmStop</i>	• Source: Manually • Safety Chain: Hard- and Soft-wired • Processing: Redundant • Override-able: No • EmStop Actuators: all	Man	Em Stop
Internal Automatic Emergency Stop <i>IntAutoEmStop</i>	• Source: Automatically • Safety Chain: Hardwired • Processing: Redundant • Override-able: No • EmStop Actuators: all	SaCoS Safety Stop*	Overall Safety Stop*
Internal Automatic Shutdown <i>IntAutoSD</i>	• Source: Automatically • Safety Chain: Cloud-based • Processing: Single or redundant • Override-able: Yes • EmStop Actuators: Individually		
External Emergency Stop <i>ExtEmStop</i>	• Source: Unknown • Safety Chain: Hard- and Soft-wired • Override-able: No • Processing: Redundant • EmStop Actuators: all		
External Automatic Shutdown <i>ExtAutoSD</i>	• Source: Unknown • Safety Chain: Cloud-based • Override-able: Yes • Processing: Redundant • EmStop Actuators: Individually		

Figure 62: Safety Functions

Note:

The automatic emergency stop and automatic shutdown may have impact on the function of the plant. These effects can differ widely depending on the overall design of plant and must already be considered in an early phase of the project planning.

Note:

A manual emergency stop stops the engine, but does not affect the interface signals requesting the auxiliary units. During the integration, the respective integrator must determine how the system reacts.

Load reduction

The safety system supervises requests a load reduction to 60%. The load reduction has to be carried out by an external system (PMS, PCS, etc.). For safety reasons, SaCoS 5000 will not reduce the load by itself. The load reduction can be also requested via an external system.

Override

With the Override switch on the bridge or in the engine control room, the safety system function can be restricted to the issuing of alarms and messages. With the Override active, the engine is not automatically shutdown by the safety system and neither a load reduction will occur.

Exceptions are:

- Manual emergency stop
- Internal automatic emergency stop
- External emergency stop

Further exceptions depend on the specifications of the respective classification society.

Alarm functions

The alarm functions supervise all necessary limit values and generate alarms to indicate discrepancies. The alarm functions are processed in an area completely independent of the safety system area in all redundant modules.

Self-monitoring

SaCoS 5000 carries out independent self-monitoring functions. Thus, for example the connected sensors are checked constantly for function and wire break. SaCoS 5000 reports all occurred malfunctions via alarm messages.

Speed control

The engine speed control is realised by software functions of the Injection Control Module. Engine speed and crankshaft turn angle indication is carried out by means of redundant pick ups at the camshaft.

Load limit curves

SaCoS 5000 features the following load limit curves:

- Start fuel limiter
- Maximum fuel limiter
- Charge air pressure dependent fuel limiter
- Torque limiter
- Rail pressure limiter
- Jump-rate limiter

Shutdown

The engine shutdown, initiated by safety functions and manual emergency stops, is carried out by redundant fast closing valves of the gas valve unit and independent interrupt of power supply of gas admission valves.

Note:

The engine shutdown may have impact on the function of the plant. These effects can be very diverse depending on the overall design of the plant and must already be considered in early phase of the project planning.

Overspeed protection

The engine speed is monitored independently from each other in the alarm system and safety system. In case engine overspeed is detected each system actuates the shutdown device via a separate hardware channel.

Control

SaCoS 5000 controls all engine-internal functions as well as external components in the plant.

Start/stop sequence	SaCoS 5000 controls all steps of the start/stop sequence: ▪ Slow turn ▪ Start air/stop air pressure monitoring ▪ Requests of lube oil and cooling water pumps ▪ Monitoring of the prelubrication and post-cooling period ▪ Monitoring of the acceleration period
Control station switch-over	SaCoS 5000 controls the switch-over between the different operating panels and the switch-over to an external control system.
External functions	The scope of control functions depends on the plant configuration and must be coordinated during the project engineering phase. These control functions may cover: ▪ Electrical lube oil pump ▪ Electrical driven HT cooling water pump ▪ Electrical driven LT cooling water pump ▪ Nozzle cooling water module ▪ HT preheating unit ▪ Clutches

Media temperature control

Various media flows must be controlled to ensure trouble-free engine operation.

The temperature controllers are available as software functions. The temperature controllers are operated by the displays at the operating panels as far as it is necessary.

The cylinder cooling water (HT) temperature control is equipped with performance-related feed forward control, in order to guarantee the best control accuracy possible (refer also to section [Cooling water systems, Page 214](#)).

- The design of the lube oil temperature control depends on the engine type. It is designed either as a thermostatic valve (waxcartridge type) or as an electric driven control valve with electronic control similar to the HT temperature controller. Refer also to section [External lube oil system, Page 205](#).

4.5 Interfaces

Data bus interface (machinery alarm system)

This interface serves for data exchange to the ship alarm system. The interface is actuated with MODBUS protocol and is available as:

- Ethernet interface (MODBUS over TCP (Transmission Control Protocol))

The status messages, alarms and safety actions, which are generated in the system, can be transferred to the ship alarm system. All measuring values acquired by SaCoS are available for transfer.

Power Management System

Hardwired interface, for remote start/stop, load setting, etc.

Propulsion Optimization Interface

Standardised hardwired interface including all signals for control and safety actions between SaCoS 5000 and the propulsion control system.

This includes the following signals:

- Overload
- Operation close to the limit curve
- Propeller pitch reduction
- Engine speed
- Engine torque
- Distance to active limiter
- Derating factor (for DF engines)

This signals allow an optimized data exchange between engine and a smooth and look ahead control of the CCP propulsion system.

Clarify details at early stage of project.

Others

In addition, interfaces to auxiliary systems are available, such as:

- Nozzle cooling water module
- HT preheating unit
- Electric driven pump for lube oil
- Clutches
- Gearbox

4.6 Technical data

Design

Cabinet

- Floor-standing cabinets with plinth and fan/air condition
- Cable entries: From below, through cabinet base
- Accessible by front door(s), doors with locks
- Opening angle: 90°
- Standard colour: Light grey (RAL7035)
- Ingress protection: IP54

Dimensions and weights of cabinets

Cabinet	Dimensions (mm) including base			Approx. weight (kg)
	Width	Height	Depth	
Interface Cabinet, equipped with fan	1,200	2,100	400	300
Interface Cabinet, equipped with air condition	1,550	2,100	400	360
Power Supply Cabinet, equipped with fan	600	2,100	400	300
Power Supply Cabinet, equipped with air condition	950	2,100	400	360
Data Logging Cabinet	See chapter Data Logging Solutions, Page 125			

Cabinet	Dimensions (mm) including base			Approx. weight (kg)
	Width	Height	Depth	
Turning Gear Cabinet	460	460	210	20
Remote Operating Panel	400	400	-	5
Wheelhouse Operating Panel	400	400	-	5

Table 90: Dimensions and weights of cabinets

Door opening area of cabinets

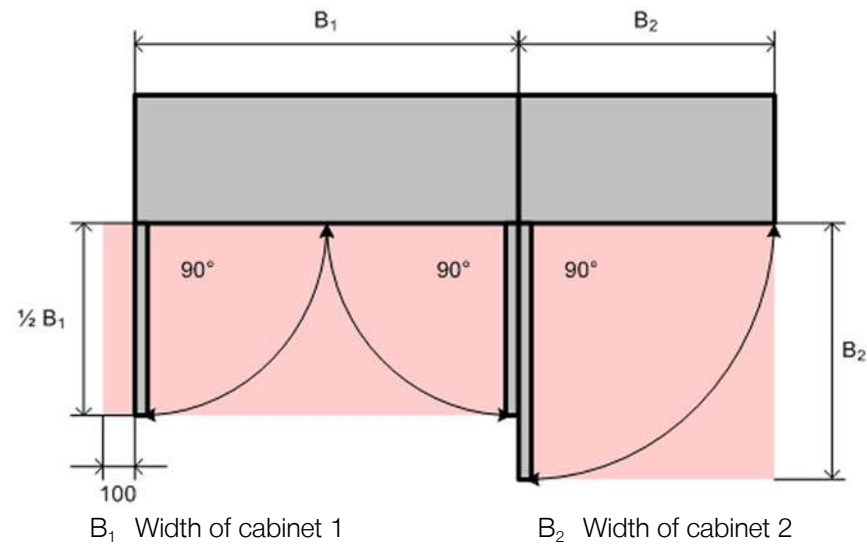


Figure 63: Exemplary arrangement of control cabinets with door opening areas (top view)

Environmental conditions

Components on engine and wall-mounted cabinets

- Ambient air temperature: +5 °C to +55 °C
 - Exception: an ambient air temperature of +5 °C to +45 °C applies to the SCR Cabinet, Gas Valve Unit Cabinet and Fuel Valve Train Cabinet
 - Exception: ambient air temperature Data Logging Cabinet, see chapter [Data Logging Solutions, Page 125](#)

- Relative humidity: < 96 %
- Vibrations: < 0.7 g

Floor-standing cabinets

- Ambient air temperature:
 - 0 °C to +45 °C: Floor-standing cabinets will be equipped with a fan
 - Over +45 °C: Floor-standing cabinets will be mandatory equipped with an air condition
- Relative humidity: < 96 %
- Vibrations: < 0.7 g

4.7 Installation requirements

Location

- The cabinets are designed for installation in engine rooms or engine control rooms.
- The cabinets must be installed at a location suitable for service inspection.
- Do not install the cabinets close to heat-generating devices.

Wall-mounted cabinets and floor-standing cabinets

The cabinet must be installed at a location suitable for service inspection.

Do not install the cabinet close to heat-generating devices.

Floor-standing cabinets

In case of installation at walls, the distance between the floor-standing cabinet and the wall has to be at least 100 mm to allow air convection.

The foundation at the installation site must be solid enough to withstand the weight of the floor-standing cabinets.

All floor-standing cabinets have to be fixed to the floor. Also they have to be secured against tipping over (for example, by attaching the roof to the wall) with suitable mounting support, proven to withstand at minimum the maximum allowed inclination, see accordingly section Engine inclination.

Note:

If the restrictions for ambient temperature cannot be kept, the floor-standing cabinet must be ordered with an optional air condition system.

Ambient air conditions

For restrictions of ambient conditions, refer to the section [Technical data, Page 148](#).

Cabling

The interconnection cables between the engine and the cabinets have to be installed according to the rules of electromagnetic compatibility. Control cables and power cables have to be routed in separate cable ducts.

Cabling

- The interconnection cables between the engine and cabinets have to be installed according to the rules of electromagnetic compatibility (for example, IEC 60446). Control cables and power cables have to be routed in separate cable ducts.
- The cables for the connection of sensors and actuators which are **not mounted on the engine** are not included in the scope of supply of Everllence. Shielded cables have to be used for the cabling of sensors. For electrical noise protection, an electric ground connection must be made from the cabinets to the ship's hull.
- All cabling between the cabinets and the controlled device is scope of customer supply.
- The cabinets are equipped with spring loaded terminal clamps. All wiring to external systems should be carried out without conductor sleeves.
- The redundant CAN cables are Everllence scope of supply.

Maximum cable lengths

Connection	Max. cable length
Cables between engine and Interface Cabinet	≤ 45 m
MODBUS cable between Interface Cabinet and superordinate automation system (only for Ethernet)	≤ 100 m
Cable between Interface Cabinet and Remote Operating Panel	≤ 100 m

Installation works

- During the installation period, the customer has to protect the cabinets against water, dust, and fire. It is not permissible to do any welding near the cabinets. The cabinets to be fixed to the floor by screws.
- If it is inevitable to do welding near the cabinets, the cabinets and panels have to be protected against heat, electric current, and electromagnetic influences. To guarantee protection against current, the cabling must be disconnected from the affected components.

- The installation of other components inside the cabinets is only permissible after approval by the responsible project manager of Everllence.

Sensors

The sensor 1TE3165 “HTCW Temp After Mixing Point” (double PT1000) measures the HT-CW temperature after the mixing point.

The sensor 1TE4165 “LTCW Temp After Control Valve” (double PT000) measures the LT-CW temperature after the control valve.

The sensor 1TE6000 “Ambient Air Temp” (double PT1000) measures the temperature of the (outdoor) ambient air. The temperature of the ambient air will typically differ from that in the engine room.

Installation of sensor 1TE6000 „Ambient Air Temp”

The sensor may be installed in the ventilation duct of the fan blowing the (outdoor) ambient air into the engine room. Ensure to keep the sensor away from the influence of heat sources or radiation. The image below shows two options of installing the sensors correctly:

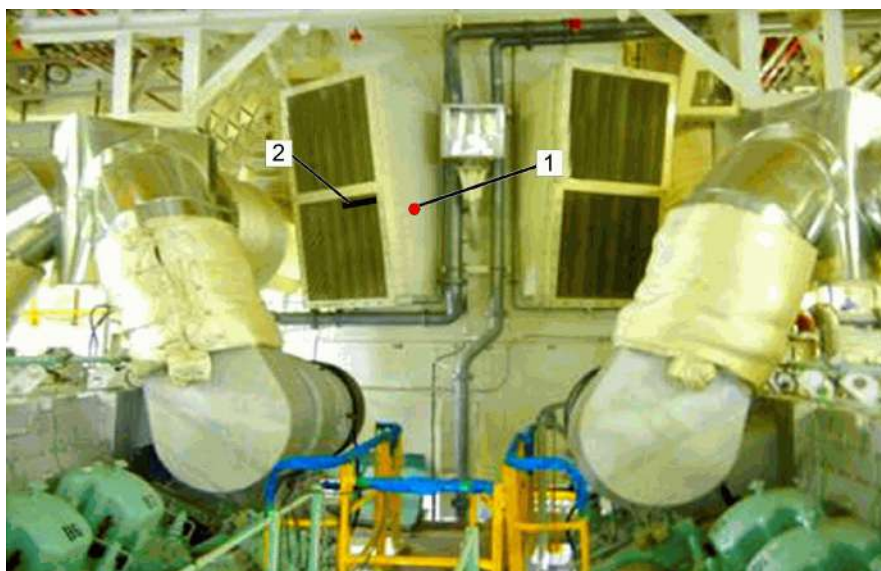


Figure 64: Possible locations for installing the sensor 1TE6000

1	Hole drilled into the duct of the engine room ventilation. Sensor measuring the temperature of the air-stream.	2	Self-designed holder in front of the duct.
---	--	---	--

Note:

The sensor 1TE6100 “Intake Air Temp” is not suitable for this purpose.

4.8 Engine-located measuring and control devices

Exemplary list for project planning

No.	Measuring point	Description	Function	Measuring Range	Location	Connected to	Depending on option
Temperature control							

No.	Measuring point	Description	Function	Measuring Range	Location	Connected to	Depending on option
1	1TE0003	temp sensor interface cabinet internal temp.	Indication	0-120 °C	Interface Cabinet	-	-
Speed pickups							
1	1SE1004A/B ¹⁾	speed pickup TC A/B speed-1	indication, supervision	0–30,000 rpm/ 0–1,000 Hz (16V) 0–40,000 rpm/ 0–1,333 Hz (20V)	turbocharger	Control Module/ Safety	-
2	2SE1004A/B ¹⁾	speed pickup TC A/B speed-2	indication, supervision	0–30,000 rpm/ 0–1,000 Hz (16V) 0–40,000 rpm/ 0–1,333 Hz (20V)	turbocharger	Control Module/ Safety	-
3	1SE1005	speed pickup engine speed-1	camshaft speed and position	0–1,200 rpm/ 0–2,000 Hz	camshaft drive wheel	Control Module/ Alarm	-
4	2SE1005	speed pickup engine speed-2	camshaft speed and position	0–1,200 rpm/ 0–2,000 Hz	camshaft drive wheel	Control Module/ Safety	-
Start and stop of engine							
1	1SSV1011	solenoid valve engine start valve	actuated during engine start and slowturn	-	engine	Control Module/ Alarm	-
Charge air bypass							
1	1XCV1030	control valve charge air engine bypass flap	blow by while part-load or low speed	-	engine	Control Module/ Alarm	charge air bypass
Charge air blow-off							
1	1XSV1031	solenoid valve charge air blow off flap	charge air blow off at low intake air temp	-	engine	Control Module/ Alarm	charge air blow off
Main bearings							

No.	Measuring point	Description	Function	Measuring Range	Location	Connected to	Depending on option
1	1TE1064-x	double temp sensors main bearing 1 temp.-x	indication, alarm, engine protection	0–150 °C	engine	Control Modules	main bearing temp monitoring
2	xTE1064-x	double temp sensors main bearing x temp.-x	indication, alarm, engine protection	0–120 °C	engine	Control Modules	main bearing temp monitoring
3	xTE1066-x	double temp sensors engine PTO shaft bearing temp.-x	indication, alarm, engine protection	0–150 °C	engine	Control Modules	main bearing temp monitoring
Turning gear							
1	1GOS1070	limit switch turning gear engaged	indication and start blocking	-	engine	Control Module/ Alarm	-
2	1GOS1071	limit switch motor of turning gear engaged	indication and start blocking	-	engine	Control Module/ Alarm	-
Lube oil system							
1	1TE2160-x	double temp sensors lube oil temp. lube oil cooler inlet-x	indication	0–120 °C	engine	Control Modules	-
2	1PT2165	pressure transmitter lube oil pressure filter inlet	-	0–10 bar	engine	Control Module/ Alarm	-
3	1TE2170-x	double temp sensors lube oil temp engine inlet-x	alarm at high temp	0–120 °C	engine	Control Modules	-
4	1PT2170	pressure transmitter lube oil pressure engine inlet-1	alarm at low lube oil pressure	0–10 bar	engine	Control Module/ Alarm	-
5	2PT2170	pressure transmitter lube oil pressure engine inlet-2	auto shut-down at low pressure	0–10 bar	engine	Control Module/ Safety	-
6	1PT2570A/B ¹⁾	pressure transmitter lube oil pressure TC A/B inlet-1	alarm at low lube oil pressure	0–6 bar	engine	Control Module/ Alarm	-
7	2PT2570A/B ¹⁾	pressure transmitter lube oil pressure TC A/B inlet-2	auto shut-down at low lube oil pressure	0–6 bar	engine	Control Module/ Safety	-
8	1TE2580A/B ¹⁾ -x	double temp sensors lube oil temp TC A/B outlet-x	alarm at high temp	0–120 °C	engine	Control Modules	-

No.	Measuring point	Description	Function	Measuring Range	Location	Connected to	Depending on option
Crankcase pressure							
1	1PT2800	pressure transmitter crankcase pressure-1	input for alarm system	– 20-20 mbar	engine	Control Module/ Alarm	-
2	2PT2800	pressure transmitter crankcase pressure-2	input for safety system	– 20-20 mbar	engine	Control Module/ Safety	-
3	3PT2810	lube oil pressure oil pan	oil level monitoring	0-100 mbar	IC	ERA	-
4	5PT2810	lube oil pressure oil pan	oil level monitoring	0-100 mbar	IC	ERA	-
Splash oil							
1	xTE2880-x	double temp sensors splash oil temp compt. x(-x)	splash oil supervision	0–120 °C	engine	Control Modules	-
Gearbox							
1	2TE2970	temp sensor gear lube oil temp.	gearbox supervision	0-150 °C	gearbox	-	-
2	1PS2970	pressure switch gear lube oil press. low	gearbox supervision	-1-1 bar	gearbox	-	-
3	2PS2970	pressure switch gear lube oil press. low low	gearbox supervision	-1-1 bar	gearbox	-	-
4	3PS2970	pressure switch gear lube oil press. sufficient	gearbox supervision	-1-10 bar	gearbox	-	-
5	1SE2971	speed pickup gear pinion shaft speed-1	gearbox supervision	-	gearbox	-	-
6	2SE2971	speed pickup gear pinion shaft speed-2	gearbox supervision	-	gearbox	-	-
7	2TE2980	temp sensor gear thrust bearing temp.	gearbox supervision	0-150 °C	gearbox	-	-
Cooling water systems							
1	1TE3170-x	double temp sensors HTCW temp. cyl. cooling inlet-x	alarm, indication	0–120 °C	engine	Control Modules	-
2	1PT3170	pressure transmitter HTCW press. cyl. cooling inlet-1	alarm at low pressure	0–10 bar	engine	Control Module/ Alarm	-

No.	Measuring point	Description	Function	Measuring Range	Location	Connected to	Depending on option
3	2PT3170	pressure transmitter HTCW press. cyl. cooling inlet-2	detection of low cooling water pres- sure	0–10 bar	engine	Control Module/ Alarm	-
4	1TE3180A/B ¹⁾ - x	double temp sensors HTCW temp. cyl. cooling outlet row A/ B-x	-	0–120 °C	engine	Control Modules	-
5	1TE3190-x	double temp sensors HTCW temp. last charge air cooler out- let-x	-	0–120 °C	engine	Control Modules	-
6	1PT4120	pressure transmitter seawater pressure pump outlet	-	0–10 bar	engine	Control Module/ Alarm	-
7	1TE4170-x	double temp sensors LTCW temp. charge air cooler inlet-x	alarm, in- dication	0–120 °C	LT pipe charge air cooler inlet	Control Modules	-
8	1PT4170	pressure transmitter LTCW pressure charge air cooler in- let-1	alarm at low cooling water pres- sure	0–10 bar	engine	Control Module/ Alarm	-
9	2PT4170	pressure transmitter LTCW pressure charge air cooler in- let-2	alarm at low cooling water pres- sure	0–10 bar	engine	Control Unit	-
10	1TE4180-x	double temp sensors LTCW temp. charge air cooler outlet-x	-	0–120 °C	engine	Control Module/ Alarm	-
11	1TE4185-x	double temp sensors LTCW temp. lube oil cooler outlet-x	-	0–120 °C	engine	Control Module/ Alarm	-
Fuel system							
1	1TE5070-x	double temp sensors fuel oil temp engine inlet-x	alarm at high temp in MDO- mode and for EDS use	0–120 °C	engine	Control Modules	-
2	1PT5070	pressure transmitter fuel oil pressure en- gine inlet-1	remote in- dication and alarm	0–16 bar	engine	Control Module/ Alarm	-
3	2PT5070	pressure transmitter fuel oil pressure en- gine inlet-2	remote in- dication and alarm	0–16 bar	engine	Control Module/ Safety	-

No.	Measuring point	Description	Function	Measuring Range	Location	Connected to	Depending on option
4	xFSV5078A/B ¹⁾	injection valve fuel oil injection cylinder A/B-x	fuel injection	-	engine	Injection Module 1/2	-
5	1LS5080	level switch fuel oil injector and pump leakage	alarm at high level	-	-	Control Module/Alarm	-
Charge air system							
1	1TE6100A/B ¹⁾ -x	double temp sensors intake air temp. row A/B-x	-	-50–80 °C	intake air duct after filter	Control Module/Alarm	-
2	1TE6170A/B ¹⁾	double temp sensors charge air temp cooler A/B inlet	for EDS visualisation	0–300 °C	engine	Control Modules	-
3	1PT6170A/B ¹⁾	pressure transmitter charge air pressure cooler A/B-1	STC control	0–4 bar	engine	Control Modules	STC
4	2PT6170A/B ¹⁾	pressure transmitter charge air pressure cooler A/B-2	STC control	0–4 bar	engine	Control Modules	STC
5	1FSV6171A-x	solenoid valve charge air switch-over for STC	bistabile 5/2-way valve to cut off CA pipe of TC A for STC	-	engine	Control Module/Alarm	STC
6	1TE6180-x	double temp sensors charge air temp engine inlet-x	alarm at high temp	0–120 °C	engine	Control Modules	-
7	1PT6180	pressure transmitter charge air pressure engine inlet-1	engine control	0–4 bar	engine	Control Module/Alarm	-
8	2PT6180	pressure transmitter charge air pressure engine inlet-2	-	0–4 bar	engine	Control Module/Safety	-
Exhaust gas system							
1	xTE6570A/B ¹⁾ -x	double thermocouples exhaust gas temp cylinders A/Bx outlet-x	indication, alarm, engine protection	0–800 °C	engine	Control Modules	-
2	1XCV6570	variable flap waste gate	-	-	-	-	-

No.	Measuring point	Description	Function	Measuring Range	Location	Connected to	Depending on option
3	1FSV6571A-x	solenoid valve exhaust gas switch-over for STC	bistabile 5/2-way valve to cut off exhaust pipe of TC A for STC	-	engine	Control Module/ Alarm	STC
4	1TE6575A/B ¹⁾ -x	double thermo-couples exhaust gas temp TC A/B inlet-x	indication, alarm, engine protection	0–800 °C	engine	Control Modules	-
5	1TE6580A/B	double temp sensor exhaust gas temp TC A/B outlet	indication	-	turbocharger	Control Modules	-
Control air, start air, stop air							
1	1PT7170	pressure transmitter start air pressure-1	engine control, remote indication	0–40 bar	engine	Control Module/ Alarm	-
2	2PT7170	pressure transmitter start air pressure-2	engine control, remote indication	0–40 bar	engine	Control Module/ Safety	-
3	1PT7400	pressure transmitter control air pressure-1	remote indication	0–10 bar	engine	Control Module/ Alarm	-

¹⁾ A-sensors: Installed on row A; B-sensors: Installed on row B.

Table 91: List of engine-located measuring and control devices

This page is intentionally left blank

5 Specification for engine supplies

5.1 Specification of lubricating oil for operation with DMA, DFA

General

The specific output achieved by modern diesel engines combined with the use of fuels that satisfy the quality requirements more and more frequently increase the demands on the performance of the lubricating oil which must therefore be carefully selected.

Doped lube oils (HD oils) have a proven track record as lubricants for the drive, cylinder, turbocharger, and for cooling the piston. Doped lube oils contain additives that among other things ensure dirt absorption capability, engine cleaning, and neutralisation of acidic combustion products.

Only lube oils that have been approved by Everllence may be used.

Specifications

Neutralization capacity	The neutralization capacity (DIN ISO 3771) must be so high that the acidic products produced during combustion are neutralized. The reaction time of the additives must be matched to the process in the combustion chamber. The base number (BN) should be at least 8.5 mg KOH/g with a fuel sulfur content of 0.2 % or less. At a fuel sulfur content between 0.2 and 1.5 %, the base number should be at least 12 mg KOH/g. The oil must be a SAE40 monograde oil in terms of its viscosity.
Lubricating oil additives	The use of other additives in conjunction with the lubricating oil or the mixing of different brands (oils from different manufacturers and different brands from the same manufacturer) is not permitted, as this can affect the performance of existing additives, which have been carefully matched to each other and have also been specially adapted to the base oil.
Military specification	The approved engine oils formally meet the requirements according to NATO O-278. Other oils with approval according to NATO O-278 may only be used after prior approval from Everllence. A monthly oil analysis by Everllence PrimeServ is also required.
Selection of lubricating oils/warranty	Most oil manufacturers have close and constant contacts with engine manufacturers and can therefore specify which oil from their own product line is approved by the engine manufacturer for the application. Regardless of this information, lubricating oil manufacturers are always liable for the quality and properties of their products. If you have any questions, we will be happy to provide you with further information. The list of the currently approved lubricating oils is available at Lubrication.
Oil during operation	The intervals between lubricating oil changes are determined by the ageing rate of the oil. The lubricating oil used must comply with the requirements stated in the table entitled Limit values for used engine oil.

Property	Unit	Limit value	Procedure
Viscosity at 40 °C	mm ² /s	100–190 (SAE 40) 80–190 (SAE 10W-40)	ISO 3104, ASTM D445, ASTM D 7042, DIN EN 16896
Viscosity at 100 °C		10.5–19.0 (SAE 40) 10.5–19.0 (SAE10W-40)	
Base number (BN)	%	At least 50 % of fresh oil - BN	ISO 3771
Flash point (PM)	°C	At least 170	ISO 2719
Water content	vol. %	Max. 0.20	DIN 51777, ASTM D6304
Soot content	% (m/m)	Max. 3.0	DIN 51452
Oxidation ¹⁾	A/cm	Max. 25	DIN 51453
Fuel dilution	% (m/m)	Max. 3.0	DIN 51454
Coolant additive	mg/kg	Free from	DIN 51399-1
TAN	mg KOH/g	+3.5 for fresh oil and BN > TAN	ASTM D664
Metal content (reference values) Iron, chrome, tin, copper, aluminium, lead	ppm	dependent on engine type and operating conditions max. 50 max. 10 max. 15 max. 20	ASTM D5185, DIN 51399-1

¹⁾ Only possible if there are no ester compounds and no ingress of biofuel.

Table 92: Limit values for engine oil to be used

A monthly analysis of lube oil samples is mandatory for safe engine operation. We can analyse samples for customers in the Everllence PrimeServLab.

Note:

If operating fluids are improperly handled, this can pose a danger to health, safety and the environment. The relevant safety information by the supplier of operating fluids must be observed.

5.2 Diesel fuel (DMA, DFA) specification

General information

Diesel fuel is a middle distillate refined from crude oil. It is also referred to as: gas oil, marine gas oil (DMA), DFA, diesel oil. It should not contain any residue from crude oil refining.

Selection of suitable fuel

Unsuitable or adulterated fuel generally results in a shortening of the service life of engine parts/components, damage to these and to catastrophic engine failure. It is therefore important to select the fuel with care in terms of its suitability for the engine and the intended application. Through its combustion, the fuel influences the emissions behaviour of the engine.

Specifications and approvals (DMA)

The fuel quality varies regionally and depends on climatic conditions. All requirements from ISO 8217:2024 apply

The following values must be maintained at the engine inlet:

Property	Unit		Limit value ¹⁾	Standard ²⁾
Appearance	-	-	Clear, bright and free from visible contamination	visual
Kinematic viscosity at 40° C ³⁾	mm ² /s	Max. Min.	6.0 2.0	ISO 3104, ASTM D7042, ASTM D445, DIN EN 16896
Density at 15°C	kg/m ³	Max. Min.	890.0 820.0	ISO 3675, ISO 12185
Water content	% (m/m)	Max.	0.02	DIN 51777, DIN EN 12937, ASTM D6304
Cetane number		Min.	40	EN ISO 5165, IP541, EN 15195, EN 16715, EN 17155
Sulphur content ⁴⁾	% (m/m)	Max.	1.0	ISO 8754, ISO 14596, ASTM D4294, DIN 51400-10
Flashpoint ⁵⁾	°C	Min.	60.0	ISO 2719
Acid number	mg KOH/g	Max.	0.5	ASTM D664
Carbon residue ⁶⁾	% (m/m)	Max.	0.30	ISO 10370
Ash content	% (m/m)	Max.	0.010	ISO 6245
Lubricity (WSD)	µm	Max.	520	ISO 12156-1, ASTM D6079
Corrosion effect on copper	Class	Max.	1	EN ISO 2160
Hydrogen sulphide	mg/kg	Max.	2.0	IP 570
FAME ⁷⁾ -content	% (V/V)	Max.	0.5	ASTM D7963, IP 579, DIN EN 14078
Oxidation stability	g/m ³	Max.	25	EN ISO 12205
Sediment content ⁸⁾	% (m/m)	Max.	0.01	ISO 10307-1
CFPP	°C		10°C below the lowest temperature in the fuel system	DIN EN 116, IP 309, IP 612
Pour Point ⁹⁾ winter grade	°C	Max.	-6	ISO 3016
Pour Point ⁹⁾ summer grade	°C	Max.	0	ISO 3016
Na, K, Ca, P, Cu, Zn, Si	mg/kg	Max.	free from	DIN EN 16476

Table 93: Requirements for diesel fuel (DMA)

Remarks:

¹⁾ The fuel must be suitable for the intended application. It must not contain any substance in a concentration that causes additional air pollution, is harmful for personnel, jeopardises ship safety and/or has an adverse effect on machine performance. The fuel must be free from non-ferrous metals according to DIN EN 16476. The fuel must not contain any waste oil.

²⁾ Always refer to the currently applicable edition.

³⁾ Specific requirements of the injection system must be taken into account

- ⁴⁾ Independent of the maximum permissible sulphur content, local laws and regulations must be adhered to
- ⁵⁾ Additional requirements (e.g. SOLAS) must be observed. Applicable laws must be adhered to.
- ⁶⁾ Determined at 10% distillation residue
- ⁷⁾ The FAME must either be in accordance with EN 14214 or with ASTM D6751 as well as with increased oxidation stability of at least 8 hours (EN 15751). For information on the use of fuels with more than 0.5% FAME see section [Diesel fuel \(DMA, DFA\) specification, Page 163](#)
- ⁸⁾ If the sample is not clear and bright, complete sedimentation through hot filtration and the determination of water content is required
- ⁹⁾ 10°C below the lowest temperature in the fuel system

The following fuels are approved for use if the fuel complies with table [Requirements for diesel fuel \(DMA\), Page 161](#):

- Classes ISO F-DMA & DMZ according to ISO 8217:2024
- Diesel fuel as per EN 590:2022 with additional requirement regarding flashpoint > 60 °C in SOLAS regulated areas
- Diesel fuel no. 2-D as per ASTM D975-21 with additional requirement regarding flashpoint > 60 °C in SOLAS regulated areas

Please submit enquiries to Everllence for all fuels which do not meet the abovementioned standards.

Viscosity

In order to ensure sufficient lubrication, a minimum level of viscosity must be ensured at the fuel injection pump. The specified maximum temperature required to maintain a viscosity of more than 1.9 mm²/s upstream of the fuel injection pump depends on the fuel viscosity. The temperature of the fuel upstream of the fuel injection pump must not exceed 45 °C in any case. The lubricity requirement for the fuel upstream of the engine is a maximum of 520 µm WSD in each case according to ISO 12156-1.

Military fuel specification

The fuels of type F-75 or F-76 as per NATO STANAG 1385 can be used if they fully comply with the standards or limit values listed in the table [Requirements for diesel fuel \(DMA\), Page 161](#) pursuant to ISO 8217:2024 and the minimum permissible viscosity upstream of the injection pump with the corresponding temperature is adhered to.

Synthetic fuels (DIN EN 15940)

When using synthetic fuels according to DIN EN 15940 with a density of less than 820 kg/m³ at 15 °C, prior consultation with Everllence is required.

Synthetic fuels such as HVO, BTL, CTL, GTL according to DIN EN 15940, can be produced from renewable electrical energy and CO₂ or from the same basic material such as FAME fuels (vegetable oil, cooking oil, animal fat) but in a completely different procedure. Synthetic fuels are produced by means of hydrogen treatment, with a fuel being generated which has a very similar chemical structure to high-performance diesel fuel and consists of paraffinic hydrocarbons. In contrast to fossil diesel fuel, synthetic fuel barely contains any aromatic components, which causes very good combustion properties.

Although the energy content (per mass unit) is higher in comparison with fossil diesel fuel, the volumetric energy content is lower due to the lower density (typically approx. 780 kg/m³ at 15°C). This may lead to deviations in the specified engine output, operating behaviour, load application and emissions as well as deviations in the specific fuel consumption.

The lubricity of synthetic fuels is relatively low. In order to meet fuel specifications (requirements on diesel fuel) and guarantee sufficient lubricity of the fuel, the fuel supplier needs to add a lubricity additive or FAME.

The lower flashpoint limit is too low at a minimum of 55°C. The additional requirement relating to flashpoint min. 60 °C in SOLAS regulated areas must be observed.

FAME (fatty acid methyl ester) additive of 0.5 to 100% (DFA)

The following values must be maintained at the engine inlet:

Property	Unit		Limit value ¹⁾	Standard ²⁾
Appearance	-	-	Clear, bright and free from visible contamination	visually
Kinematic viscosity at 40° C ³⁾	mm ² /s	Max. Min.	6.0 2.0	ISO 3104, ASTM D7042, ASTM D445, DIN EN 16896
Density at 15°C	kg/m ³	Max. Min.	890.0 820.0	ISO 3675, ISO 12185
Water content	% (m/m)	Max.	0.02	DIN 51777, DIN EN 12937, ASTM D6304
Cetane number		Min.	40	EN ISO 5165, IP541, EN 15195, EN 16715, EN 17155
Sulphur content ⁴⁾	% (m/m)	Max.	1.0	ISO 8754, ISO 14596, ASTM D4294, DIN 51400-10
Flashpoint ⁵⁾	°C	Min.	60.0	ISO 2719
Acid number	mg KOH/g	Max.	0.5	ASTM D664
Carbon residue ⁶⁾	% (m/m)	Max.	0.30	ISO 10370
Ash content	% (m/m)	Max.	0.010	ISO 6245
Lubricity (WSD)	µm	Max.	520	ISO 12156-1, ASTM D6079
Corrosion effect on copper	Class	Max.	1	EN ISO 2160
Hydrogen sulphide	mg/kg	Max.	2.0	IP 570
FAME ⁷⁾ -content	% (V/V)	Min.	0.5	ASTM D7963, IP 579, DIN EN 14078
Oxidation stability	h	Min.	8	EN 15751
Sediment content ⁸⁾	% (m/m)	Max.	0.01	ISO 10307-1
CFPP	°C		10°C below the lowest temperature in the fuel system	DIN EN 116, IP 309, IP 612)
Pour Point ⁹⁾ winter grade	°C	Max.	-6	ISO 3016

Property	Unit		Limit value ¹⁾	Standard ²⁾
Pour Point ⁹⁾ summer grade	°C	Max.	0	ISO 3016
Na, K, Ca, P, Cu, Zn, Si	mg/kg	Max.	free from	DIN EN 16476

Table 94: Requirements for diesel fuel (DMA)

Remarks:

¹⁾ The fuel must be suitable for the intended application. It must not contain any substance in a concentration that causes additional air pollution, is harmful for personnel, jeopardises ship safety and/or has an adverse effect on machine performance. The fuel must be free from non-ferrous metals according to DIN EN 16476. The fuel must not contain any waste oil.

²⁾ Always refer to the currently applicable edition.

³⁾ Specific requirements of the injection system must be taken into account

⁴⁾ Independent of the maximum permissible sulphur content, local laws and regulations must be adhered to

⁵⁾ Additional requirements (e.g. SOLAS) must be observed. Applicable laws must be adhered to.

⁶⁾ Determined at 10% distillation residue

⁷⁾ The FAME must either be in accordance with EN 14214 or with ASTM D6751 as well as with increased oxidation stability of at least 8 hours (EN 15751).

⁸⁾ If the sample is not clear and bright, complete sedimentation through hot filtration and the determination of water content is required

⁹⁾ 10°C below the lowest temperature in the fuel system

When using DFA (FAME according to EN 14214 or ASTM D6751* or their mixtures with DMA), prior consultation with Everllence is required. In addition, the following should be observed:

- Due to the typically lower calorific value or energy content of FAME fuels and their mixtures with DMA (DFA), it may result in deviations to the specified engine output, operating behaviour, load application, specific fuel consumption and emissions.
- The sealing materials used must be suitable for DFA. NBR seals are not suitable and must not be used.
- DFA tends to attract water. The risk of microbial growth is therefore increased. For this reason, the water content needs to be kept as low as possible. The maximum water content must not be exceeded. Everllence recommends draining water from the fuel tank every day.
- Long standstill periods (e.g. emergency power units) must be avoided due to microbial growth. To prevent damage, it is recommendable to only operate applications with fuel which is free of FAME (DMA).
- The fuel reacts to air and this may lead to microbial growth. Ensure that the atmospheric oxygen ventilation is kept to a minimum. A nitrogen buffer is ideally installed in the fuel tank.
- The entire fuel system must be purged with fuel which is free of FAME (DMA) prior to longer standstill periods.
- If DFA is to be used with other fuels and mixing cannot be avoided, contact your fuel supplier to ensure the compatibility of these fuels.

- It is recommended that wherever possible a heat tracing system is installed in the fuel supply system, in order to prevent deposits or blockage of the lines.
- As DFA have a higher evaporation temperature than standard DMA qualities, these are enriched in lubricating oil. Regular analysis of all the lubricating oil is highly recommended. The lubricating oil needs to be replaced if a FAME content of 12% is reached.
- DFA may cause a layer to form, such a phenomenon leads to increased consumption of lubricating oil. If such an increase in lubricating oil consumption values is detected, please contact your Everllence PrimeServ department.
- Fuels may cause harmful reactions with metals such as zinc or copper. We highly recommend getting in contact with your tank and heating oil system supplier.
- After switching to DFA, pay attention to the delta pressure indicators/alarms of the filters, as the residues dissolved by DFA can clog the filters.
- In any case, it is the responsibility of the operating company to adhere to the legal requirements (e.g. SOLAS) and agree on these with the relevant authorities.

* as well as with increased oxidation stability of at least 8 hours (EN 15751)

Cold suitability

The cold suitability of the fuel is determined by the climatic requirements at the place of installation. It is the responsibility of the operating company to choose a fuel with sufficient cold suitability.

The cold suitability of a fuel may be determined and assessed using the following standards:

- Limit of filterability (CFPP) as per EN 116
- Pour point as per ISO 3016
- Cloud point as per EN 23015

To be able to draw a reliable conclusion, it is recommended to perform all three stated procedures.

Analyses

The examination of fuel samples is essential for safe engine operation. Examinations can be carried out in the Everllence PrimeServLab laboratory for our customers.

To guarantee the safety of the crew and to obtain a representative sample, sampling must take place in accordance with valid Everllence operating instructions.

5.3 Specification of engine coolant

Preliminary remarks

The composition of the engine coolant is as follows: water to dissipate the heat and a coolant additive as corrosion protection.

Engine coolant, like fuel and lubricating oil, is a medium that must be carefully selected, treated and controlled. Otherwise, corrosion, erosion and cavitation can occur on the walls of the cooling system which are in contact with water and deposits can form. Deposits impede heat transfer and can lead to

thermal overload of the parts to be cooled. Treatment with a corrosion inhibitor must be carried out before the initial commissioning of the system. During subsequent operation, the concentrations prescribed by the engine manufacturer must always be observed. This applies in particular when a chemical additive is added.

Requirements

Limit values

The properties of untreated coolant must correspond to the following limit values:

Properties/Characteristic	Properties	Unit
Water type	Distillate or fresh water, free of foreign matter.	–
Total hardness	max. 10	dGH ¹⁾
pH value	6.5 – 8	–
Chloride ion content	max. 50	mg/l ²⁾

Table 95: Properties of coolant that must be complied with

¹⁾ 1 dGH (German hardness) $\triangleq$ 10 mg CaO in 1 litre of water $\triangleq$ 17.8 mg CaCO₃/l

$\triangleq$ 0.357 mval/l $\triangleq$ 0.178 mmol/l

²⁾ 1 mg/l $\triangleq$ 1 ppm

Testing equipment

The manufacturers of anticorrosive agents supply user-friendly testing equipment.

For information on monitoring cooling water see section 4.4 Cooling water inspecting.

Additional information

Distillate

If distilled water (from a fresh water generator, for example) or fully desalinated water (from ion exchange or reverse osmosis) is available, this should ideally be used as the engine coolant. These waters are free of lime and salts, which means that deposits that could interfere with the transfer of heat to the coolant, and therefore also reduce the cooling effect, cannot form. However, these waters are more corrosive than normal hard water as the thin film of lime scale that would otherwise provide temporary corrosion protection does not form on the walls. This is why distilled water must be handled particularly carefully and the concentration of the additive must be regularly checked.

Hardness

The total hardness of the water is the combined effect of the temporary and permanent hardness. The proportion of calcium and magnesium salts is of overriding importance. The temporary hardness is determined by the carbonate content of the calcium and magnesium salts. The permanent hardness is determined by the amount of remaining calcium and magnesium salts (sulphates). The temporary (carbonate) hardness is the critical factor that determines the extent of limescale deposit in the cooling system.

Water with a total hardness of > 10°dGH must be mixed with distilled water, or softened.

Corrosion	Damage to the coolant system
Flow cavitation	Corrosion is an electrochemical process that can widely be avoided by selecting the correct water quality and by carefully handling the water in the engine cooling system.
Erosion	Flow cavitation can occur in areas in which high flow velocities and high turbulence is present. If the steam pressure is reached, steam bubbles form and subsequently collapse in high pressure zones which causes the destruction of materials in constricted areas.
Erosion	Erosion is a mechanical process accompanied by material abrasion and the destruction of protective films by solids that have been drawn in, particularly in areas with high flow velocities or strong turbulence.
Stress corrosion cracking	Stress corrosion cracking is a failure mechanism that occurs as a result of simultaneous dynamic and corrosive stress. This may lead to cracking and rapid crack propagation in water-cooled, mechanically-loaded components if the coolant has not been treated correctly.

Formation of a protective film	Treatment of engine coolant
Treatment prior to initial commissioning of engine	The purpose of treating the engine coolant using anticorrosive agents is to produce a continuous protective film on the walls of cooling surfaces and therefore prevent the damage referred to above. In order for the anticorrosive agent to be 100 % effective, it is extremely important that untreated water satisfies the requirements in paragraph Requirements, Page 166 .
	Protective films can be formed by treating the coolant with chemical slushing oil.
	Treatment with a anticorrosive agent should be carried out before the engine is brought into operation for the first time to prevent irreparable initial damage.
	Note:
	The engine must not be brought into operation without treating the cooling water first.

Additives for coolants

A list of currently approved coolant additives and their concentration can be found at [Lubrication](#).

Biocides

If the use of a biocide is unavoidable because the coolant has been contaminated by bacteria, the following steps must be observed:

- It must be ensured that a biocide suitable for the specific application is used
- The biocide is compatible with the sealing materials used in the coolant system and does not corrode them
- Neither the biocide nor its degradation products contain any corrosive components. Biocides whose decomposition products contain chloride or sulphate ions are not permitted
- Biocides that cause the coolant to foam are not permitted
- Biocides should not be used constantly, but only in a pulse dose

Antifreeze agents

- If antifreeze agents must be used, consult Everlence beforehand. Anti-freeze agents reduce the capacity of the coolant to absorb heat. In some cases the cooling effect of the coolant may be insufficient.

Prerequisite for effective use of an anticorrosive agent

Clean cooling system

As contamination significantly reduces the effectiveness of the additive, the tanks, pipes, coolers and other parts outside the engine must be free of rust and other deposits before the engine is started up for the first time and after repairs of the pipe system.

The entire system must therefore be cleaned with the engine switched off using a suitable cleaning agent (see table Cleaning agents for removing oil sludge).

Loose solid matter in particular must be removed by flushing the system thoroughly as otherwise erosion may occur in locations where the flow velocity is high.

The cleaning agents must not corrode the seals and materials of the cooling system. In most cases, the supplier of the coolant additive will be able to carry out this work and, if this is not possible, will at least be able to provide suitable products to do this. If this work is carried out by the engine operator, he should use the services of a specialist supplier of cleaning agents. The cooling system must be flushed thoroughly after cleaning. Once this has been done, the engine coolant must be immediately treated with anticorrosive agent. Once the engine has been brought back into operation, the cleaned system must be checked for leaks.

Regular checks of the coolant condition and system

Treated coolant can become contaminated during operation and the additive can lose some of its effectiveness. It is therefore advisable to check the cooling system and the condition of the coolant regularly. To detect leaks in the lubricating oil system, regular checking of the water in the expansion tank is recommended. Signs of oil in the water include discoloration or a visible oil film on the surface of the water sample.

Check the additive concentration using the test kits provided by the additive manufacturer at least once per week. The results must be recorded.

Note:

The chemical additive concentrations must not fall below the minimum concentrations specified in the table entitled Chemical agents.

Excessively low concentrations lead to corrosion and must be avoided. Concentrations that are somewhat higher do not cause damage. Concentrations that are more than twice as high as recommended should be avoided.

Every 2 to 6 months send a cooling water sample to an independent laboratory or to the engine manufacturer for integrated analysis.

If chemical additives or anti-freeze solutions are used, cooling water should be replaced after 3 years at the latest.

If there is a high concentration of solids (rust) in the system, the water must be completely replaced and entire system carefully cleaned.

Deposits in the cooling system may be caused by fluids that enter the coolant, by corrosion in the plant, and by limescale deposits if the water is very hard. If the concentration of chloride ions has increased, this generally indicates that seawater has entered the system. The maximum specified concentration of 50 mg chloride ions per kg must not be exceeded as otherwise the risk of corrosion is too high. If exhaust gas enters the coolant, this can lead to a sudden drop in the pH value or to an increase in the sulphate content.

Water losses must be compensated for by filling with untreated water that meets the quality requirements specified in the paragraph [Requirements, Page 166](#). The concentration of anticorrosive agent must subsequently be checked and adjusted if necessary.

Subsequent checks of the coolant are especially required if the coolant had to be drained off in order to carry out repairs or maintenance.

Protective measures

Anticorrosive agents contain chemical compounds that can pose a risk to health or the environment if incorrectly used. Comply with the directions in the manufacturer's material safety data sheets.

Avoid prolonged direct contact with the skin. Wash hands thoroughly after use. If larger quantities spray and/or soak into clothing, remove and wash clothing before wearing it again.

If chemicals come into contact with your eyes, rinse them immediately with plenty of water and seek medical advice.

Anticorrosive agents are generally harmful to the water cycle. Observe the relevant statutory requirements for disposal.

Approved coolant additives

A list of currently approved coolant additives and their concentration can be found at [Lubrication](#).

5.4 Cooling water inspecting

Summary

Acquire and check typical values of the operating media to prevent or limit damage.

The fresh water used to fill the cooling water circuits must satisfy the specifications. The cooling water in the system must be checked regularly in accordance with the maintenance schedule. The following work/steps is/are necessary:

Acquisition of typical values for the operating fluid, evaluation of the operating fluid and checking the concentration of the anticorrosive agent.

Tools/equipment required

The following can be used:

- The water test kit with all the necessary instruments and chemicals for determining water hardness, pH value and chloride content (available from Mar-Tec Marine, Hamburg).

Devices for testing fresh water quality

Equipment for testing the concentration of additives

Testing equipment according to the recommendations of the supplier. The test kits from the provider normally also include testing equipment which can be used to determine the fresh water quality.

Short specification**Testing the typical values of water**

Typical value/property	Water for filling and refilling (without additive)	Circulating water (with additive)
Water type	Fresh water, free of foreign matter	Treated coolant
Total hardness	≤ 10 dGH ¹⁾	≤ 10 dGH ¹⁾
pH value	6.5 – 8 at 20 °C	≥ 7.5 at 20 °C
Chloride ion content	≤ 50 mg/l	≤ 50 mg/l ²⁾

Table 96: Quality specifications for coolants (short version)

¹⁾ dGH German hardness

1 dGH = 10 mg/l CaO
= 17.8 mg/l CaCO₃
= 0.178 mmol/L

²⁾ 1 mg/l = 1 ppm

Testing kit provided by the additive supplier

If the testing kit provided by the additive supplier includes an option for determining the typical values of fresh water, it may be used.

Testing the concentration of chemical additives

The concentration should be tested every week, and/or according to the maintenance schedule, using the testing instruments, reagents and instructions of the relevant supplier.

Chemical slushing oils can only provide effective protection if the right concentration is precisely maintained. This is why the concentrations recommended by Everlence (see section [Specification of engine cooling water, Page 165](#)) must be observed in all cases. These recommended concentrations may not be the same as those specified by the manufacturer.

Regular analysis of coolant is very important for safe engine operation. We can analyse fuel for customers at Everlence laboratory PrimeServLab.

5.5 Cooling water system cleaning**Summary**

Remove contamination/residue from operating fluid systems, ensure/re-establish operating reliability.

Cooling water systems containing deposits or contamination prevent effective cooling of parts. Contamination and deposits must be regularly eliminated.

This comprises the following:

Cleaning the system and, if required, removal of limescale deposits, flushing the system.

Cleaning

The coolant system must be checked for contamination at regular intervals. Cleaning is required if the degree of contamination is high. This work should ideally be carried out by a specialist who can provide the right cleaning agents

Oil sludge

for the type of deposits and materials in the cooling circuit. The cleaning should only be carried out by the engine operator if this cannot be done by a specialist.

Oil sludge from lubricating oil that has entered the cooling system or a high concentration of anticorrosive agents can be removed by flushing the system with fresh water to which some cleaning agent has been added. Suitable cleaning agents are listed alphabetically in the table entitled Cleaning agents for removing oil sludge. Products by other manufacturers can be used providing they have similar properties. The manufacturer's instructions for use must be strictly observed.

Manufacturer	Product
Drew	HDE - 777
Nalfleet	Maxi-Clean 2
Unitor	Seaclean, Seaclean Plus

Table 97: Cleaning agents for removing oil sludge

Lime and rust deposits

Lime and rust deposits can form if the water is especially hard or if the concentration of the anticorrosive agent is too low. A thin lime scale layer can be left on the surface as experience has shown that this protects against corrosion. However, limescale deposits with a thickness of more than 0.5 mm obstruct the transfer of heat and cause thermal overloading of the components being cooled.

Rust that has been flushed out may have an abrasive effect on other parts of the system, such as the sealing elements of the water pumps. Together with the elements that are responsible for water hardness, this forms what is known as ferrous sludge which tends to gather in areas where the flow velocity is low.

Products that remove limescale deposits are generally suitable for removing rust. Suitable cleaning agents are listed alphabetically in the table entitled Cleaning agents for removing limescale and rust deposits. Products by other manufacturers can be used providing they have similar properties. The manufacturer's instructions for use must be strictly observed. Prior to cleaning, check whether the cleaning agent is suitable for the materials to be cleaned. The products listed in the table entitled Cleaning agents for removing limescale and rust deposits are also suitable for stainless steel.

Manufacturer	Product
Nalfleet	Nalco 8344, 73190
Unitor	Metal Brite
Drew	Ferroclean

Table 98: Cleaning agents for removing lime scale and rust deposits

The carbon dioxide bubbles released when the lime scale layer is dissolved can prevent the cleaning agent from reaching lime scale deposits. It is therefore absolutely necessary to circulate the water with the cleaning agent to flush away the gas bubbles and allow them to escape. The length of the cleaning process depends on the thickness and composition of the deposits.

Following cleaning

The cooling system must be flushed several times once it has been cleaned using cleaning agents. Replace the water during this process. If acids are used to carry out the cleaning, neutralise the cooling system afterwards with suitable chemicals then flush. The system can then be refilled with water that has been prepared accordingly.

Note:

Start the cleaning operation only when the engine has cooled down. Hot engine components must not come into contact with cold water. Open the venting pipes before refilling the cooling water system. Blocked venting pipes prevent air from escaping which can lead to thermal overloading of the engine.

When disposing of cleaning agents or acids, observe the applicable regulations.

Note:

The products to be used can endanger health and may be harmful to the environment. Follow the manufacturer's handling instructions without fail.

5.6 Specification of intake air (combustion air)

General

The quality and condition of intake air (combustion air) have a significant effect on the engine output, wear and emissions of the engine. In this regard, not only are the atmospheric conditions extremely important, but also contamination by solid and gaseous foreign matter.

Mineral dust in the intake air increases wear. Chemicals and gases promote corrosion.

This is why effective cleaning of intake air (combustion air) and regular maintenance of the air filter are required.

When designing the intake air system, the maximum permissible overall pressure drop (filter, silencer, pipe line) of 20 mbar must be taken into consideration.

Exhaust turbochargers for marine engines are equipped with silencers and air filters as a standard.

Requirements

Liquid fuel engines: As minimum, inlet air (combustion air) must be cleaned by an ISO Coarse 45% class filter as per DIN EN ISO 16890, if the combustion air is drawn in from inside (e.g. from the machine room/engine room). If the combustion air is drawn in from outside, in the environment with a risk of higher inlet air contamination (e.g. due to sand storms, due to loading and unloading grain cargo vessels or in the surroundings of cement plants), additional measures must be taken. This includes the use of pre-separators, pulse filter systems and a higher grade of filter efficiency class at least up to ISO ePM10 50% according to DIN EN ISO 16890.

Gas engines and dual-fuel engines: As minimum, inlet air (combustion air) must be cleaned by an ISO COARSE 45% class filter as per DIN EN ISO 16890, if the combustion air is drawn in from inside (e.g. from machine room/engine room). Gas engines or dual-fuel engines must be equipped with a dry filter. Oil bath filters are not permitted because they enrich the inlet air with oil mist. This is not permissible for gas operated engines because this may result in engine knocking. If the combustion air is drawn in from outside, in the environ-

onment with a risk of higher inlet air contamination (e.g. due to sand storms, due to loading and unloading grain cargo vessels or in the surroundings of cement plants) additional measures must be taken. This includes the use of pre-separators, pulse filter systems and a higher grade of filter efficiency class at least up to ISO ePM10 50% according to DIN EN ISO 16890.

In general, the following applies:

The inlet air path from air filter to engine shall be designed and implemented airtight so that no false air may be drawn in from the outdoor.

The concentration downstream of the air filter and/or upstream of the turbocharger inlet must not exceed the following limit values.

The air must not contain organic or inorganic silicon compounds.

Properties	Limit	Unit ¹⁾
Dust (sand, cement, CaO, Al ₂ O ₃ etc.)	max. 5	mg/Nm ³
Chlorine	max. 1.5	
Sulphur dioxide (SO ₂)	max. 1.25	
Hydrogen sulphide (H ₂ S)	max. 5	
Salt (NaCl)	max. 1	
¹⁾ One Nm ³ corresponds to one cubic meter of gas at 0 °C and 101.32 kPa.		

Table 99: Typical values for intake air (combustion air) that must be complied with

Note:

Intake air shall not contain any flammable gases. Make sure that the combustion air is not explosive and is not drawn in from the ATEX Zone.

5.7 Specification of compressed air

General

For compressed air quality observe the ISO 8573-1. Compressed air must be free of solid particles and oil (acc. to the specification).

Requirements

The starting air must fulfil at least the following quality requirements according to ISO 8573-1.

Purity regarding solid particles	Quality class 6
Particle size > 40µm	max. concentration < 5 mg/m ³
Purity regarding moisture	Quality class 7
Residual water content	< 0.5 g/m ³
Purity regarding oil	Quality class X

Additional requirements are:

- The air must not contain organic or inorganic silicon compounds.
- The layout of the starting air system must ensure that no corrosion may occur.

Compressed air quality in the control air system

- The starting air system and the starting air receiver must be equipped with condensate drain devices.
- By means of devices provided in the starting air system and via maintenance of the system components, it must be ensured that any hazardous formation of an explosive compressed air/lube oil mixture is prevented in a safe manner.

Please note that control air will be used for the activation of some safety functions on the engine – therefore, the compressed air quality in this system is very important.

Control air must meet at least the following quality requirements according to ISO 8573-1.

- | | |
|------------------------------------|-----------------|
| ▪ Purity regarding solid particles | Quality class 5 |
| ▪ Purity regarding moisture | Quality class 4 |
| ▪ Purity regarding oil | Quality class 3 |

For catalysts

The following specifications are valid unless otherwise defined by any other relevant sources:

Compressed air quality for soot blowing

Compressed air for soot blowing must meet at least the following quality requirements according to ISO 8573-1.

- | | |
|------------------------------------|-----------------|
| ▪ Purity regarding solid particles | Quality class 3 |
| ▪ Purity regarding moisture | Quality class 4 |
| ▪ Purity regarding oil | Quality class 2 |

Compressed air quality for reducing agent atomisation

Compressed air for atomisation of the reducing agent must fulfil at least the following quality requirements according to ISO 8573-1.

- | | |
|------------------------------------|-----------------|
| ▪ Purity regarding solid particles | Quality class 3 |
| ▪ Purity regarding moisture | Quality class 4 |
| ▪ Purity regarding oil | Quality class 2 |

Note:

To prevent clogging of catalyst and catalyst lifetime shortening, the compressed air specification must always be observed.

5.8 Specification of urea solution

Use of good quality urea solution is essential for the operation of a SCR catalyst.

Note:

The overall SCR system is designed for an aqueous solution having a urea content of 40 % as listed in the table below. This must be taken into account when ordering.

Urea 40% must meet the standard of ISO 18611. Everllence recommends urea according to the specification below.

	Urea solution concentration 39 – 41 [%]	Test method
Density at 20 °C [g/cm ³]	1.105 – 1.115	DIN EN ISO 12185

	Urea solution concentration 39 – 41 [%]	Test method
Refractive index at 20 °C	1.3930 – 1.3962	ISO 18611-2 Annex C
Biuret [%]	max. 0.5	ISO 18611-2 Annex E
Alkalinity as NH ₃ [%]	max. 0.5	ISO 18611-2 Annex D
Aldehyde [mg/kg]	max. 10	ISO 18611-2 Annex F
Insolubles [mg/kg]	max. 20	ISO 18611-2 Annex G
Phosphorus (as PO ₄) [mg/kg]	max. 0.5	ISO 18611-2 Annex H
Calcium [mg/kg]	max. 0.5	ISO 18611-2 Annex I
Iron [mg/kg]	max. 0.5	ISO 18611-2 Annex I
Magnesium [mg/kg]	max. 0.5	ISO 18611-2 Annex I
Sodium [mg/kg]	max. 0.5	ISO 18611-2 Annex I
Potassium [mg/kg]	max. 0.5	ISO 18611-2 Annex I
Aluminium [mg/kg]	max. 0.5	ISO 22241-2 Annex I
Nickel [mg/kg]	max. 0.2	ISO 22241-2 Annex I
Copper [mg/kg]	max. 0.2	ISO 22241-2 Annex I
Zinc [mg/kg]	max. 0.2	ISO 22241-2 Annex I
Chromium [mg/kg]	max. 0.2	ISO 22241-2 Annex I

Table 100: Urea 40 % solution specification

This page is intentionally left blank

6 Engine supply systems

6.1 3D Engine Viewer – A support programme to configure the engine room

Everllence offers a free-of-charge online programme for the configuration and provision of installation data required for installation examinations and engine room planning: The 3D Engine Viewer .

Easy-to-handle selection and navigation masks permit configuration of the required engine type, as necessary for virtual installation in your engine room.

In order to be able to use the 3DEngine Viewer, register on our website under:

[Everllence Extranet](#)

After successful registration, the 3D Engine Viewer are available under:

[3D Engine Viewer](#)

[3D GenSet Viewer](#)

by clicking onto the requested application.

In only three steps, you will obtain professional engine room data for your further planning:

- Selection
Select the requested output, respectively the requested type.
- Configuration
Drop-down menus permit individual design of your engine according to your requirements. Each of your configurations will be presented on the basis of isometric models.
- View
The models of the 3D Engine Viewer include all essential geometric and planning-relevant attributes (e.g. connection points, interfering edges, exhaust gas outlets, etc.) required for the integration of the model into your project.

The configuration with the selected engines can now be easily downloaded.

For 2D representation as:

- .pdf
- .dwg
- .dxf

for 3D as:

- .dgn
- .stp
- .sat
- .igs
- 3D-dxf
- and many others

On the following pages, you will find information on the four-stroke Diesel engine programme of Everllence SE. By means of the Engine Viewer, you can specifically select engine designs and download the technical data and 3-D-CAD models essential for engine room planning.

- By means of the combo box and the function "Search" choose the output in the table on the right.

or

- In case you already know the required engine type, a click on the engine type in the table on the bottom will take you to the data sheets of the desired engine.

All available engine types are listed in the table above. We are continuing our efforts to provide the data of our other medium-speed engines as well.

All data provided in this application is non-binding. This data serves informational purposes only and is especially not guaranteed in any way. Depending on the subsequent specific individual projects, the relevant data may be subject to changes and will be assessed and determined individually for each project. This will depend on the particular characteristics of each individual project, especially specific site and operational conditions.

Click on engine type for details

r/min	3000	6000	9000	12000	15000	18000	21000	24000	kW
500-514									V48/60CR
500-514									V51/60DF
600-600									V49/60DF
600-600									L49/60DF
600-600									L49/60
720-750									V32/44CR
500-514									L48/60CR
1000-1032									V28/33STC
500-514									L51/60DF
720-750									V32/40
720-750									L32/44CR
720-750									L35/44DF
720-750									L32/40
800-800									L27/38
1000-1000									L21/31
1600-2000									175D
r/min	3000	6000	9000	12000	15000	18000	21000	24000	kW

Figure 65: Selection of engine

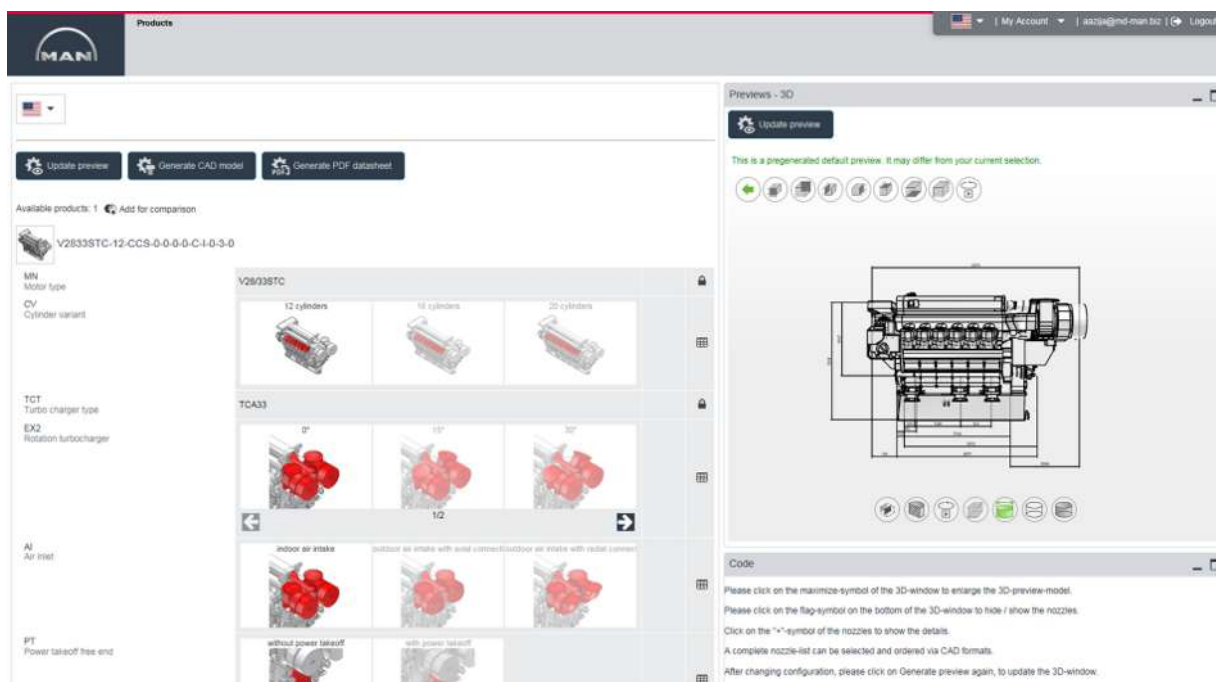


Figure 66: Preselected standard configuration

6.2 Basic principles for pipe selection

6.2.1 External pipe dimensioning

The external piping systems are to be dimensioned, designed, installed and connected to the engine by the shipyard. The pipe systems should be designed in such a way that the pressure losses are kept within reasonable limits. To achieve this at justifiable cost, it is recommended to maintain the flow rates as indicated below. Nevertheless, depending on specific conditions of piping systems, it may be necessary in some cases to adopt even lower flow rates. Generally, it is not recommended to use higher flow rates.

For small pipes a low flow speed has to be calculated, for bigger pipes (> DN 125) the higher values may be chosen.

	Recommended flow rates (m/s)	
	Suction side	Delivery side
Fresh water (cooling water)	1.0–2.0	1.5–3.0
Lube oil	0.5–1.0	1.5–2.5
Seawater	1.0–1.5	1.5–2.5
Diesel fuel	0.5–1.0	1.5–2.0
Compressed air for control air system	-	2–10
Compressed air for starting air system	-	25–30 ¹⁾
Intake air	20–25	
Exhaust gas	40	

¹⁾ During engine start higher velocities acceptable, depends on total pressure loss of supply system.

Table 101: Recommended flow rates

6.2.2 Engine pipe connections and dimensions

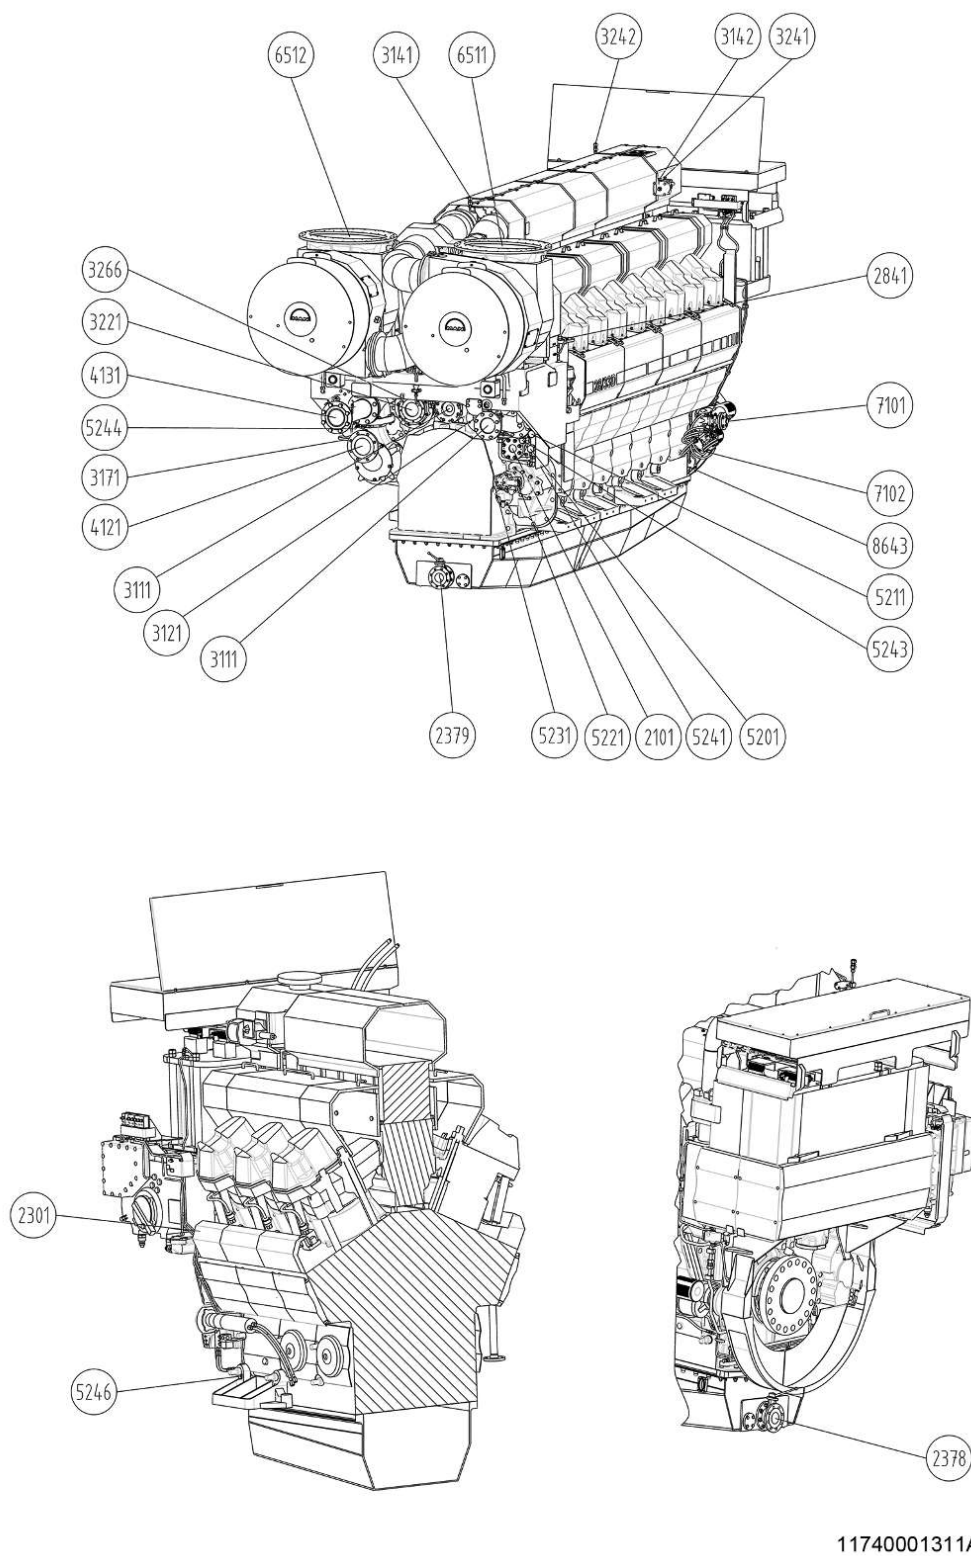


Figure 67: Engine pipe connections

Anschluss Nr. Connection-No.	Benennung des Rohranschlusses Description of pipe connection	Rohrabmessung Pipe dimension	Bezeichnung des Anschlusses Code for connection part	Anschlussort Connection location	Flussrichtung Flow direction
2101	Schmieröl lubricating oil	StR 88,9x3,2	EN 1092-1/01 A/DN80/PN16/S235JRG2	Kupplungsgegensseite Coupling counterside	Eintritt Inlet
2301	Schmieröl Füllleitung oil tank fill connection	Schlauch/hose EN 857 2SC 25	Schnellkupplung Quick coupling	Kupplungsseite Coupling side	Eintritt Inlet
2378	Ablauf aus der Ölwanne Drain from oil pan	StR 88,9x3,2	EN 1092-1/01 A/DN80/PN16/S235JRG2	Kupplungsseite Coupling side	Austritt Outlet
2379	Ablauf aus der Ölwanne Drain from oil pan	StR 88,9x3,2	EN 1092-1/01 A/DN80/PN16/S235JRG2	Kupplungsgegensseite Coupling counterside	Austritt Outlet
2841	Kurbelraumventilierung crankcase venting	StR 88,9x3,2		Kupplungsgegensseite Coupling counterside	Austritt Outlet
3111	HT Kuehlwasser HT cooling water	StR 139,7x4,5	EN 1092-1/01 A/DN125/PN16/S235JRG2	Kupplungsgegensseite Coupling counterside	Austritt Outlet
3121	HT Kuehlwasser HT cooling water	StR 139,7x4,5	EN 1092-1/01 A/DN125/PN16/S235JRG2	Kupplungsgegensseite Coupling counterside	Eintritt Inlet
3141	Entlüftung HT Kuehlwasserleitung 1 air vent HT cooling water pipe 1	StR 16x2	ISO 8434-1 - S16 DIN 3861 - S16-St	Kupplungsgegensseite Coupling counterside	Austritt Outlet
3142	Entlüftung HT Kuehlwasserleitung 2 air vent HT cooling water pipe 2	StR 16x2	ISO 8434-1 - S16 DIN 3861 - S16-St	Kupplungsseite Coupling side	Austritt Outlet
3171	Kuehlwasservorwärmung cooling water preheat	StR 60,3x2,9	EN 1092-1/11 A/DN50/PN16/P265GH+N	Kupplungsgegensseite Coupling counterside	Austritt Outlet
3211	NT Kuehlwasser LT cooling water	StR 139,7x4,5	EN 1092-1/01 A/DN125/PN16/S235JRG2	Kupplungsgegensseite Coupling counterside	Austritt Outlet
3221	NT Kuehlwasser LT cooling water	StR 139,7x4,5	EN 1092-1/01 A/DN125/PN16/S235JRG2	Kupplungsgegensseite Coupling counterside	Eintritt Inlet
3241	Entlüftung NT Kuehlwasserleitung 1 air vent LT cooling water pipe 1	StR 16x2	ISO 8434-1 - S16 DIN 3861 - S16-St	Kupplungsseite Coupling side	Austritt Outlet
3242	Entlüftung NT Kuehlwasserleitung 2 air vent LT cooling water pipe 2	StR 16x2	ISO 8434-1 - S16 DIN 3861 - S16-St	Kupplungsseite Coupling side	Austritt Outlet
3266	NT Kuehlwasser Nachkuehlung LT cooling water post cooling	StR 22x2	ISO 8434-1 - L22	Kupplungsgegensseite Coupling counterside	Eintritt Inlet
4121	Seewasser Pumpe sea water pump	StR 168,3x4,5	EN 1092-1/01 A/DN150/PN16/CuSn7Zn2Pb3	Kupplungsgegensseite Coupling counterside	Eintritt Inlet
4131	Seewasser Pumpe sea water pump	DIN B6019-159x8 CuNi10Fe1.6Mn	EN 1092-1/01 A/DN150/PN16/CuNi10Fe1.6Mn	Kupplungsgegensseite Coupling counterside	Austritt Outlet
5201	Kraftstoff fuel	StR 38x3,5	ISO 8434-1 - S38 DIN 3861 - BS38-ST	Kupplungsgegensseite Coupling counterside	Eintritt Inlet
5211	Kraftstoff fuel	StR 38x3,5	ISO 8434-1 - S38 DIN 3861 - BS38-ST	Kupplungsgegensseite Coupling counterside	Austritt Outlet
5221	Kraftstoff Foerderpumpe fuel supply pump	StR 76,1x2,9		Kupplungsgegensseite Coupling counterside	Eintritt Inlet
5231	Kraftstoff Foerderpumpe fuel supply pump	StR 76,1x2,9		Kupplungsgegensseite Coupling counterside	Austritt Outlet
5241	Leckkraftstoffablauf leakage fuel drain	StR 10x1,5	ISO 8434-1 - S10 DIN 3861 - BS10-ST	Kupplungsgegensseite Coupling counterside	Austritt Outlet
5243	Kraftstoffleckageablauf 1 fuel oil leakage drain 1	StR 25x2	ISO 8434-1 - S25 DIN 3861 - BS25-ST	Kupplungsgegensseite Coupling counterside	Austritt Outlet
5244	Kraftstoffleckageablauf 2 fuel oil leakage drain 2	StR 20x2	ISO 8434-1 - S25 DIN 3861 - BS25-ST	Kupplungsgegensseite Coupling counterside	Austritt Outlet
5246	Kraftstoffleckageablauf 3 fuel oil leakage drain 3	StR 25x2	ISO 8434-1 - S25 DIN 3861 - BS25-ST	Kupplungsseite Coupling side	Austritt Outlet
6511	Abgasaustritt exhaust outlet	DN 700	DRW 11289840616	Kupplungsgegensseite Coupling counterside	Austritt Outlet
6512	Abgasaustritt exhaust outlet	DN 700	DRW 11289840616	Kupplungsgegensseite Coupling counterside	Austritt Outlet
7101	Anlassluft starting air	StR 48,3x2,6	EN 1092-1/11 B1/DN40/PN40/P245GH	Kupplungsseite Coupling side	Eintritt Inlet
7102	Steuerluft Eintritt control air inlet	StR 10x1,5	ISO 8434-1 - L10 DIN 3861 - BS10-St	Kupplungsseite Coupling side	Eintritt Inlet
8643	Kondenswasserablauf v. Ladeluftleitung condensed water drain f. air manifold		kein Anschluss / no connection	Kupplungsseite Coupling side	Austritt Outlet

11740001311A

Figure 68: Legend to engine pipe connections

6.2.3 Specification of materials for piping

General

- The properties of the piping shall conform to international standards, e.g. DIN EN 10208, DIN EN 10216, DIN EN 10217 or DIN EN 10305, DIN EN 13480-3.
- For piping, carbon steel pipe should be used; stainless steel shall be used where necessary.
- Outer surface of carbon steel pipes needs to be primed and painted according to shipyard's specification.

- The pipes are to be sound, clean and free from all imperfections. The internal surfaces must be thoroughly cleaned and all scale, grit, dirt and sand used in casting or bending has to be removed. No sand is to be used as packing during bending operations.
- In case of pipes with forged bends, care must be taken to ensure that inner surfaces are smooth and that no stray weld metal remains after joining.
- Advices in Everllence work instruction 010.000.001-03. Pipelines cleaning, pickling and preservation. Carry out the pressure test for cleaning of steel pipes before fitting them together should be observed.
- Certain material combinations are sensitive to electro-chemical corrosion, therefore special attention must be paid to the arrangement within a pipe system including all connected components.
- All information given is to be regarded as indication only; the sole responsibility for the functionality and durability of the external piping system lies with the shipyard.

LT-, HT cooling water pipes

Galvanised steel pipe must not be used for the piping of the system as all additives contained in the engine cooling water attack zinc. Moreover, there is the risk of the formation of local electrolytic element couples where the zinc layer has been worn off, and the risk of aeration corrosion where the zinc layer is not properly bonded to the substrate.

Proposed material (EN)

P235GH, E235, X5CrNiMoTi17-12-2

Fuel oil pipes, lube oil pipes

Galvanised steel pipe must not be used for the piping of the system as acid components of the fuel may attack zinc.

Proposed material (EN)

E235, P235GH, X6CrNiMoTi17-12-2

Urea pipes (for SCR only)

Galvanised steel pipe, brass and copper components must not be used for the piping of the system.

Proposed material (EN)

X6CrNiMoTi17-12-2

Compressed air pipes

Galvanised steel pipe must not be used for the piping of the system.

Proposed material (EN)

E235, P235GH, X6CrNiMoTi17-12-2

Seawater pipes

Material depending on required flow speed and mechanical stress.

Proposed material


CuNiFe, glass fiber reinforced plastic, rubber lined steel

6.2.4 Installation of flexible pipe connections

Arrangement of hoses on engine

Flexible pipe connections are necessary to connect resiliently mounted engines with external piping systems. They are used to compensate the dynamic movements of the engine in relation to the external piping system.

The engine's movement on its foundation is caused by the engine's rotation and torque itself as well as by rolling and pitching of the ship. Based on roll angles of $\pm 22.5^\circ$ and pitching of $\pm 7.5^\circ$ (according to prescriptive rules of classification societies) the excursions at the exhaust gas outlet can be up to 5 mm in X-, 25 mm in Y- and 6 mm in Z-direction. As the exhaust gas outlet is at the highest point of the engine the excursions at lower positions are smaller respectively. In order to obtain exact data on excursions at certain points, a project-specific calculation of the elastic engine mount is required.

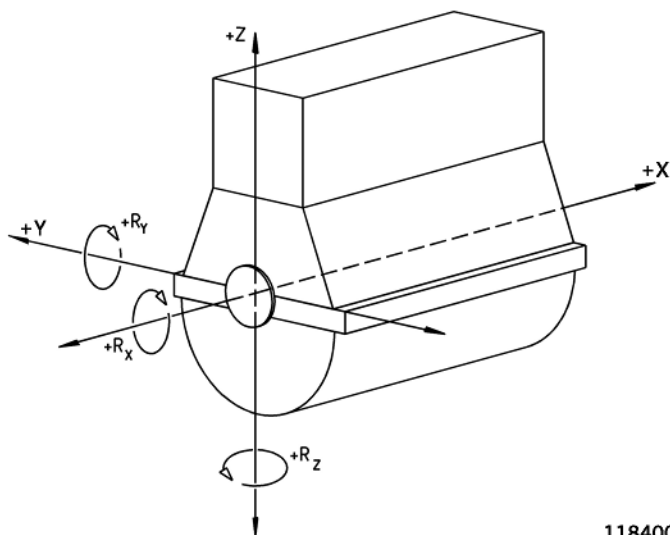

11840050003A

Figure 69: Coordinate system

Generally flexible pipes (rubber hoses with steel inlet, metal hoses, PTFE-corrugated hose-lines, rubber bellows with steel inlet, steel bellows, steel compensators) are nearly unable to compensate twisting movements. Therefore the installation direction of flexible pipes must be vertically (in Z-direction) if ever possible. Torsion on flexible pipe connections must be avoided. Flexible pipe connections which are installed in X-direction are particularly at risk. Therefore the installation of flexible pipe connections in this direction should be avoided. Where the installation of flexible pipe connections in X-direction is nevertheless unavoidable, the continuing pipeline on the plant side must be designed in such a way that the torsional forces can be safely absorbed. An installation in horizontal-lateral (Y-direction) is not recommended.

The media connections (compensators) to and from the engine must be highly flexible whereas the fixations of the compensators on the one hand with the engine and on the other hand with the environment must be realised as stiff as possible.

Flange and screw connections

Flexible pipes delivered loose by Everllence are fitted with flange connections from DN32 upwards. Smaller sizes are fitted with screw connections. Each flexible pipe is delivered complete with counter flanges or, those smaller than DN32, with weld-on sockets.

Arrangement of the external piping system

Shipyard's pipe system must be exactly arranged so that the flanges or screw connections do fit without lateral or angular offset. Therefore it is recommended to adjust the final position of the pipe connections after engine alignment is completed.

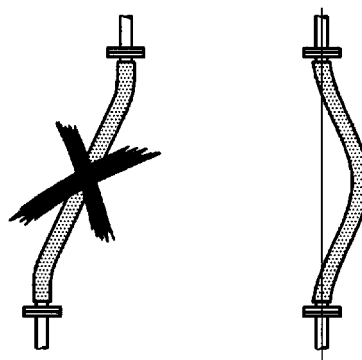


Figure 70: Arrangement of pipes in system

Installation of hoses

In the case of straight-line-vertical installation, a suitable distance between the hose connections has to be chosen, so that the hose is installed with a sag. To satisfy a correct sag in a straight-line-vertically installed hose, the distance between the hose connections (hose installed, engine stopped) has to be approximately 5% shorter than the same distance of the unconnected hose (without sag). Flexible hoses must not be installed with tensile stress, compression or torsional tension.

In case it is unavoidable (this is not recommended) to connect the hose in lateral-horizontal direction (Y-direction) the hose must preferably be installed with a 90° arc. The minimum bending radii, specified in provided drawings, are to be observed.

Hoses must not be twisted during installation. Turnable lapped flanges on the hoses avoid this.

Where bolted connections are used, hold the hexagon on the hose with a wrench while fitting the nut.

All installation instructions of the hose manufacturer have to be complied with.

Depending on the required application rubber hoses with steel inlet, metal hoses or PTFE-corrugated hose lines are used.

Installation of steel compensators

Steel compensators are used for hot media, e.g. exhaust gas. They can compensate movements in line and transversal to their centre line, but they are absolutely unable to compensate twisting movements. Compensators are very stiff against torsion. For this reason all kind of steel compensators installed on resilient mounted engines are to be installed in vertical direction.

Note:

Exhaust gas compensators are also used to compensate for thermal expansion. Exhaust gas compensators are therefore required for all type of engine mountings, also for semi-resilient or rigid mounted engines. But in these cases the compensators can be shorter, as they are designed only to compensate the thermal expansions and vibrations, but not other dynamic engine movements.

Supports of pipes

Flexible pipes must be installed as close as possible to the engine connection.

On the shipside, directly after the flexible pipe, the pipe is to be fixed with a sturdy pipe anchor of higher than normal quality. This anchor must be capable to absorb the reaction forces of the flexible pipe, the hydraulic force of the fluid and the dynamic force.

Example of the axial force of a compensator to be absorbed by the pipe anchor:

- Hydraulic force
= (cross section area of the compensator) x (pressure of the fluid inside)
- Reaction force
= (spring rate of the compensator) x (displacement of the comp.)
- Axial force
= (hydraulic force) + (reaction force)

Additionally a sufficient margin has to be included to account for pressure peaks and vibrations.

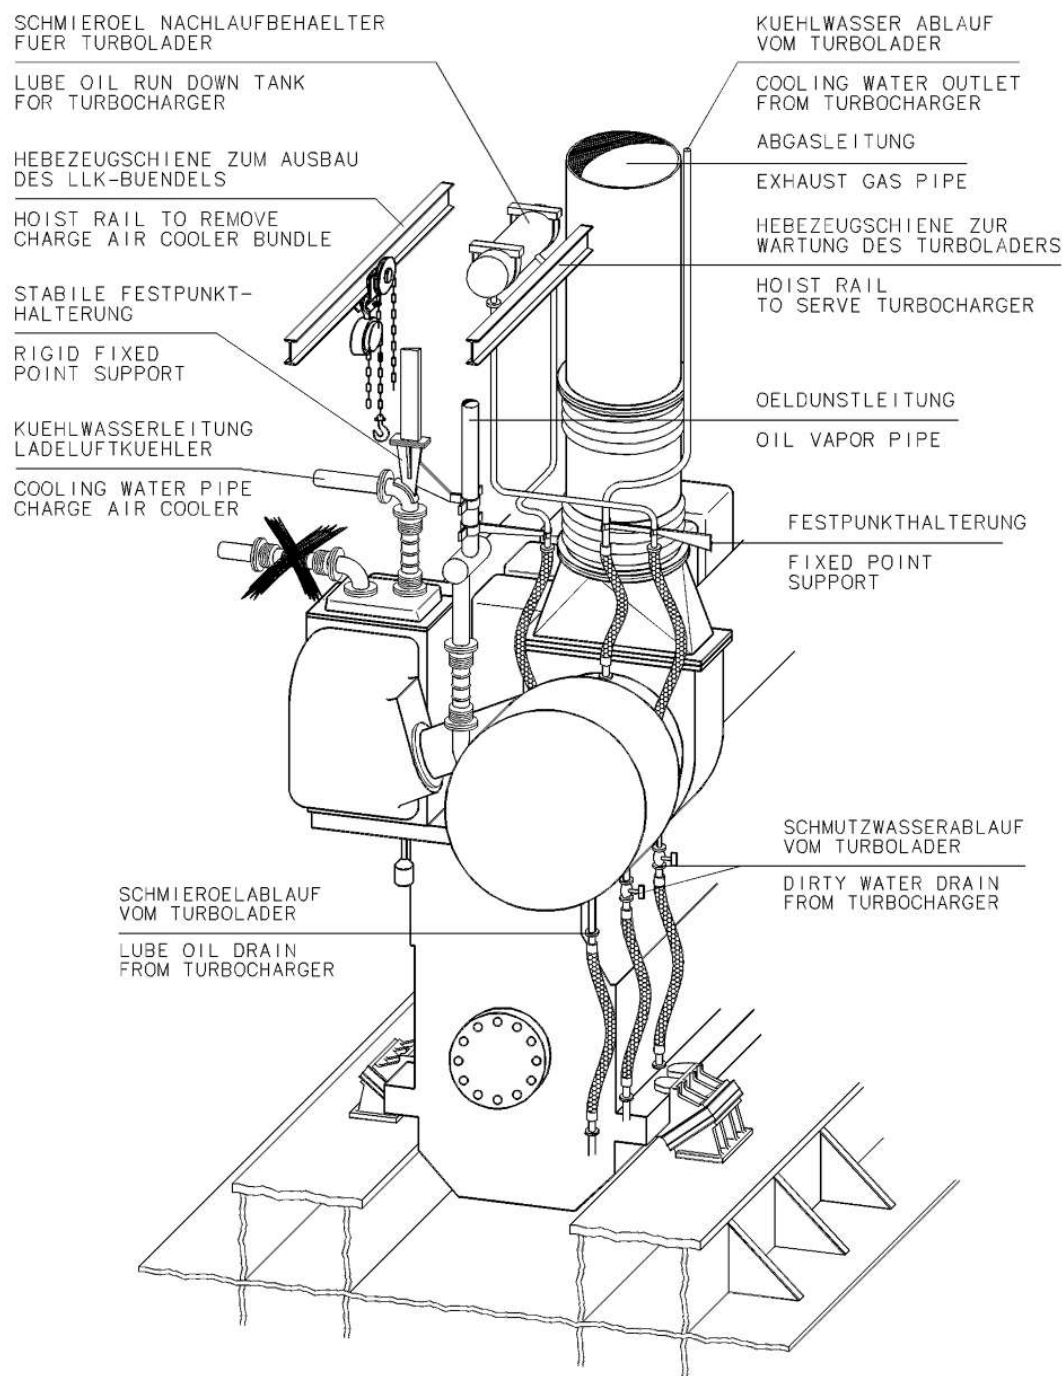


Figure 71: Installation of hoses

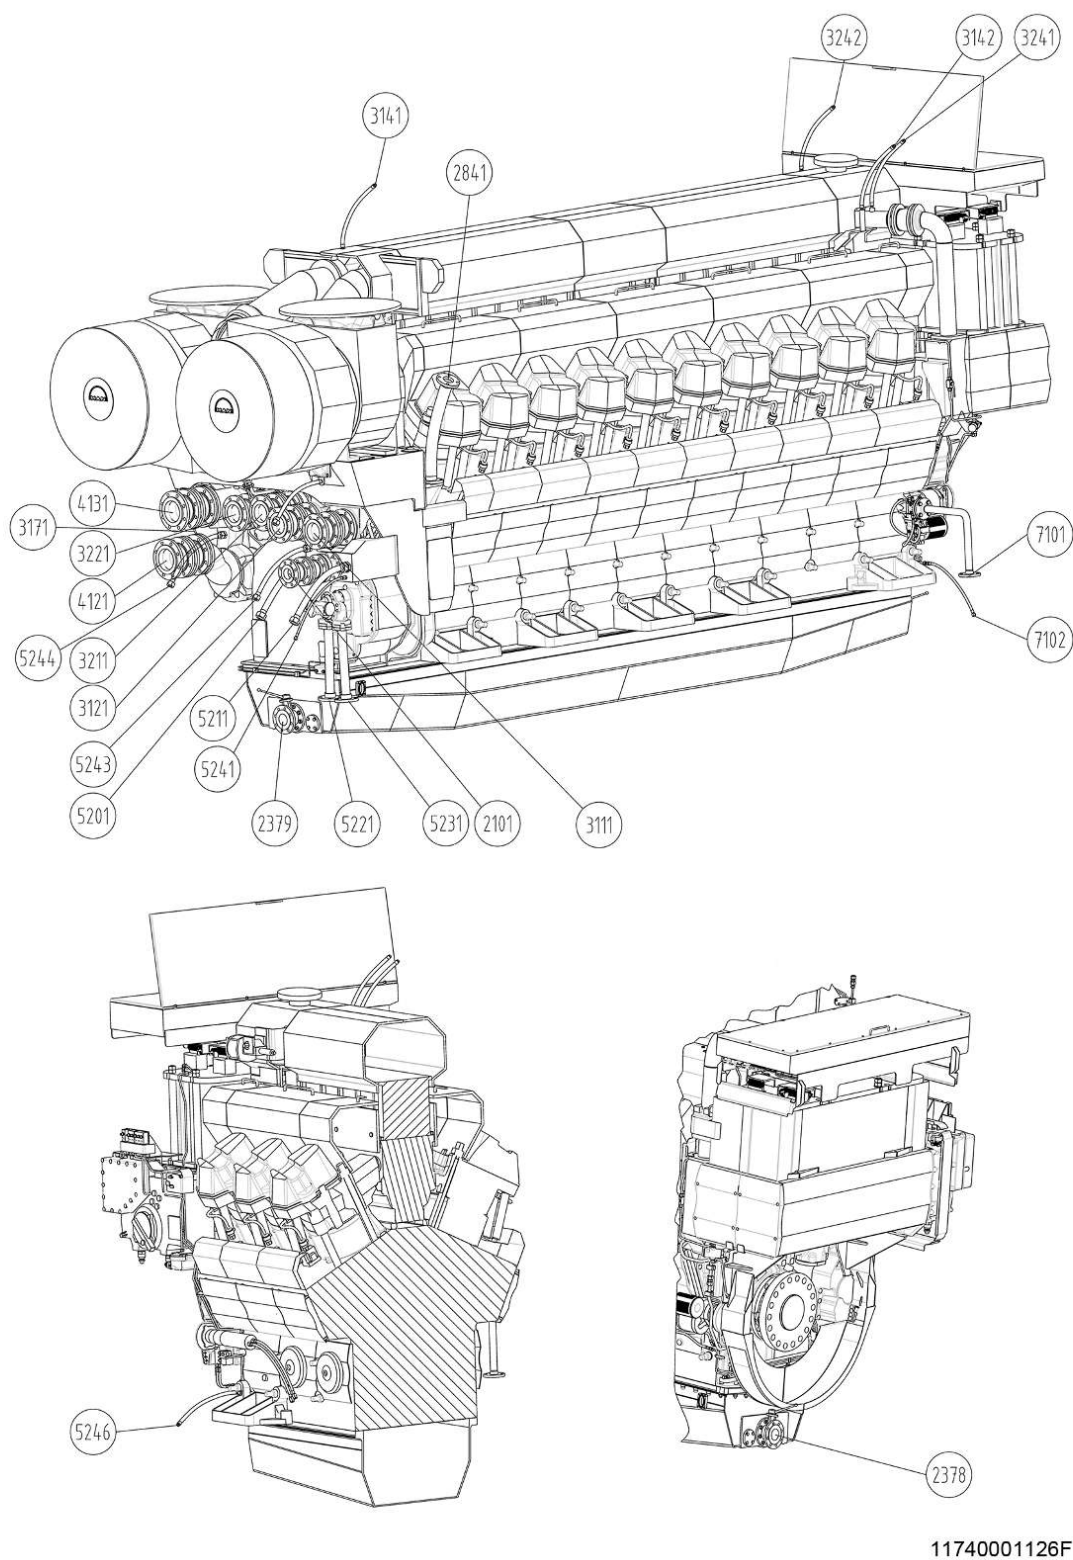


Figure 72: Example of installation of hoses

Anschluss Nr. Connection-No.	Benennung des Rohranschlusses Description of pipe connection	Rohrmaßung Pipe dimension	Bezeichnung des Anschlusses Code for connection part	Rohrverbindungen Pipe connection	Flussrichtung Flow direction
2101	Schmieröl lubricating oil	StR 88,9x3,2	EN 1092-1/01 A/DN80/PN16/S235JRG2	Doppelkompensator Double compensator	Eintritt Inlet
2378	Ablauf aus der Ölwanne Drain from oil pan	StR 88,9x3,2	EN 1092-1/01 A/DN80/PN16/S235JRG2	Kompensator Compensator	Austritt Outlet
2379	Ablauf aus der Ölwanne Drain from oil pan	StR 88,9x3,2	EN 1092-1/01 A/DN80/PN16/S235JRG2	Kompensator Compensator	Austritt Outlet
2841	Kurbelraumentlüftung crankcase venting	StR 88,9x3,2		Schlauch Hose-line	Austritt Outlet
3111	HT Kuehlwasser HT cooling water	StR 139,7x4,5	EN 1092-1/01 A/DN125/PN16/S235JRG2	Doppelkompensator Double compensator	Austritt Outlet
3121	HT Kuehlwasser HT cooling water	StR 139,7x4,5	EN 1092-1/01 A/DN125/PN16/S235JRG2	Doppelkompensator Double compensator	Eintritt Inlet
3141	Entlüftung HT Kuehlwasserleitung 1 air vent HT cooling water pipe 1	StR 16x2	ISO 8434-1 - S16 DIN 3861 - S16-ST	Schlauch Hose-line	Austritt Outlet
3142	Entlüftung HT Kuehlwasserleitung 2 air vent HT cooling water pipe 2	StR 16x2	ISO 8434-1 - S16 DIN 3861 - S16-ST	Schlauch Hose-line	Austritt Outlet
3171	Kuehlwasservorwärmung cooling water preheat	StR 60,3x2,9	EN 1092-1/11 A/DN50/PN16/P265GH+N	Schlauch Hose-line	Austritt Outlet
3211	LT Kuehlwasser LT cooling water	StR 139,7x4,5	EN 1092-1/01 A/DN125/PN16/S235JRG2	Doppelkompensator Double compensator	Austritt Outlet
3221	NT Kuehlwasser NT cooling water	StR 139,7x4,5	EN 1092-1/01 A/DN125/PN16/S235JRG2	Doppelkompensator Double compensator	Eintritt Inlet
3241	Entlüftung NT Kuehlwasserleitung 1 air vent LT cooling water pipe 1	StR 16x2	ISO 8434-1 - S16 DIN 3861 - S16-ST	Schlauch Hose-line	Austritt Outlet
3242	Entlüftung NT Kuehlwasserleitung 2 air vent LT cooling water pipe 2	StR 16x2	ISO 8434-1 - S16 DIN 3861 - S16-ST	Schlauch Hose-line	Austritt Outlet
4121	Seewasser Pumpe sea water pump	StR 168,3x4,5	EN 1092-1/01 A/DN150/PN16/CuSn7Zn2Pb3	Doppelkompensator Double compensator	Eintritt Inlet
4131	Seewasser Pumpe sea water pump	DIN 86019-159x8 CuNi10Fe16Mn	EN 1092-1/01 A/DN150/PN16/CuNi10Fe16Mn	Doppelkompensator Double compensator	Austritt Outlet
5201	Kraftstoff fuel	StR 38x3,5	ISO 8434-1 - S38 DIN 3861 - BS38-ST	Schlauch Hose-line	Eintritt Inlet
5211	Kraftstoff fuel	StR 38x3,5	ISO 8434-1 - S38 DIN 3861 - BS38-ST	Schlauch Hose-line	Austritt Outlet
5221	Kraftstoff Foerderpumpe fuel supply pump	StR 76,1x2,9		Schlauch Hose-line	Eintritt Inlet
5231	Kraftstoff Foerderpumpe fuel supply pump	StR 76,1x2,9		Schlauch Hose-line	Austritt Outlet
5241	Leckkraftstoffablauf leakage fuel drain	StR 10x1,5	ISO 8434-1 - S10 DIN 3861 - BS10-ST	Schlauch Hose-line	Austritt Outlet
5243	Kraftstoffleckageablauf 1 fuel oil leakage drain 1	StR 25x2	ISO 8434-1 - S25 DIN 3861 - BS25-ST	Schlauch Hose-line	Austritt Outlet
5244	Kraftstoffleckageablauf 2 fuel oil leakage drain 2	StR 20x2	ISO 8434-1 - S25 DIN 3861 - BS25-ST	Schlauch Hose-line	Austritt Outlet
5246	Kraftstoffleckageablauf 3 fuel oil leakage drain 3	StR 25x2	ISO 8434-1 - S25 DIN 3861 - BS25-ST	Schlauch Hose-line	Austritt Outlet
7101	Anlassluft starting air	StR 48,3x2,6	EN 1092-1/11 B1/DN40/PN40/P245GH	Schlauch Hose-line	Eintritt Inlet
7102	Steuerluft 1 control air 1	StR 10x1,5	ISO 8434-1 - L10 DIN 3861 - BS10-ST	Schlauch Hose-line	Eintritt Inlet

11740001126F

Figure 73: Legend to example of installation of hoses

6.2.5 Condensate amount in charge air pipes and air vessels

Water vapour content of the air
[g water / kg air]

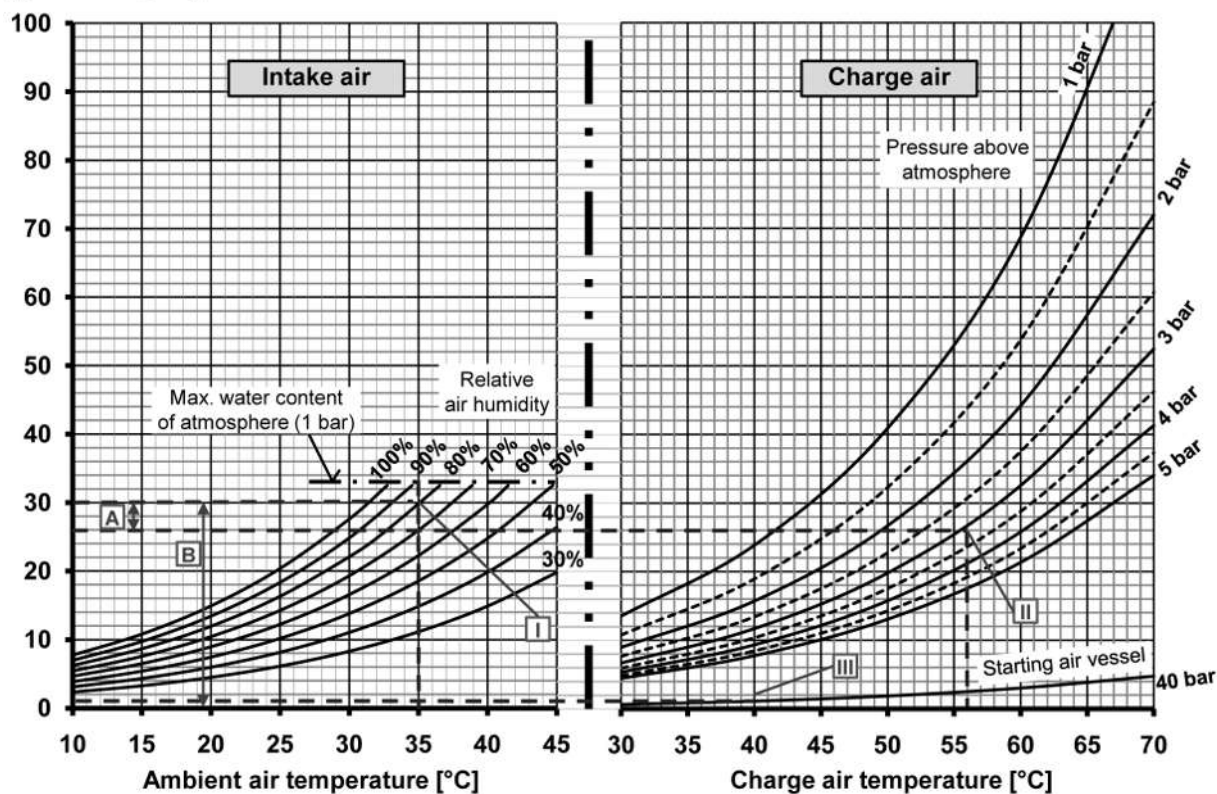


Figure 74: Diagram condensate amount

The amount of condensate precipitated from the air can be considerably high, particularly in the tropics. It depends on the condition of the intake air (temperature, relative air humidity) in comparison to the charge air after charge air cooler (pressure, temperature).

It is important, that no condensed water of the intake air/charge air will be led to the compressor of the turbocharger, as this may cause damages.

In addition the condensed water quantity in the engine needs to be minimised. This is achieved by controlling the charge air temperature.

How to determine the amount of condensate:

First determine the point I of intersection in the left side of the diagram (intake air), see figure [Diagram condensate amount, Page 189](#) between the corresponding relative air humidity curve and the ambient air temperature.

Secondly determine the point II of intersection in the right side of the diagram (charge air) between the corresponding charge air pressure curve and the charge air temperature. Note that charge air pressure as mentioned in section [Planning data, Page 79](#) is shown as absolute pressure.

At both points of intersection read out the values [g water/kg air] on the vertically axis.

The intake air water content I minus the charge air water content II is the condensate amount A which will precipitate. If the calculations result is negative no condensate will occur.

For an example see figure [Diagram condensate amount, Page 189](#). Intake air water content 30 g/kg minus 26 g/kg = 4 g of water/kg of air will precipitate.

To calculate the condensate amount during filling of the starting air receiver just use the 40 bar curve (see figure [Diagram condensate amount, Page 189](#)) in a similar procedure.

Example how to determine the amount of water accumulating in the charge air pipe

Parameter	Unit	Value
Engine output (P)	kW	9,000
Specific air flow (Ie)	kg/kWh	6.9
Ambient air condition (I):		
Ambient air temperature	°C	35
Relative air humidity	%	80
Charge air condition (II):		
Charge air temperature after cooler ¹⁾	°C	56
Charge air pressure (over pressure) ¹⁾	bar	3.0
Solution according to above diagram		
Water content of air according to point of intersection (I)	kg of water/kg of air	0.030
Maximum water content of air according to point of intersection (II)	kg of water/kg of air	0.026
The difference between (I) and (II) is the condensed water amount (A)		
$A = I - II = 0.030 - 0.026 = 0.004$ kg of water/kg of air		
Total amount of condensate Q_A :		
$Q_A = A \times Ie \times P$		
$Q_A = 0.004 \times 6.9 \times 9,000 = 248$ kg/h		
¹⁾ In case of two-stage turbocharging choose the values of the high-pressure TC and cooler (second stage of turbocharging system) accordingly.		

Table 102: Example how to determine the amount of water accumulating in the charge air pipe

Example how to determine the condensate amount in the starting air receiver

Parameter	Unit	Value
Volumetric capacity of tank (V)	litre	1,500
	m ³	1.5
Temperature of air in starting air receiver (T)	°C	40
	K	313
Air pressure in starting air receiver (p _{above atmosphere})	bar	40
Air pressure in starting air receiver (p _{absolute})	bar abs	41
		41×10^5

Parameter	Unit	Value
	$\frac{N}{m^2}$	
Gas constant for air (R)	$\frac{Nm}{kg \times K}$	287
Ambient air temperature	°C	35
Relative air humidity	%	80
Weight of air in the starting air receiver is calculated as follows:		
$m = \frac{p \times V}{R \times T} = \frac{41 \times 10^5 \times 1.5}{287 \times 313} = 68.5 \text{ kg}$		
Solution acc. to above diagram:		
Water content of air according to point of intersection (I)	kg of water/kg of air	0.030
Maximum water content of air according to point of intersection (III)	kg of water/kg of air	0.001
The difference between (I) and (III) is the condensed water amount (B)		
B = I – III		
B = 0.030 – 0.001 = 0.029 kg of water/kg of air		
Total amount of condensate in the vessel Q _B :		
Q _B = m x B		
Q _B = 68.5 x 0.029 = 1.99 kg		

Table 103: Example how to determine the condensate amount in the starting air receiver

6.3 SaCoS Engine Room Automation

6.3.1 SaCoS ERA system overview

The engine is equipped with the latest generation of Everllence engine control- and safety system SaCoS 5000 (Safety and Control System) for four-stroke diesel- and gas engines including SaCoS ERA (Engine Room Automation). SaCoS ERA is a part of SaCoS 5000 and a consequent development of the existing automation. It is an architectural adaptation within the SaCoS 5000 and offers several advantages by dividing the functions into engine-related and vessel system-related functions, without losing its integrity and reliability. SaCoS ERA consists of an EEC (Engine Environment Cabinet) which decouples vessel system-related functions and thus gives the shipyard more flexibility and provides specially tailored the customer needs. The EEC is capable to serve up to three engines within one engine room at marine application. Therefore, SaCoS ERA saves construction space. SaCoS ERA forms the basis for forward-looking developments and prepares the system for future requirements from the market and regulations.

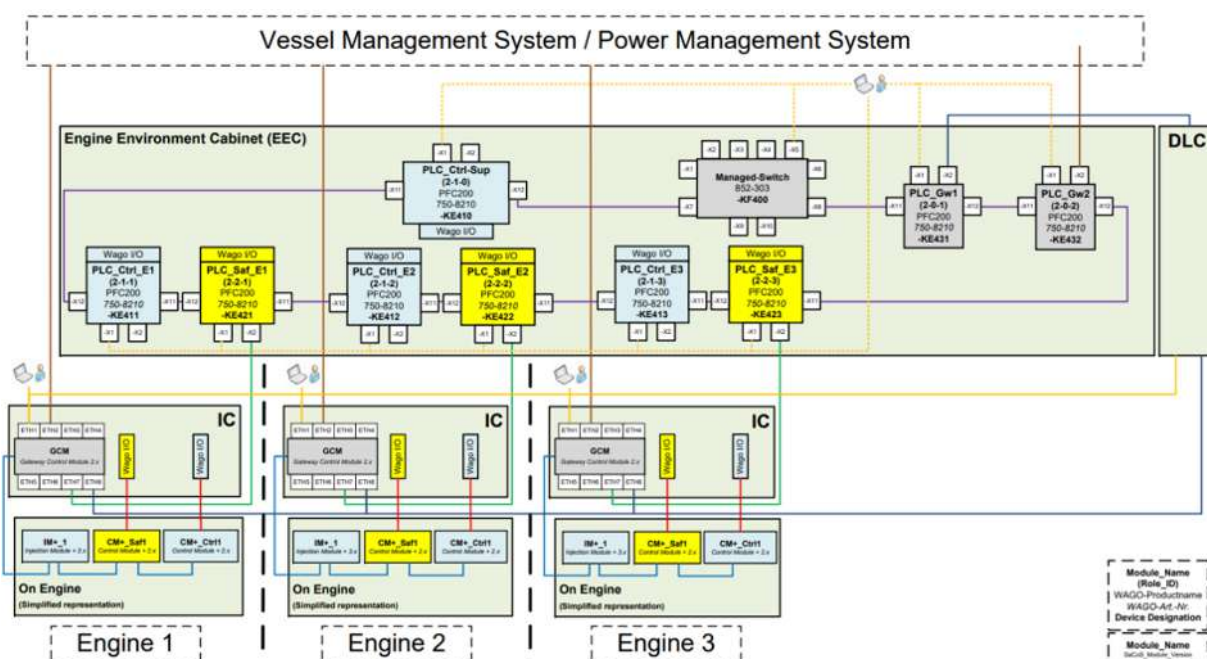


Figure 75: SaCoS ERA system architecture (example for three engines)

Engine Environment Cabinet The Engine Environment Cabinet (EEC) is a floor-standing cabinet. The EEC for one engine contains the general part and the control parts for the first engine. Due to the modular cabinet design for more engines the EEC will be extended in case more engines are supported. However, the EEC always can be seen as one cabinet consisting of up to three cabinet modules.



Figure 76: SaCoS EEC (example for three engines)

6.3.2 Cybersecurity guidelines

6.3.2.1 Terms, abbreviations, and definitions

Term, abbreviation	Definition
G(C)M	Gateway (Communication) Module
DM	Display module
LOP	Local operating panel
ROP	Remote operating panel (see also WOP, wheel operating panel)
SCR	Selective catalytic reduction
IAS	Integrated alarm system (see also “customer network”)
PMS	Power management system
SDI	SaCoSone device image
EXPERT	Everllence tool for SaCoS parameterisation
Toolbox	(Virtual) device for parameterisation and backup/restore of SaCoS
RDP	Remote desktop protocol
CEON	Everllence service for recording engine data
DLC	Data logging cabinet
ER	Engine room
ECR	Engine control room
SaCoS	Safety and Control System
SL	SCR Single Line system (medium speed)
ML	SCR Multi Line system (high speed / 175D)
ROC	Remote operation centre
WBM	Web-based management
IC	Interface cabinet
eToken	SaCoS 5000 security token SaCoSone security token (Thales Group eToken 5110+)

Table 104: Terms, abbreviations, and definitions

6.3.2.2 System overview

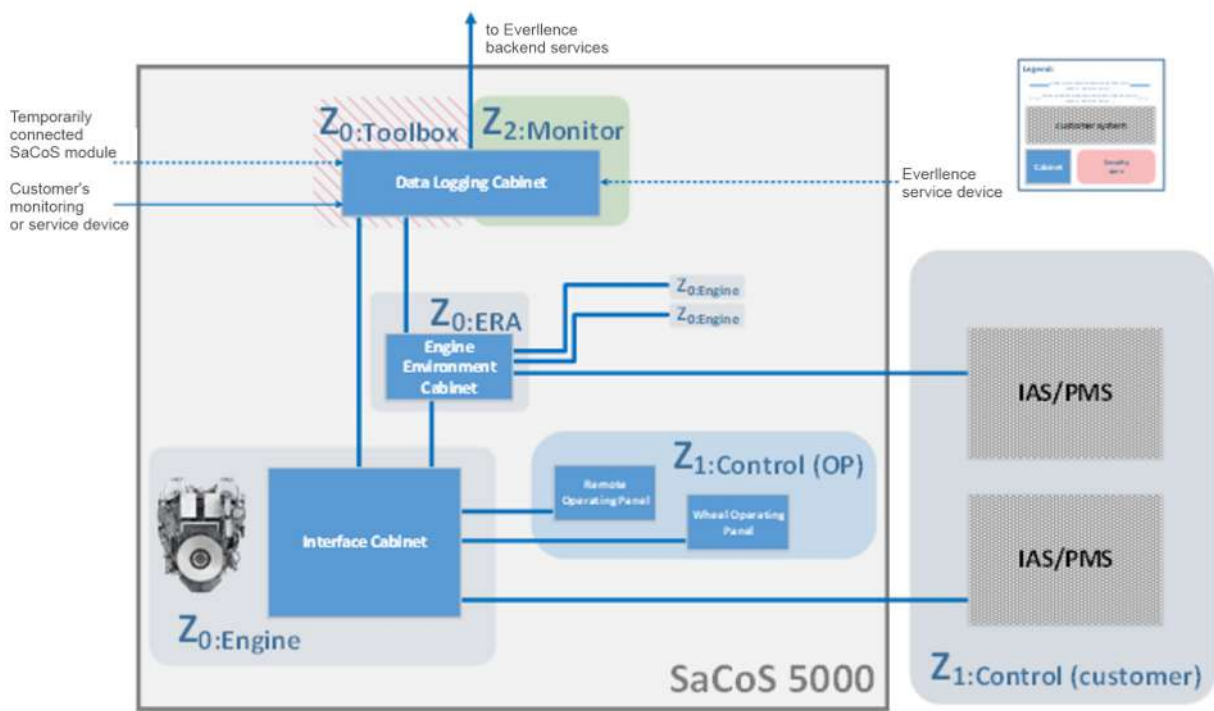


Figure 77: SaCoS 5000 Largebore with SCR and EngineVault: Zones and connections (simplified)

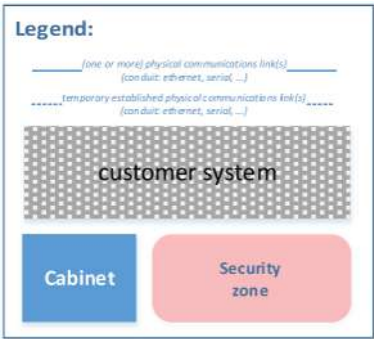


Figure 78: SaCoS-5000 Largebore with SCR and EngineVault Zones and connections (simplified) - Legend

Fig. SaCoS 5000 Largebore with SCR and EngineVault: Zones and connections (simplified):
Shows a simplified overview of the SaCoS 5000 system (Largebore version with SCR and EngineVault), and some of the relevant zones and connections.

Fig. SaCoS 5000 Largebore with SCR and EngineVault: Zones and connections (simplified) – Legend:
Shows the legend for the simplified overview of the SaCoS 5000 system (Largebore version with SCR and EngineVault).

The system is divided into the following main security zones:

- **Z_{0:Engine}**: Devices in this zone implement the main functionality of the engine control system.
- **Z_{0:ERA}**: Devices in this zone implement the Engine Room Automation functionality and enable local monitoring and control of the ERA system.

- **Z_{1:Control(OP)}**: This zone contains the control panels (including, for example, the ROP and WOP) that enable local monitoring and control of the engine control system.
- **Z_{1:Control(customer)}**: This zone contains the ship's integrated alarm and/or power management system(s) (IAS/PMS).
- **Z_{2:Monitor}** and **Z_{0:Toolbox}**: These zones (not included in all SaCoS variants) include virtualised and physical devices that implement local/remote monitoring and logging of control system data, and enable local/remote system parameterisation, including restoring system backups to SaCoS modules that are temporarily connected to the Data Logging Cabinet (DLC) for this purpose. To obtain limited, secure and interactive access to the Jump host (also called *Engine Vault PC* in SaCoS) in the DLC and to use the described functionality, the user can connect to the system with their own device via the network connection provided for this purpose in the DLC.

The majority of the devices making up the control system are installed in locked control cabinets or units. These must be set up in restricted locations such as engine rooms (ER) and engine control rooms (ECR). For further cyber security information, please also see the Project Guide for the SaCoS 5000 engine control system.

6.3.2.3 Physical security of SaCoS

Due to their design, some SaCoS devices and communication links must be physically protected against unauthorised access at all times (i.e., including during commissioning). Only authorised and authenticated personnel may have access to these devices and connections. Such access must be logged.

The security of these protections should be assessed by the customer, taking into account the system context, system purpose, system location, assumptions about current and future threats to the customer's business, and applicable regulations.

6.3.2.4 Secure access and storage of SaCoS data

It is necessary to keep the data created by or for SaCoS secure and protected against access by third parties.

6.3.2.5 Securing Z_{1:Control(Customer)}

Z_{1:Control(Customer)} must be a trusted network in the sense of IACS UR E27. It is also recommended to further segment this network so that each zone of the SaCoS system that requires a connection to this zone communicates with a separate **Z_{1:Control(Customer)}** segment.

In addition, a compromised SaCoS can pose a threat to customer networks and devices, and infect or compromise the customer systems within. The operator/integrator can implement additional measures such as installing additional network security devices to protect against this threat.

6.3.2.6 Maintaining network segmentation

Network segmentation is one of SaCoS's key protection measures. Therefore, the network structure set up by Everllence must not be changed.

Specifically, the following guidelines should be adhered to:

- Individual network segments must not be bridged (e.g. by connecting a device to several segments at the same time, connecting network switches from different segments to each other, or connecting devices from one segment to other segments).
- No additional devices may be connected to the SaCoS network segments.

6.3.2.7 Preparation for security incidents

Residual risks may remain even if the present guidelines are followed. The customer should prepare for possible security incidents in order to be able to react to them quickly. This includes the creation of an *incident response plan*, which should address the following points, among others:

- Obtain spare parts to replace SaCoS modules that have failed or been compromised due to an attack.
- If changes are made to the system (e.g. parameterisation of the system), these changes should be saved accordingly.
- Report the security incident to Everllence via a secure channel and follow the instructions.
- Save all data relevant to the cause (may require assistance from the engine manufacturer's 1st level support). This includes, but is not limited to, the access logs and general audit logs generated by the customer, customer devices, and the plant.
- Analyse the data and take steps to address the vulnerability that led to the incident.

The customer is also instructed to monitor the system for indications of a possible security incident to the extent possible.

6.3.2.8 Safe disposal

The customer is responsible for the security of potentially sensitive data when disposing of the devices.

6.3.2.9 User account management

The operator and service personnel are responsible for managing the access data for SaCoS devices.

6.3.2.10 Security incident report

The security incidents concerning SaCoS should be reported to Everllence PrimeServ.

6.3.3 Power supply

The plant has to provide electric power for SaCoS ERA. An uninterrupted 24-V DC power supply is required for SaCoS ERA marine application. According to the class rules, the voltages of the engines must be independent of each other, so that a voltage failure does not affect several engines.

Required power supplies

Consumer	Voltage	Notes
Engine Environment Cabinet for one engine	230 V 50/60 Hz	General part

Consumer	Voltage	Notes
	230 V 50/60 Hz	General part
	24 V DC	General part
	24 V DC	Parts for the first engine
	24 V DC UPS	Parts for the first engine
Engine Environment Cabinet for two engines (additionally)	24 V DC	Parts for the second engine
	24 V DC UPS	Parts for the second engine
Engine Environment Cabinet for three engines (additionally)	24 V DC	Parts for the third engine
	24 V DC UPS	Parts for the third engine

Table 105: Required power supplies

6.3.4 Interfaces

This interface serves for data exchange to the vessel management system/ power management system. The interface is actuated with MODBUS protocol and is available as Ethernet interface (MODBUS over TCP/IP).

6.3.5 Technical data

Design

- Floor-standing cabinet with plinth and fan
- Cable entries: From below, through cabinet base
- Accessible by front door(s), doors with locks
- Opening angle: 90°
- Standard colour: Light grey (RAL7035)
- Ingress protection: IP54

Dimensions and weights

Cabinet	Dimensions (mm) including base			Approx. weight (kg)
	Width	Height	Depth	
Engine Environment Cabinet for one engine	800	2,100	400	approximately 400
Engine Environment Cabinet for one engine, equipped with air condition	1,150	2,100	400	approximately 460
Engine Environment Cabinet for two engines ¹⁾	1,400	2,100	400	approximately 700
Engine Environment Cabinet for two engines ¹⁾ , equipped with air condition	1,750	2,100	400	approximately 760
Engine Environment Cabinet for three engines ¹⁾	2,000	2,100	400	approximately 1000
Engine Environment Cabinet for three engines ¹⁾ , equipped with air condition	2,430	2,100	400	approximately 1080
1) The cabinets are connected as one unit to a bulkhead.				

Table 106: Dimensions and weights of cabinet

6.3.6 Installation requirements

The same installation requirements apply as described for SaCoS 5000 in the section [Installation requirements, Page 149](#).

6.4 Lube oil system

6.4.1 Internal lube oil system

To ease the installation of the V28/33D STC all core components of the lube oil system are already integrated in the engine design.

As a standard the engine is equipped with following attached equipment:

- Lube oil pump
- Oil sump for complete lube oil filling (2 different kinds available)
- Lube oil cooler
- Lube oil temperature control valve

- Lube oil duplex filter, optional: Alternatively lube oil automatic filter plus lube oil centrifugal filter

Not attached to the engine, but part of the delivery:

- Oil mist eliminator

Not included:

- Prelubrication pump (electric driven)
- Preheating unit

P-001/Lube oil pump

The V28/33D STC engine is not used for single engine plants. Therefore an electrically driven stand-by lube oil pump with 100% delivery capacity is not required by classification rules. However, if for any other reason an electrically driven 100% stand-by lube oil pump becomes necessary, contact Everllence.

The lube oil service pump draws the lube oil through suction strainers in the engine sump. The engine driven attached lube oil service pump has an integral pressure relief valve to prevent overpressurisation of the system when the oil is more viscous during cold conditions.

A main lube oil pump as spare is required to be on board according to class society. For design data of these lube oil pumps see sections [Planning data, Page 79](#), [Operating/service temperatures and pressures, Page 90](#) and [Filling volumes, Page 97](#).

Note:

Cold starting precautions:

If starting in cold conditions the service pump outlet pressure may exceed the maximum pressure of 8 bar (PT2170). Also, the differential pressure in the lube oil filter may exceed the maximum of 10 bar. Therefore, in cold conditions it is recommended that:

- Before starting the engine, lube oil is circulated by the prelubrication pump in order to absorb heat from the warm, upper part of the engine.
- After starting, the engine is allowed to idle; sensors PT2170 and filter differential pressure are monitored as speed is increased to ensure the maximum pressures are not exceeded.

HE-037/Engine attached lube oil cooler

Oil travels along a passage in the air manifold to the cooler and lube oil filter module mounted at the flywheel end of the engine above the flywheel itself. The cooler is of plate design and mounted horizontally flat on top of the filter module which also incorporates an integral oil thermostat valve.

The cooling medium passing the lube oil cooler is low temperature (LT) cooling water.

Between the main pump and the thermostat a supply is taken from the main feed line to a metal particle detector. This detector provides an additional high level of protection for the engine.

TCV-001/Lube oil temperature control valve

The thermostatic valve is a direct acting, pre-set wax element type, automatic temperature regulator fitted across the inlet and outlet of the cooler. As the oil warms the valve operates to divert more oil through the cooler to maintain it at the correct working temperature at engine inlet.

Filtration of lube oil

As standard the engine is equipped with a lube oil duplex filter. Optional a configuration with automatic filter and centrifuge is available.

FIL-002/Lube oil duplex filter

The duplex filter is equipped with filter elements of 25 µm absolute filter fineness. A changeover valve allows to change the elements in one filter chamber while the engine is running. See also figure [External lube oil system diagram including lube oil module with duplex filter \(standard\)](#), Page 208.

FIL-001/Lube oil automatic filter (optional)

The back washing/flushing of the filter elements is arranged in a way that lube oil flow and pressure will not be affected. The flushing discharge is led to the oil sump. The automatic filter is equipped with an integrated second filtration stage (50 µm absolute filter mesh). This second stage protects the engine from particles which may pass the first stage filter elements (30 µm absolute filter mesh) in case of any malfunction. See also figure [External lube oil system diagram including lube oil module with automatic filter \(optional\)](#), Page 210.

CF-008/Lube oil centrifugal filter (optional)

The engine is equipped with a centrifugal by-pass filter in case an automatic filter is installed to get the contamination out of the system. This filter removes contaminants through centrifugal force. The sludge is collected in the filter fleece which must be cleaned/removed regularly. The cleaned oil returns into to lube oil pan.

Indication and alarm of filters

Lube oil module with duplex filter

The duplex oil filter is equipped with differential pressure transmitters on its inlet and outlet ports. The pressure at these points is transmitted to the control panel and the differential pressure between the two is derived in the control software. An alarm is triggered when the differential pressure reaches 1 bar (rising).

Lube oil module with automatic filter


The engine mounted automatic filter is equipped with differential pressure gauges, to protect the filter cartridges and to indicate clogging condition of the filter. A high differential pressure is indicated as an alarm. The centrifugal filter has to be cleaned in given intervals. There is no indication at the centrifuge.

For details of the instrumentation, see section SaCoSone system overview.

PCV-007/Lube oil pressure relief valve


The pressure relief valve is integrated in the attached lube oil pump. By use of the pressure relief valve, a constant lube oil pressure at engine inlet is adjusted. The pressure relief valve is installed parallel to the attached lube oil pump. The return line of the valve is connected to the suction side of the pump.

Internal lube oil system – Exemplary

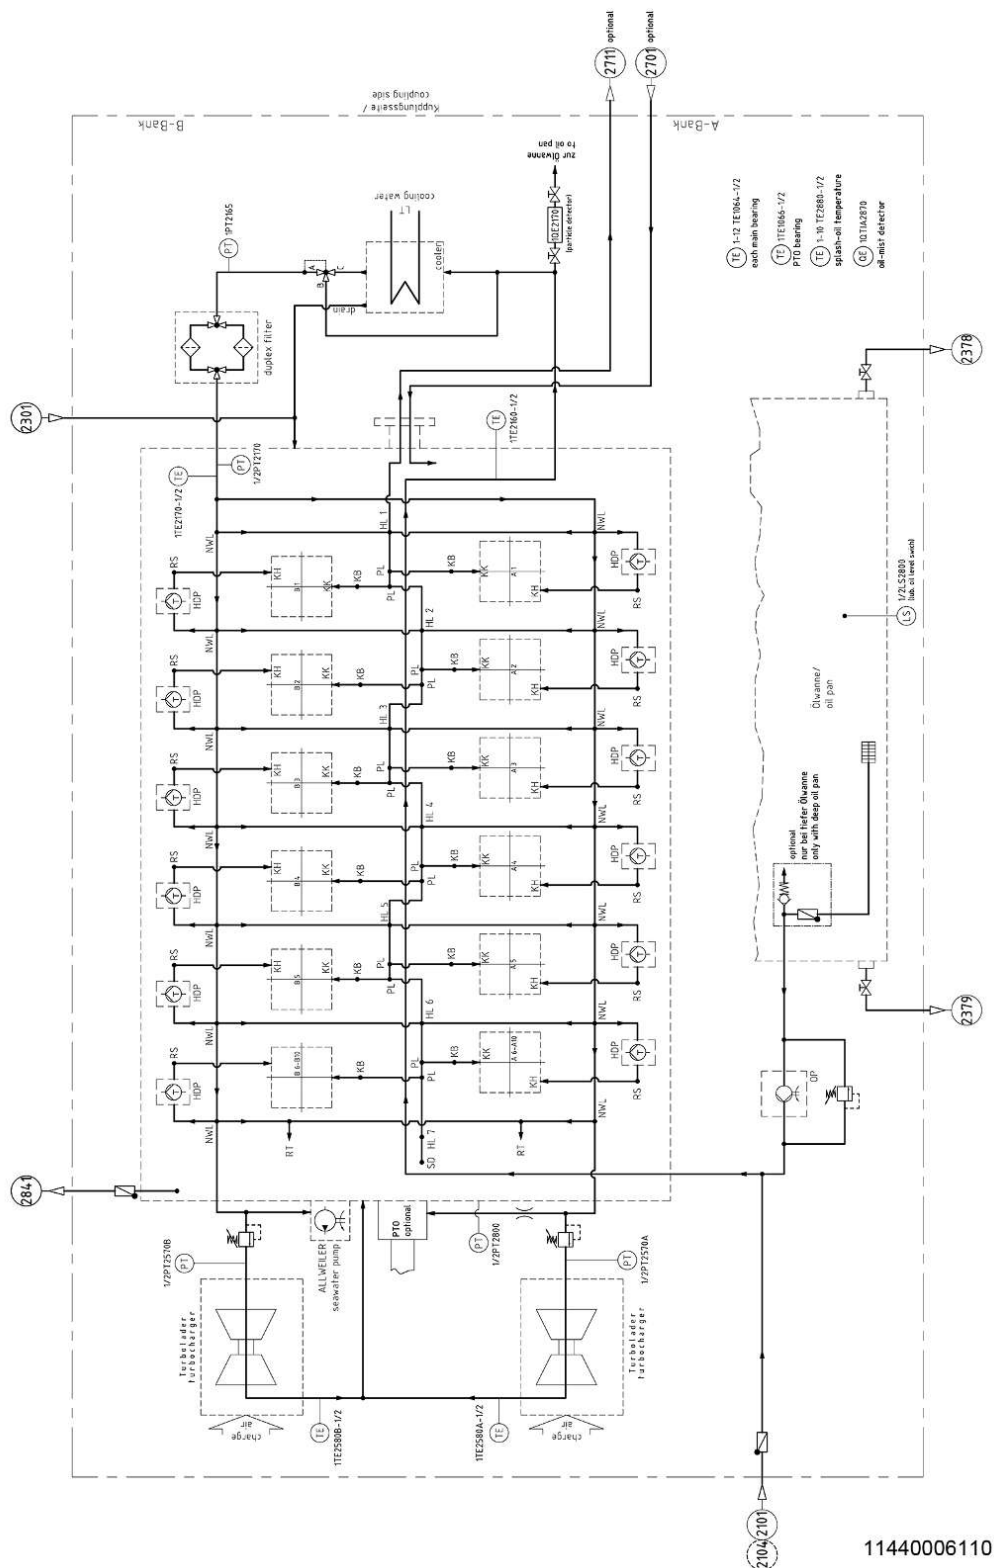

Meaning abbreviation	
HDP	High pressure fuel pump
HL	Main bearing
KB	Piston pin
KH	Rocker lever lubrication
KK	Piston cooling
KW	Crankshaft
NW	Camshaft
Connection numbers	
2101	Lube oil inlet to engine
2104	Lube oil inlet to engine for provisional lubrication
2301	Lube oil filling on engine
2378	Lube oil connection of oil pan, coupling side (CS)
NWL	Camshaft bearing
PL	Con-rod bearing
RS	Roller tappet
RT	Bearings gear drive
SD	Vibration damper
OP	Oil pump
2379	Lube oil connection of oil pan, coupling counter side (CCS)
2701	Lube oil inlet from coupling to crankshaft (optional)
2711	Lube oil outlet from crankshaft to coupling (optional)
2841	Venting of crankcase

Figure 79: Internal lube oil system – Exemplary for variant with lube oil duplex filter

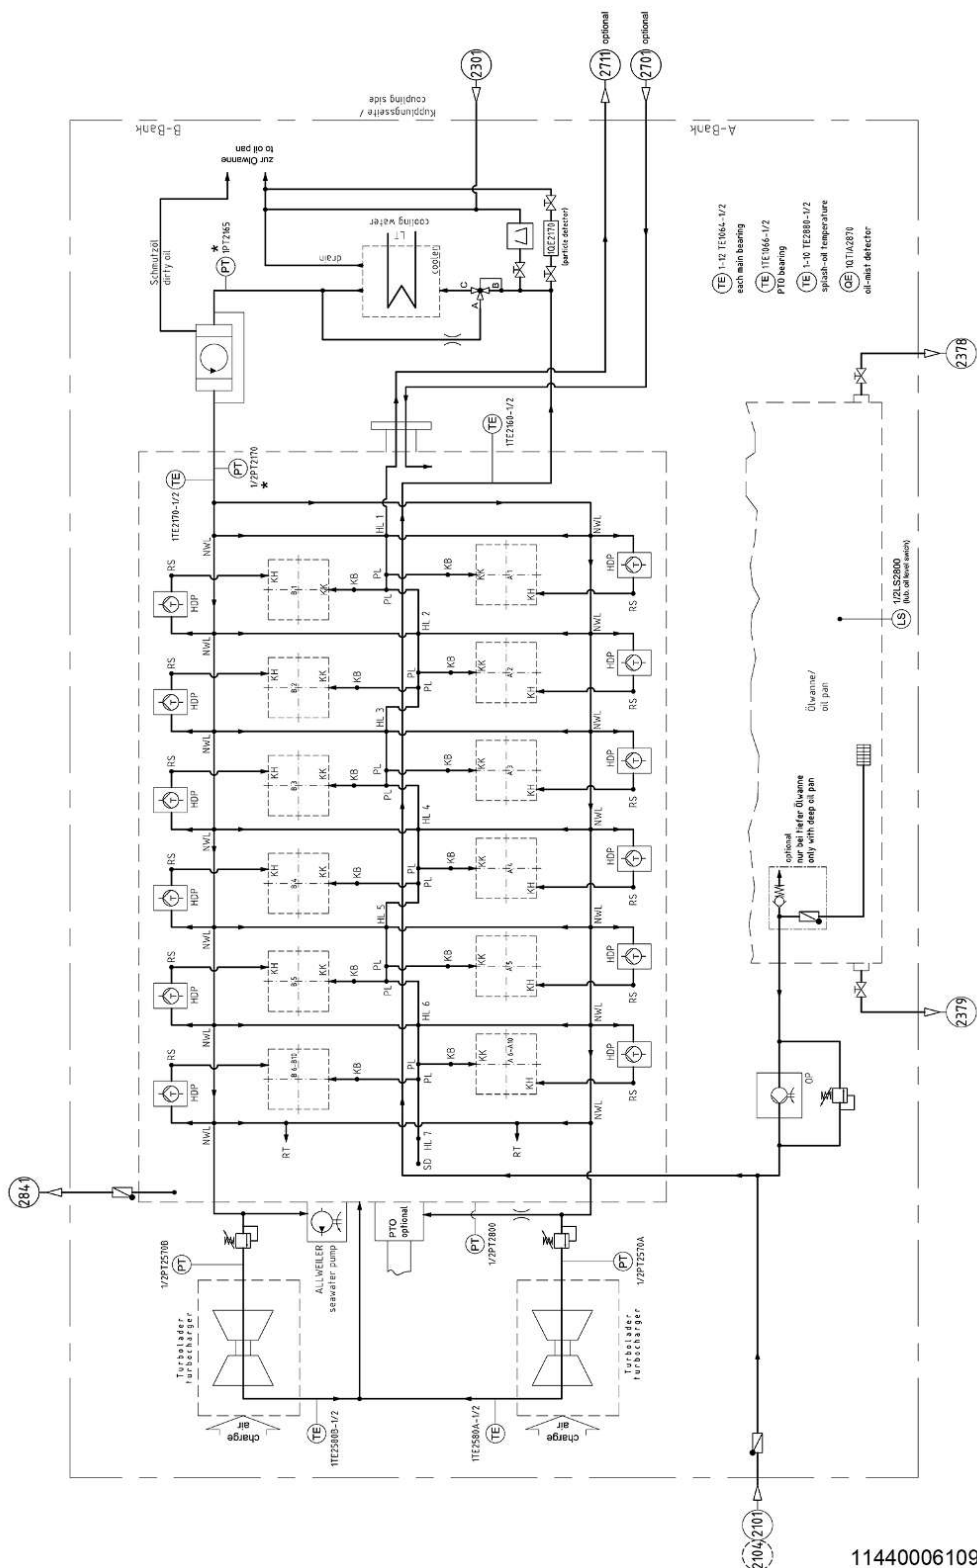

Meaning abbreviation	
HDP	High pressure fuel pump
HL	Main bearing
KB	Piston pin
KH	Rocker lever lubrication
KK	Piston cooling
KW	Crankshaft
NW	Camshaft
Connection numbers	
2101	Lube oil inlet to engine
2104	Lube oil inlet to engine for provisional lubrication
2301	Lube oil filling on engine
2378	Lube oil connection of oil pan, coupling side (CS)
NWL	Camshaft bearing
PL	Con-rod bearing
RS	Roller tappet
RT	Bearings gear drive
SD	Vibration damper
OP	Oil pump
2379	Lube oil connection of oil pan, coupling counter side (CCS)
2701	Lube oil inlet from coupling to crankshaft (optional)
2711	Lube oil outlet from crankshaft to coupling (optional)
2841	Venting of crankcase

Figure 80: Internal lube oil system – Exemplary for variant with lube oil automatic filter

Note:
The drawings show the basic internal media flow of the engine in general.
Project-specific drawings thereof don't exist.

6.4.2 External lube oil system

P-007/Prelubrication lube oil pump

The V28/33D STC engine is not used for single engine plants. Therefore an electrically driven stand-by lube oil pump with 100% delivery capacity is not required by classification rules. However, if for any other reason an electrically driven 100% stand-by lube oil pump becomes necessary, contact Everllence.

A prelubrication pump P-007 for pre- and postlubrication is necessary. The prelubrication pump draw oil through suction strainers in the engine sump. Dependent on the type of prelubrication pump, an orifice on the discharge side could be necessary to comply with the required differential pressure over the pump, given by the pump manufacturer.

The prelubrication pump is a positive displacement type fitted with a by-pass relief valve to protect the pump and system against overpressure. An interlock is fitted at the engine management (SaCoS) to prevent engine start if the pre-lubrication oil pressure is not detected or reached. The engine will be fully primed and available to start within 60 seconds of starting the prelubrication pump.

The prelubrication pump must be located as low as possible and close to the lube oil service tank to prevent cavitation. The pressure drop in the piping must not exceed the suction capability of the pump. With adequate diameter, straight lines and short length the pressure drop can be kept low.

For further information according this pump see section [Planning data, Page 79](#) and paragraph [Lube oil, Page 93](#).

After engine stop the postlubrication must be started and must persist accordingly to table [System circuit operation time after engine stop, Page 53](#). This is required to cool down the bearings of the turbocharger and hot inner engine components.

2026-02-24 - 6.2

Note:**Cold starting precautions:**

If starting in cold conditions the service pump outlet pressure may exceed the maximum pressure of 8 bar (PT2170). Also, the differential pressure in the lube oil filter may exceed the maximum of 10 bar. Therefore, in cold conditions it is recommended that:

- Before starting the engine, lube oil is circulated by the prelubrication pump in order to absorb heat from the warm, upper part of the engine.
- After starting, the engine is allowed to idle; sensors PT2170 and filter differential pressure are monitored as speed is increased to ensure the maximum pressures are not exceeded.

H-025/Lube oil preheater (optional)

For engine room temperatures below 5°C the HT cooling water preheater can be used to preheat the lube oil by circulating both media simultaneously through the engine. The prelubrication pump can be used for circulation of the lube oil through the engine. For temperatures significantly below 0°C a more powerful HT cooling water preheater must be provided and also the power of the electric motor and the suction ability of the prelubrication pump has to be adjusted to the highest possible lube oil viscosity. As alternative a separate lube oil preheating unit can be installed.

The same procedure can be used to keep the oil temperature above 40°C (start requirement) during stand-by operation of the engine.

A separate lube oil preheater or a HT cooling water preheater with higher capacity including a modified prelubrication pump can be supplied by Everllence. Contact Everllence for technical drawings of auxiliary equipment.

For low lube oil temperatures, heating up the lube oil can be achieved by circulating the lube oil via the pre-lubrication pump. For this purpose, oil pan connections 2378 (coupling side) and 2379 (coupling counter side) can be used to circulate the oil. Additional pipes and valves are required from Everllence. Recommended design pressure for complete system installation is PN16.

FIL-004/Lube oil suction strainer

The lube oil suction strainer protects the lube oil pumps against larger dirt particles that may have accumulated in the tank. It is recommended to use a cone type strainer with a mesh size of 1.5 mm. Two manometers installed before and after the strainer indicate when manual cleaning of filter becomes necessary, which should preferably be done in port.

BL-007/Fan, crankcase venting

To ensure that a slight vacuum is maintained within the crankcase and to remove the potentially hazardous mix of oil mist and combustion gas a motor driven extractor fan is fitted. The majority of oil mist condenses into droplets in the venting pipe and runs back into the engine, thus the pipework to the fan unit has to have a continuous rise. To ensure prolonged maintenance free operation we recommend that this pipework is installed at a minimum angle of 25°. If this angle is not achievable for part or all of the installation, manual drain points are to be fitted in the pipework at positions where the oil might collect. The crankcase vacuum is regulated by an extraction fan placed within

the engine venting pipe and regulated via a pressure transmitter placed on the crankcase. Distance between engine and venting fan shall be min. 7 metres and max. 10 metres.

Withdrawal points for oil sampling

A point for drawing lube oil samples is provided – the manual vent for the lube oil filter is used for this purpose. Looking on the flywheel, this vent is positioned on the right hand side of the oil filter casing, just above the manual sump filling point. There is enough room to enable a small sampling bottle to be positioned under the vent tap.

Piping system

As a minimum standard it is recommended to use pipes according to the pressure class PN 10. Lube oil prelubrication connections on the engine are PN 16.

MOD-064/Lube oil replenishing unit

This unit contains a lube oil suction strainer, see paragraph [FIL-004/Lube oil suction strainer, Page 206](#), a lube oil transfer pump and a flexible hose. The lube oil transfer pump P-012 supplies fresh oil from the lube oil storage tank to the operating tank. Starting and stopping of the lube oil transfer pump should preferably be done automatically by float switches fitted in the tank.

Suction pipes


Suction pipes must be installed with a steady slope and dimensioned for the total resistance (incl. pressure drop for suction filter) not exceeding the pump suction head. Before engine starts, venting of suction line must be warranted. Therefore the design of the suction line must be executed accordingly.

Requirements before commissioning of engine

The flushing of the lube oil system in accordance to the Everllence specification (see the relevant working instructions) before commissioning of the engine demands that all installations within the system are in proper operation. Be aware that special installations for commissioning are required.

Contact Everllence or licensee if any uncertainties occur.

External lube oil system diagrams

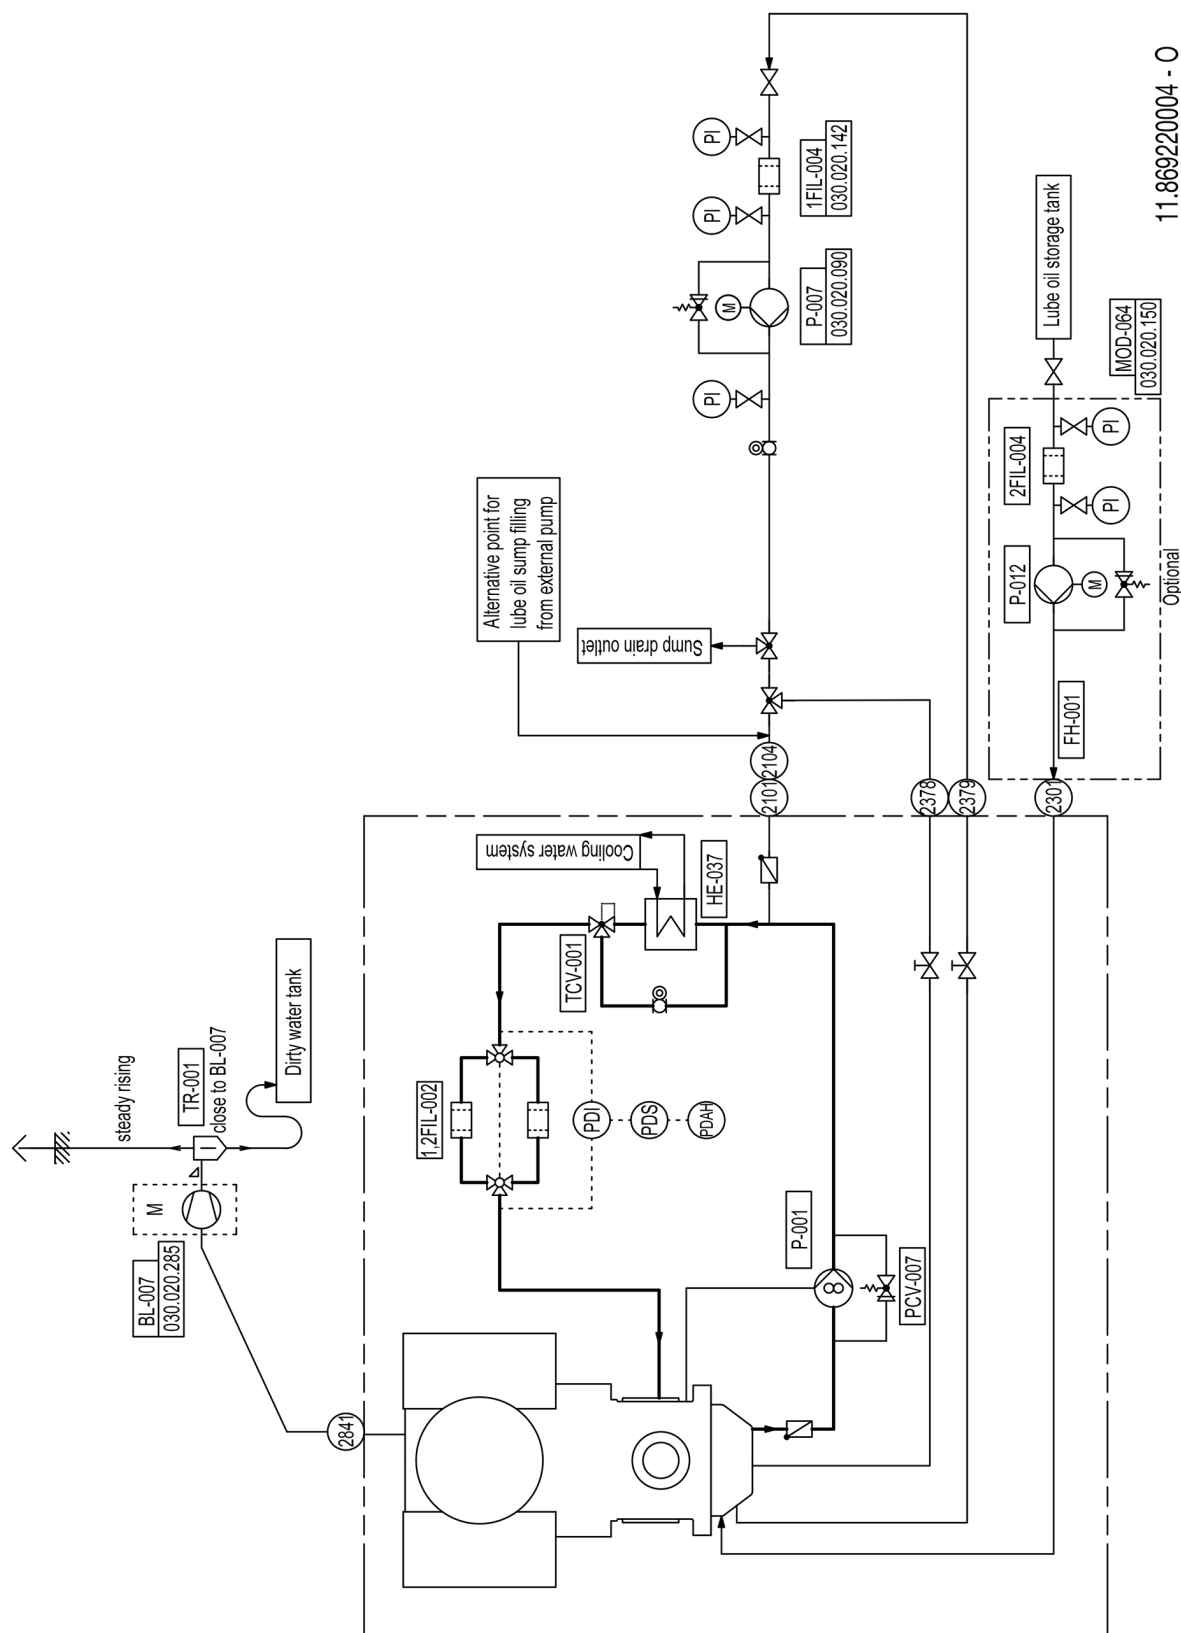


11.869220004 - O

Components	
FH-001	Flexible hose for lube oil replenishing unit
1,2FIL-002	Lube oil duplex filter
1,2FIL-004	Lube oil suction strainer
HE-037	Lube oil cooler main engine, at-tached
MOD-064	Lube oil replenishing unit (consists of P-012, 2FIL-004, FH-001)
P-001	Lube oil service pump, attached
Major engine connections	
2101	Lube oil inlet to engine
2104	Lube oil inlet for provisional lubrication
2301	Lube oil filling connection on base frame tank
P-007	Prelubrication pump
P-012	Lube oil transfer pump
PCV-007	Lube oil pressure relief valve
T-021	Sludge tank
TCV-001	Lube oil temperature control valve
TR-010	Oil mist eliminator with extraction fan
2378	Lube oil connection of oil pan, coupling side (CS)
2379	Lube oil connection of oil pan, coupling counter side (CCS)
2841	Venting of crankcase 1

Figure 81: External lube oil system diagram including lube oil module with duplex filter (standard)

2026-02-24 - 6.2

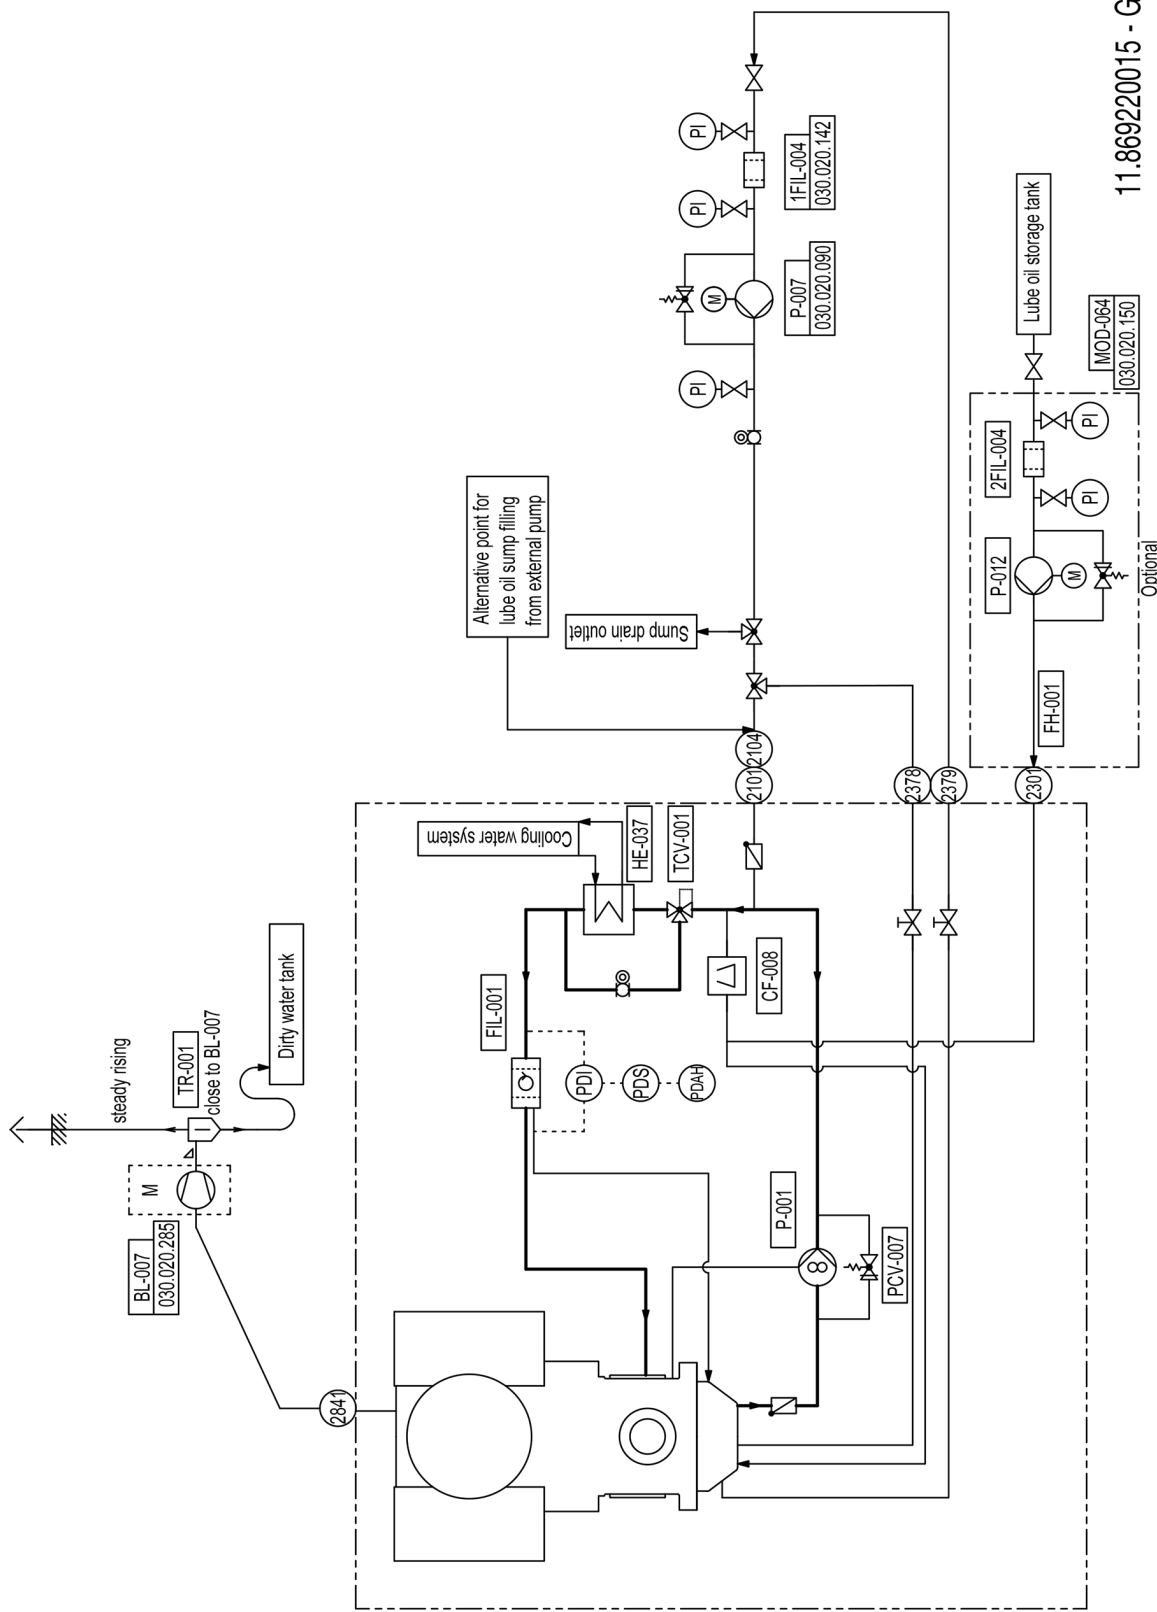

11.869220015 - G

Components	
CF-008	Lube oil centrifugal filter
FH-001	Flexible hose for lube oil replenishing unit
FIL-001	Lube oil automatic filter
1,2FIL-004	Lube oil suction strainer
H-025	Lube oil preheater
HE-037	Lube oil cooler main engine, at-tached
MOD-064	Lube oil replenishing unit (consists of P-012, 2FIL-004, FH-001)
Major engine connections	
2101	Lube oil inlet to engine
2104	Lube oil inlet for provisional lubrica-tion
2301	Lube oil filling connection on base frame tank
P-001	Lube oil service pump, attached
P-007	Prelubrication pump
P-012	Lube oil transfer pump
PCV-007	Lube oil pressure relief valve
BL-007	Fan, crankcase venting
TCV-001	Lube oil temperature control valve
TR-001	Condensate trap, lube oil systems
2378	Lube oil connection of oil pan, coup-ling side (CS)
2379	Lube oil connection of oil pan, coup-ling counter side (CCS)
2841	Venting of crankcase 1

Figure 82: External lube oil system diagram including lube oil module with automatic filter (optional)

6.4.3 Prelubrication/postlubrication

Prelubrication

The prelubrication pump must be switched on at least 5 minutes before engine start. The prelubrication pump serves to assist the engine attached main lube oil pump, until this can provide a sufficient flow rate.

For design data of the prelubrication pump see section [Planning data, Page 79](#) and paragraph [Lube oil, Page 93](#).

Postlubrication

The prelubrication pump is also to be used for postlubrication after the engine is turned off.

See table [System circuit operation time after engine stop, Page 53](#) for the required operation time.

6.4.4 Lube oil filling and outlets

Lube oil filling

The lube oil system can be manually filled from barrels and hand pump via the filling cap point (2361) situated on the oil filter housing on 'B' bank side, see section [Definitions, Page 295](#). Alternatively filling can be effected by transfer pump from an oil storage tank via the prelubricaton inlet pipe as indicated on the P&I diagram.

Lube oil drain

Assuming a suitable drain or holding tank is installed, the lube oil system can be drained by the installation of lockable three-way valve as indicated on the diagram. Alternatively single valve configurations can be used if it is the shipyard preference. The prelubricaton pump, in manual control, can then be used to empty the system. As a warning, this pump has a high flow rate and

2026-02-24 - 6.2

will empty a typical oil system on a 12V28/33D STC in less than 3 minutes. Lube oil holding or drain tanks, transfer pumps and associated pipework are all shipyard supply.

6.5 Crankcase vent


Crankcase pressure arising from blow-by of combustion gases past the piston rings is relieved through the crankcase venting, connection 2841. This pressure, if unrelieved, could cause leakage of lubricating oil through the crankshaft oil seals and ultimately crankcase explosion if left unchecked.

Under normal running conditions, the crankcase is filled with warm air laden with oil mist together with relatively small quantities of combustion gases that pass through the venting to the atmosphere.

In the event of a crankcase explosion, the sudden pressure rise is relieved through fast opening disc valves situated on the crankcase doors. The primary pressure wave is followed by a partial vacuum in the crankcase, which closes the valve and thus prevents the in-rush of a charge of air that could cause a secondary and more violent explosion.

Vent pipes

The vent pipe from the engine crankcase is to be arranged according to the following diagram. The required nominal diameter DN of the vent pipe is to be found in the legend following the diagram.

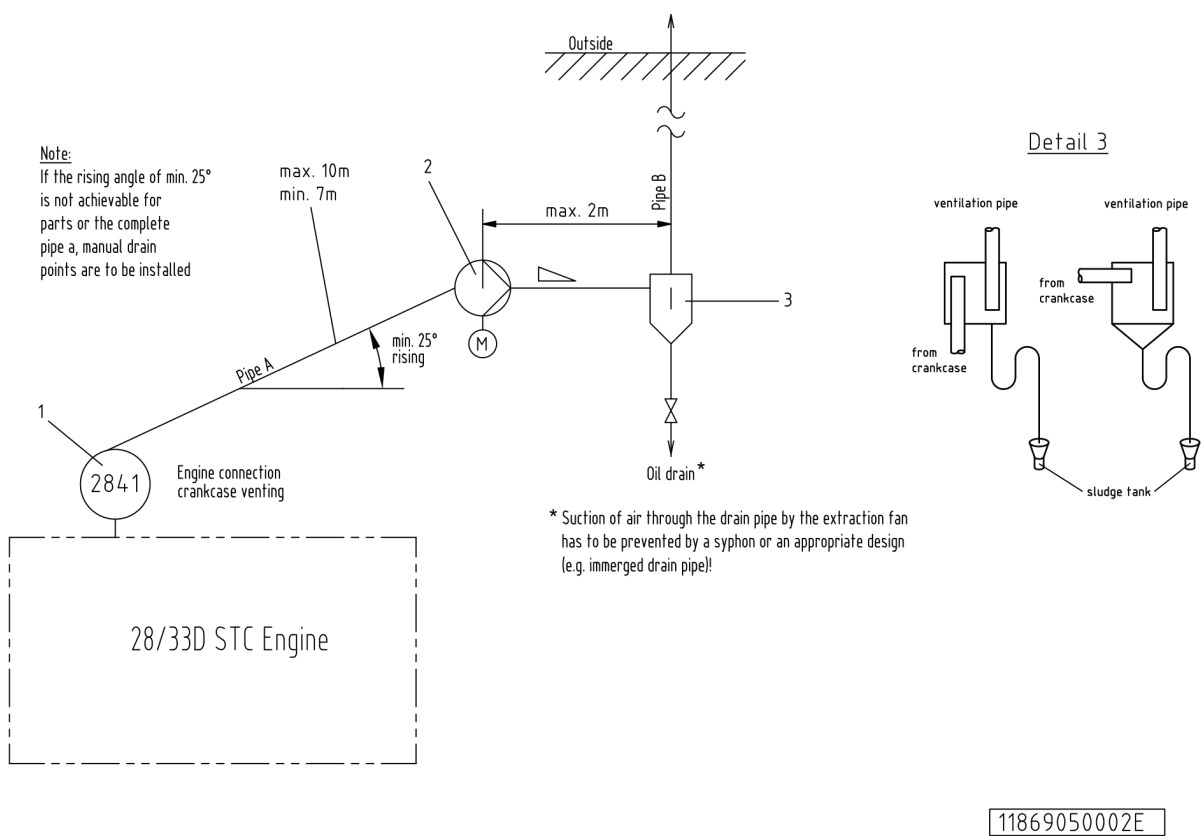

- 1 Connecting crankcase vent
2 Condensate trap

- 3 Condensate trap

Figure 83: Crankcase vent

Pipe	Length	Engine	Diameter
A	7–10 m	12V	DN 65
		16V	DN 80
		20V	DN 100
B	See fan curve	12V	DN 100
		16V	
		20V	

2026-02-24 - 6.2

6.6 Water systems

6.6.1 Cooling water system description

Introduction

The following is a description of a V28/33D STC marine cooling system and it is designed to suit the majority of installations. However, should it be absolutely necessary, the cooling water system can be tailored to suit the requirements of individual vessels. In this case Everllence should be consulted.

For the design data of the system components shown in the diagram (figure [External cooling water system diagram, Page 221](#)), see section [Planning data, Page 79](#).

The cooling water is to be conditioned using a corrosion inhibitor, see section [Specification of engine coolant, Page 165](#).

LT = low temperature

HT = high temperature

Cooler dimensioning, general

For coolers operated by seawater (not treated water), lube oil or fuel oil on the primary side and treated freshwater on the secondary side, an additional safety margin of 10% related to the heat transfer coefficient is to be considered. If treated water is applied on both sides, Everllence does not insist on this margin.

- If antifreeze agents must be used, consult Everllence beforehand. Antifreeze agents reduce the thermal heat capacity of the coolant. This can lead in some cases to insufficient cooling effect.

The cooler piping arrangement should include venting and draining facilities for the cooler.

As demanded by modern marine installations, to ensure minimum weight and physical size is attained, the main plate cooler/s are designed with very small margins. In order to achieve maximum cooler efficiency it is important that the design water flow rates within the systems are correct. Also, design flow rates should not be exceeded by more than 15% to avoid cavitation within the engine and its systems. Therefore, facility for flow restriction, in the form of either adjustable valves or orifice plates and bosses for instrumentation should be installed in the off engine pipework where shown on the P&ID see figure [External cooling water system diagram, Page 221](#).

Open/closed system

Open system

Characterised by "atmospheric pressure" in the expansion tank. Pre-pressure in the system, at the suction side of the cooling water pump is given by the geodetic height of the expansion tank (standard value 6–9 m above crankshaft of engine).

Closed system

In a closed system, the expansion tank is pressurised and has no venting connection to open atmosphere. This system is recommended in case the engine will be operated at cooling water temperatures above 100°C or an open expansion tank may not be placed at the required geodetic height. Use air separators to ensure proper venting of the system.

Venting**Note:**

Insufficient venting of the cooling water system prevents air from escaping which can lead to thermal overloading of the engine. Make sure that a minimum flow rate of 1% of the HT-cooling water flow given in section 2 is led from the engine HT-venting connection to the expansion tank at maximum engine speed.

The cooling water system needs to be vented at the highest point in the cooling system. Additional points with venting lines to be installed in the cooling system according to layout and necessity. In case engines may be operated on gas or low flashpoint fuels like methanol, all venting pipes have to be routed to open atmosphere.

If LT and HT string are separated, make sure that the venting lines are always routed only to the associated expansion tank. The venting pipe must be connected to the expansion tank below the minimum water level, this prevents oxydation of the cooling water caused by "splashing" from the venting pipe. We recommend to connect the venting pipes at the tank bottom. The expansion tank should be equipped with venting pipe and flange for filling of water and inhibitors.

In case a closed system with pressurised expansion tank is used, air separators have to be installed in the system.

Additional notes regarding venting pipe routing:

- The ventilation pipe should be continuously inclined (min. 5 degrees).
- At the interface to the system (engine connection terminal), the line must be continued directly with an elastic pipe connection (e.g. hose line).
- No additional masses such as shut-off valves, reducers, extensions, etc. may be attached to the engine-side connection terminal, since they represent an additional oscillating mass that can cause the line to break during operation.
- Venting pipes from several engine circuits may only be connected together if there are no longer any pressure differences between the individual pipes.
- It is to be avoided to merge venting pipes from low-temperature (LT) and high-temperature (HT) circuits, as a separate fault detection (e.g. lubricating oil or fuel in the cooling water) is no longer possible.
- No restrictions, no kinks in the ventilation pipes.
- Merging of ventilation pipes only permitted with appropriate cross-sectional enlargement.
- In case the engine HT cooling water may be cooled down in part load operation, a throttle valve has to be installed in the HT venting pipe to adjust the flow towards the expansion tank. The valve is recommended for plants with mixing systems, combustion air intake from outside the vessel, operation under arctic conditions or other special applications. In these cases, contact Everllence.

Draining

At the lowest point of the cooling system, a drain has to be provided. Additional points for draining to be provided in the cooling system according to layout and necessity, e.g. for components in the system that will be removed for maintenance.

We recommend using lockable valves or locking caps for sample and draining points to avoid opening by mistake.

6.6.2 Internal LT cooling water system

As a standard the engine is equipped with following attached equipment:

- Two-stage charge air coolers (1,2 HE-008), relevant 2nd stage for LT cooling water
- Lube oil cooler (HE-037)
- LT cooling water pump (P-004)

1,2 HE-008/LT stage of
two-stage charge air cooler

To cool down the charge air after compressor of the turbocharger the engine is equipped with a two-stage charge air cooler.

HE-037/Engine mounted
lube oil cooler

To cool down the lube oil, the engine is equipped with a plate type heat exchanger.


For the description see section [Lube oil system, Page 199](#). For the heat data, flow rates and tolerances see section [Planning data, Page 79](#). For the principal design criteria for coolers see paragraph [Cooler dimensioning, general, Page 214](#).

P-004/LT cooling water
pump

The LT cooling water pump is an engine driven centrifugal pump mounted about the center of the free end of the engine.

The engine driven LT pump circulates the water through the second stage of the charge air cooler and through the engine mounted lubricating oil plate cooler. The water then leaves the engine and is cooled by seawater in the main LT plate cooler. The pump inlet pipework should incorporate a connection to the header tank to ensure a positive pressure at the pump suction. For the LT water pump performance data see paragraph [HT and LT fresh water pump, Page 224](#).

Internal cooling water system (LT and HT) – Exemplary

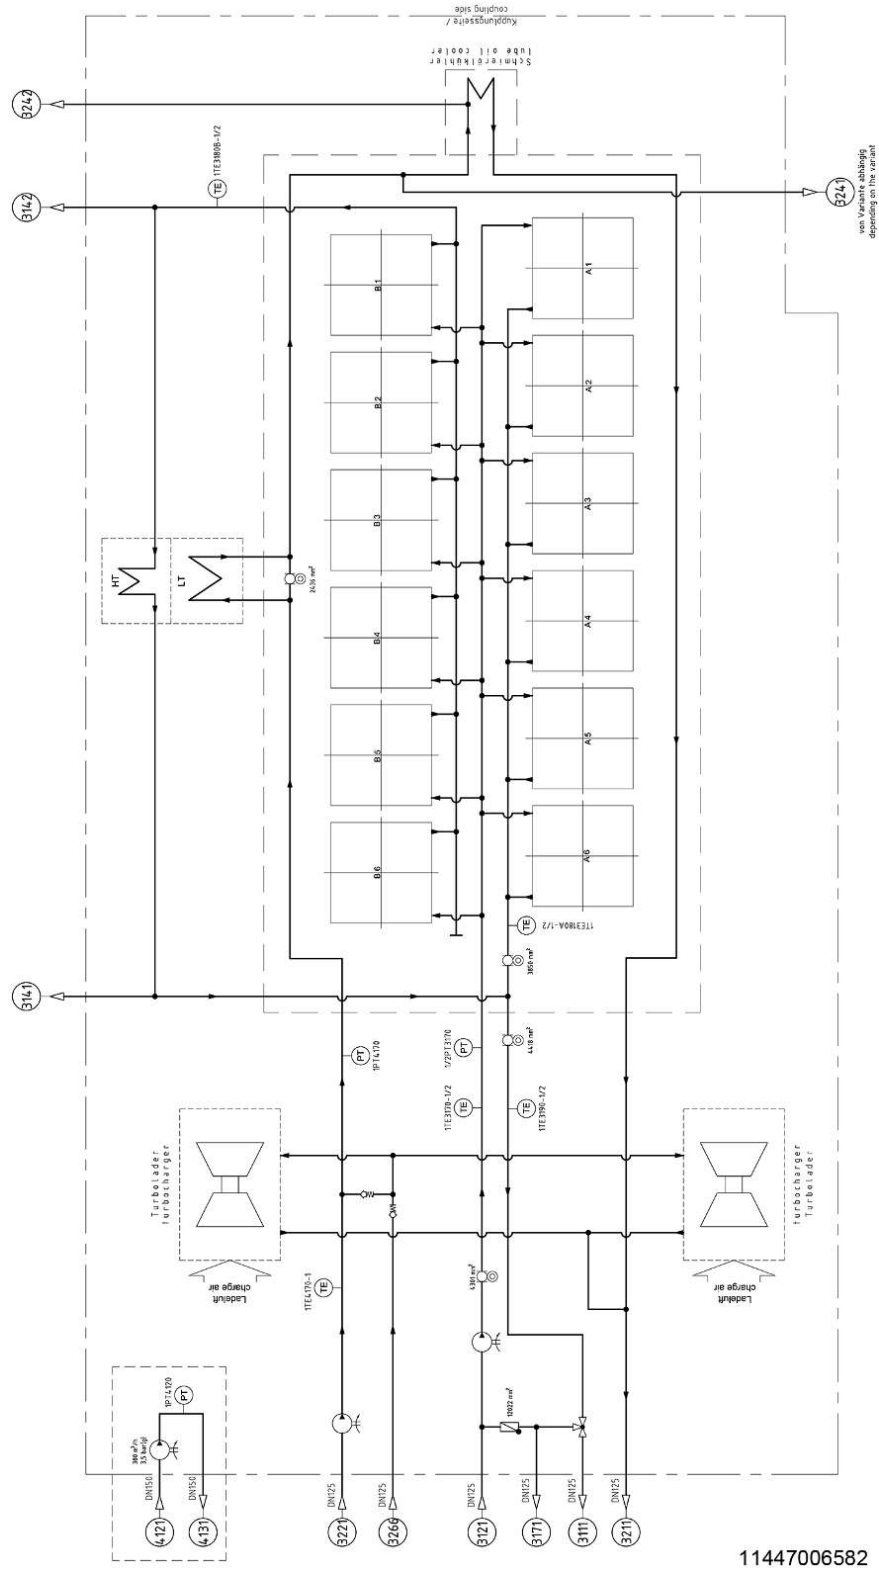

6.6 Water systems

6 Engine supply systems

Major engine connections

3111	HT cooling water outlet from engine	3221	LT cooling water inlet to cooling water pump
3121	HT cooling water inlet to cooling water pump	3241	Venting of LT cooling water pipe 1
3141	Venting of HT cooling water pipe 1	3242	Venting of LT cooling water pipe 2
3142	Venting of HT cooling water pipe 2	3266	Cooling water inlet for compressor post cooling
3171	HT cooling water outlet to preheater	4121	Seawater inlet to seawater pump
3211	LT cooling water outlet from engine	4131	Seawater outlet from seawater pump

Figure 84: Internal cooling water system (LT and HT) – Exemplary 12V engine

Note:

The drawing shows the basic internal media flow of the engine in general. Project-specific drawings thereof don't exist.

6.6.3 External LT cooling water system

TCV-016/LT cooling water temperature control valve

The cooling water temperature in the LT circuit is maintained by a three-way temperature control valve. For the standard configuration of the engine a wax type valve is used.

HE-024/Cooler for LT cooling water

The LT water is recooled by an external plate type heat exchanger. It is possible to either use a single LT cooling water cooler or a combined HT/LT cooling water cooler, see paragraph [HE-036/Combined cooler for HT/LT cooling water, Page 220](#).

For heat data, flow rates and tolerances of the heat sources see section [Planning data, Page 79](#). For the principal design criteria for coolers see paragraph [Cooler dimensioning, general, Page 214](#).

P-092/LT cooling water circulation pump

The pump serves for cooling of the compressor wheel casing of the turbocharger after engine shutdown. It has to be operated during prelubrication and postlubrication and remain in operation accordingly to table [System circuit operation time after engine stop, Page 53](#).

Everllence can supply a suitable pump.

1 FIL-021/Strainer for LT cooling water

In order to protect the engine and system components, several commissioning strainers are to be installed during the flushing process. We recommend a mesh size of 1–2 mm depending on the pipe diameter. To protect three-way valves and other sensitive components, we recommend to leave at least one strainer remaining in the piping of each system. Use stainless steel mesh material.

We recommend to install Y-type strainers with magnetic inserts. For further operation of the engine, we recommend to use a cartridge with mesh size of about 1 mm to catch particles. The strainers have to be installed in horizontal pipes or pipes with flow direction downwards.

HE-007/Fuel oil cooler

A fuel oil cooler is required to dissipate the heat of the fuel injection pumps during operation, see section [Fuel oil system, Page 224](#) for further details. One cooler is required per engine. In case the fuel oil cooler is recooled by seawater, we recommend to use a double wall type cooler.

T-103/Cooling water expansion tank

The expansion tank compensates changes in system volume and losses due to leakages and temperature changes. It is to be arranged in such a way, that the tank bottom is situated above the highest point of the system at any ship inclination. The expansion pipe should empty into the suction pipe as close to the pump as possible. For the required volume of the tank and the recommended installation height see section [Filling volumes, Page 97](#).

The fresh water contained within the engine systems will require treatment with an approved corrosion inhibitor additive and depending on location of operation, anti-freeze agent (see section [Specification of engine coolant, Page 165](#)).

Venting pipes from engine connections must be led to the expansion tank separately.

Contact Everllence for details concerning auxiliary equipment.

6.6.4 Internal HT cooling water system

As a standard the engine is equipped with following attached equipment:

- Two-stage charge air coolers (1,2 HE-010), relevant 1st stage for HT cooling water
- HT cooling water temperature control valve (TCV-002)
- HT cooling water pump (P-002)

1,2 HE-010/HT stage of two-stage charge air cooler

To cool down the charge air after compressor of the turbocharger the engine is equipped with a two-stage charge air cooler.

TCV-002/HT cooling water temperature control valve

The cooling water temperature in the HT circuit is maintained by a three way temperature control valve. For the standard configuration of the engine, a wax type valve is used. The HT valve is attached to the engine.

P-002/HT cooling water pump

The HT cooling water pump is an engine driven centrifugal pump mounted at the free end of the engine. The HT cooling water pump circulates the water through the engine (jacket water) and through the first stage of the charge air cooler. The water then leaves the engine and is cooled by seawater in the main HT plate cooler.

The pump inlet pipework should incorporate a connection to the expansion tank to ensure a positive pressure at the pump suction side.

For details concerning the HT water pump performance data see paragraph [HT and LT fresh water pump, Page 224](#).

Note:

See figure [Internal cooling water system \(LT and HT\) – Exemplary 12V engine, Page 217](#).

6.6.5 External HT cooling water system

MOD-004/HT cooling water preheating module

The HT circuit also includes a jacket water heater and pump module comprising an in-line thermostatically controlled electrical heater and a centrifugal circulating pump. This unit is operated when the engine is not running and in stand-by mode to maintain the jacket water temperature above 60°C. The engine has to be preheated to reduce thermal expansion by quick load step up. A temperature above 60°C also prevents corrosion at the engine that may be caused by condensed water in humid air environments. Required heating power is at least 30 kW. For operation in cold conditions (arctic), a higher heating capacity is required. Consult Everllence for further information.

Avoid an installation of the preheater in parallel to the engine driven HT pump. In this case, the preheater may not be operated while the engine is running. Preheaters operated on steam or thermal oil may cause alarms since a post-cooling of the heat exchanger is not possible after engine start (preheater pump is blocked by counter pressure of the engine driven pump).

HE-003/Cooler for HT cooling water	For heat data, flow rates and tolerances of the heat sources see section Planning data, Page 79 . For the description of the principal design criteria for coolers see paragraph Cooler dimensioning, general, Page 214 . It is possible to either use a single HT cooling water cooler or a combined HT/LT cooling water cooler, see paragraph HE-036/Combined cooler for HT/LT cooling water, Page 220 .
HE-026/Fresh water generator	The freshwater generator must be switched off automatically when the cooling water temperature at the engine outlet drops below 75°C continuously. This will prevent operation of the engine at too low temperatures. In case the HT temperature control valve attached to the engine is used, the valve will recirculate hot water and prevent the engine from cooling down.
T-103/Cooling water expansion tank	For information about the shared cooling water expansion tank see paragraph T-103/Cooling water expansion tank, Page 218 .
2 FIL-021/Strainer for HT cooling water	In order to protect the engine and system components, several commissioning strainers are to be installed during the flushing process. We recommend a mesh size of 1–2 mm depending on the pipe diameter. The suction strainer protects the pump and system against larger dirt particles. We recommend to install Y-type strainers with magnetic inserts. For further operation of the engine, we recommend to use a cartridge with mesh size of about 1 mm to catch particles. The strainers have to be installed in horizontal pipes or pipes with flow direction downwards.


6.6.6 Internal seawater system

P-093/Seawater pump	The seawater pump is an engine driven centrifugal pump mounted at the free end of the engine. The seawater pump serves to draw seawater directly from the ship's seawater chest into the circuit, through a suction strainer and a recommended non-return foot valve (both client supply), delivering the water to the main engine combined cooler for HT/LT cooling water. After removing heat from these circuits, the water is piped to overboard discharge. In case the engine is placed above the seawater line, an electrically driven pump has to be used instead of the attached seawater pump. Contact Everllence in this case. In any case the required NPSH values of the pump have to be considered for the design of the seawater system.
---------------------	---

6.6.7 External seawater system

HE-036/Combined cooler for HT/LT cooling water	The combined cooler saves weight and installation space compared to solutions by two separate coolers. On the other hand the maintenance of the combined cooler is more time consuming since some pipe connections have to be dismantled to clean the plates.
FIL-019/Seawater inlet filter	The suction strainer protects the pump and system against larger dirt particles. For vessels with only one sea chest a reversible duplex filter is recommended. The mesh size should be in a range of 2–4 mm. For vessels operating predominantly in sandy waters, a mesh size of 0.3–0.5 mm is recommended.

6.6.8 External cooling water system diagram

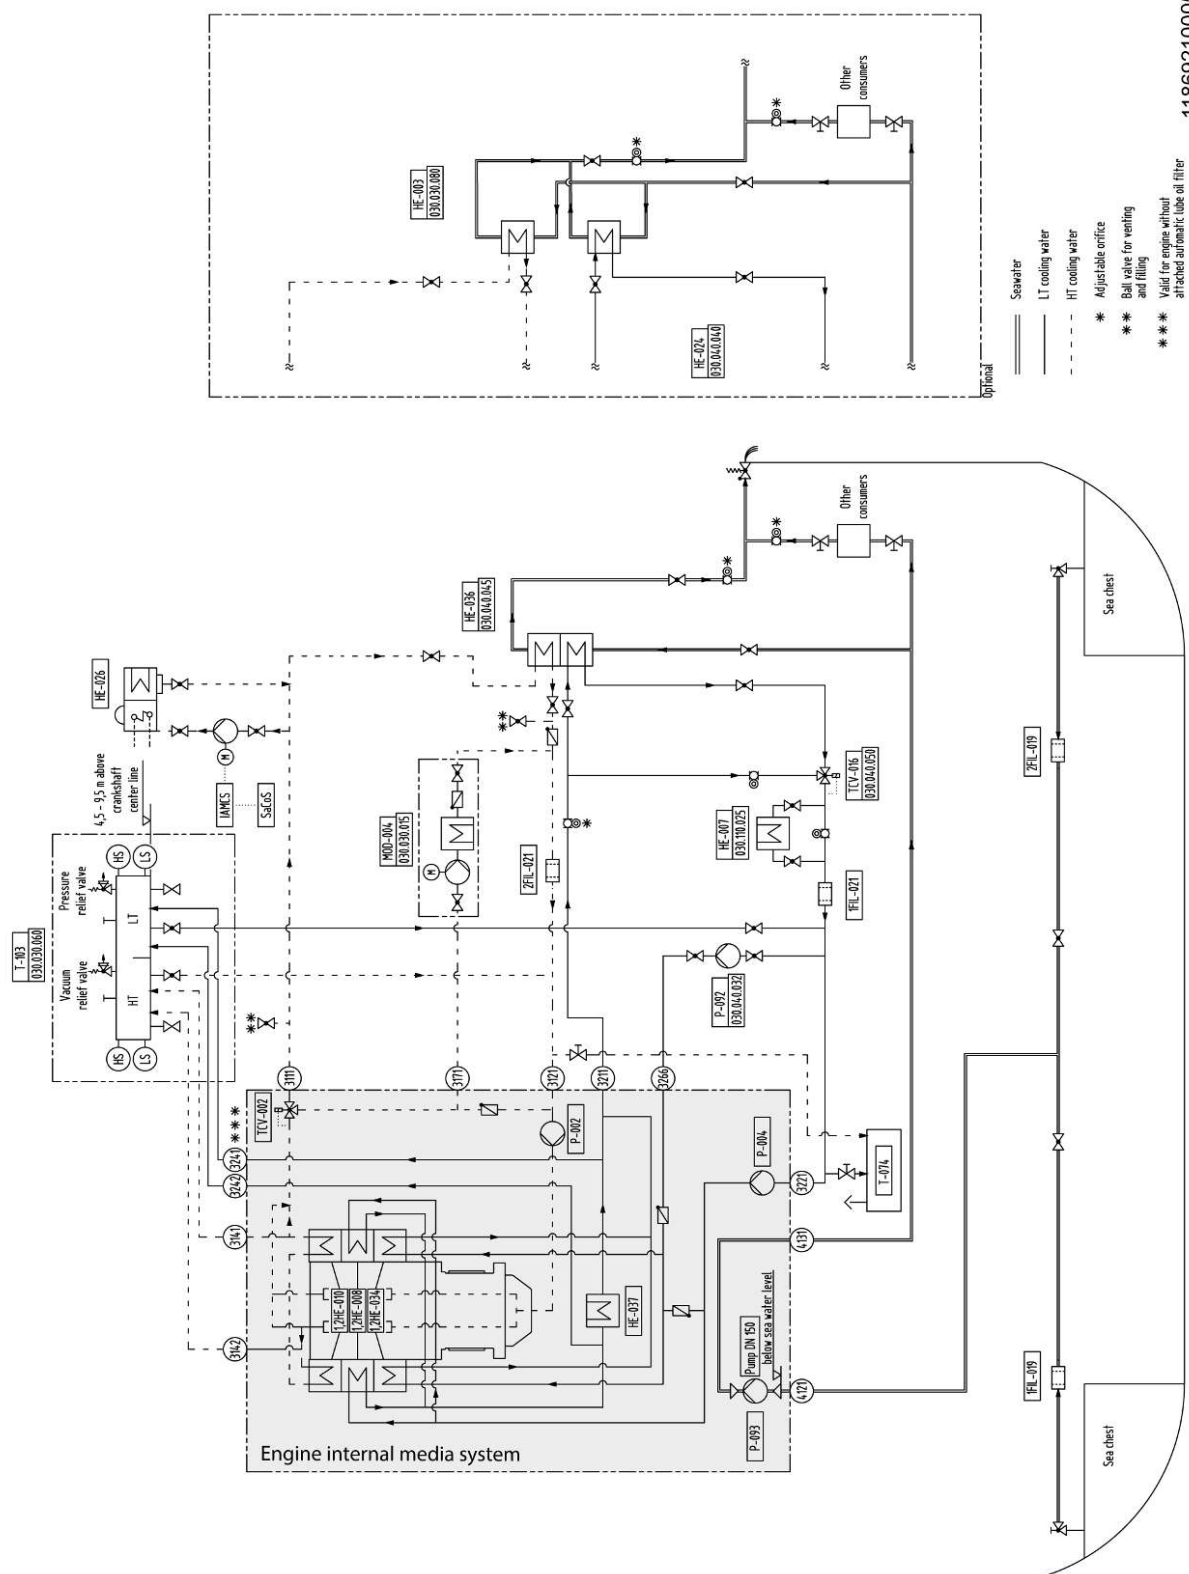

6.6 Water systems

6 Engine supply systems

Components	
1,2FIL-019	Seawater filter
1,2FIL-021	Strainer for cooling water
HE-003	Cooler for HT cooling water
HE-007	Fuel oil cooler
1,2HE-008	Charge air cooler (stage 2)
1,2HE-010	Charge air cooler (stage 1)
HE-024	Cooler for LT cooling water
HE-026	Fresh water generator
1,2HE-034	Compressor wheel casing (water cooled)
HE-036	Combined cooler for HT/LT cooling water
HE-037	Lube oil cooler main engine, attached
Major cooling water engine connections	
3111	HT cooling water outlet from engine
3121	HT cooling water inlet to cooling water pump 1
3141	Venting of HT cooling water pipe 1
3142	Venting of HT cooling water pipe 2
3171	HT cooling water outlet to preheater
3211	LT cooling water outlet from engine 1
MOD-004	HT cooling water preheating module
MOV-016	LT cooling water temperature control valve
P-002	HT cooling water service pump, attached
P-004	LT cooling water service pump, attached
P-092	LT cooling water circulation pump
P-093	Seawater service pump, attached
T-074	Fresh water collecting tank
T-103	HT/LT cooling water expansion tank
TCV-002	HT cooling water temperature control valve
TCV-016	LT cooling water temperature control valve
3221	LT cooling water inlet to cooling water pump
3241	Venting of LT cooling water pipe 1
3242	Venting of LT cooling water pipe 2
3266	LT cooling water inlet for compressor post cooling
4121	Seawater inlet to seawater pump
4131	Seawater outlet from seawater pump

Figure 85: External cooling water system diagram

6.6.9 External cooling water collecting and supply system

T-074/Cooling water collecting tank (not indicated in the diagram)

The tank is to be dimensioned and arranged in such a way that the cooling water content of both the HT and LT water circuits can be drained into it for maintenance purposes.

This is necessary to meet the requirements with regard to environmental protection (water has been treated with chemicals) and corrosion inhibition (re-use of conditioned cooling water).

Volumes for the engine are listed in table [Cooling water, fuel oil and oil volume of engine, Page 97](#).

P-031/Cooling water filling pump

To refill the HT- and LT cooling water system after maintenance, we recommend to install a cooling water filling pump. The pump shall be installed below the cooling water collecting tank with pipe connections to the related systems.

6.6.10 Miscellaneous items

Piping

Coolant additives may attack a zinc layer. It is therefore imperative to avoid using galvanised steel pipes. Treatment of cooling water as specified by Everllence will safely protect the inner pipe walls against corrosion.

Moreover, there is the risk of the formation of local electrolytic element couples where the zinc layer has been worn off, and the risk of aeration corrosion where the zinc layer is not properly bonded to the substrate.

See the working instructions 6682 000.16-01E for cleaning of steel pipes before fitting.

Pipes shall be manufactured and assembled in a way that ensures a proper draining of all segments. Venting is to be provided at each high point of the pipe system and drain openings at each low point. Make sure to use lockable ball valves or locking caps to prevent hot water leaving the system in case the valves are opened by mistake.

Cooling water pipes are to be designed according to pressure values and flow rates stated in section [Planning data, Page 79](#) and the following sections. Consider the maximal possible pressure level, that can be produced by the pumps (zero delivery head) integrated in the system and static pressure by expansion tanks or other equipment. The engine cooling water connections have to be designed according to PN10/PN16.

System instrumentation

For details of the instrumentation, see section SaCoSone system overview.

6.6.11 Water pump performance

Engine driven water pumps

The engine driven pumps may be delivered with various impeller diameters to adapt the pump capacity to the needs of the plant. Normally HT- and LT-pump are delivered with the same capacity.

Seawater pump

The seawater pump attached to the engine is designed for a wide range of capacity. The standard volume flow required for the seawater cooler is given in section [Planning data, Page 79](#). In case other consumers have to be supplied, the volume flow may be increased. In this case, the increased flow speed at the suction side of the pump can cause some underpressure upstream of the pump. Consider underpressure and increased NPSH value in the calculation of the system. For further information contact Everllence.

By use of orifices (yard supply) the delivery capacity of the seawater pump has to be adjusted in order to avoid pump cavitation. For further information contact Everllence.

HT and LT fresh water pump

Product range	Engine cooling
Branch suction flange	DN 125
Discharge flange	DN 125
Nominal speed	Variable rpm
Specific gravity	1.0
Performance curve based on water.	

6.7 Fuel oil system

6.7.1 DMA supply system description

General

The V28/33D STC engine runs on distillate diesel fuel oil (light fuel oil) only.

The following is a description of a typical V28/33D STC fuel oil system and is designed to suit the majority of installations, refer to figure [External DMA supply system diagram, Page 230](#). Tailored systems are possible for individual vessel requirements as well. To specify those contact Everllence for assistance.

6.7.2 Internal fuel oil supply system

P-028/Fuel oil supply pump, attached

The diesel fuel oil supply pump is a positive displacement gear type pump. It is mounted and driven by the engine. The supply pump has an integrated pressure relief safety valve.


The day tank and mechanically driven pump arrangement ensures that the engine will remain running or available to start in "black ship" condition. This is assuming 24 V DC is available for the electronic fuel injection and control systems.

The pump increases fuel pressure up to 10 bar.

From the fuel oil pump discharge the fuel oil is piped to an off-engine duplex filter, see section [External fuel oil supply system, Page 227](#).

6 Engine supply systems

6.7 Fuel oil system

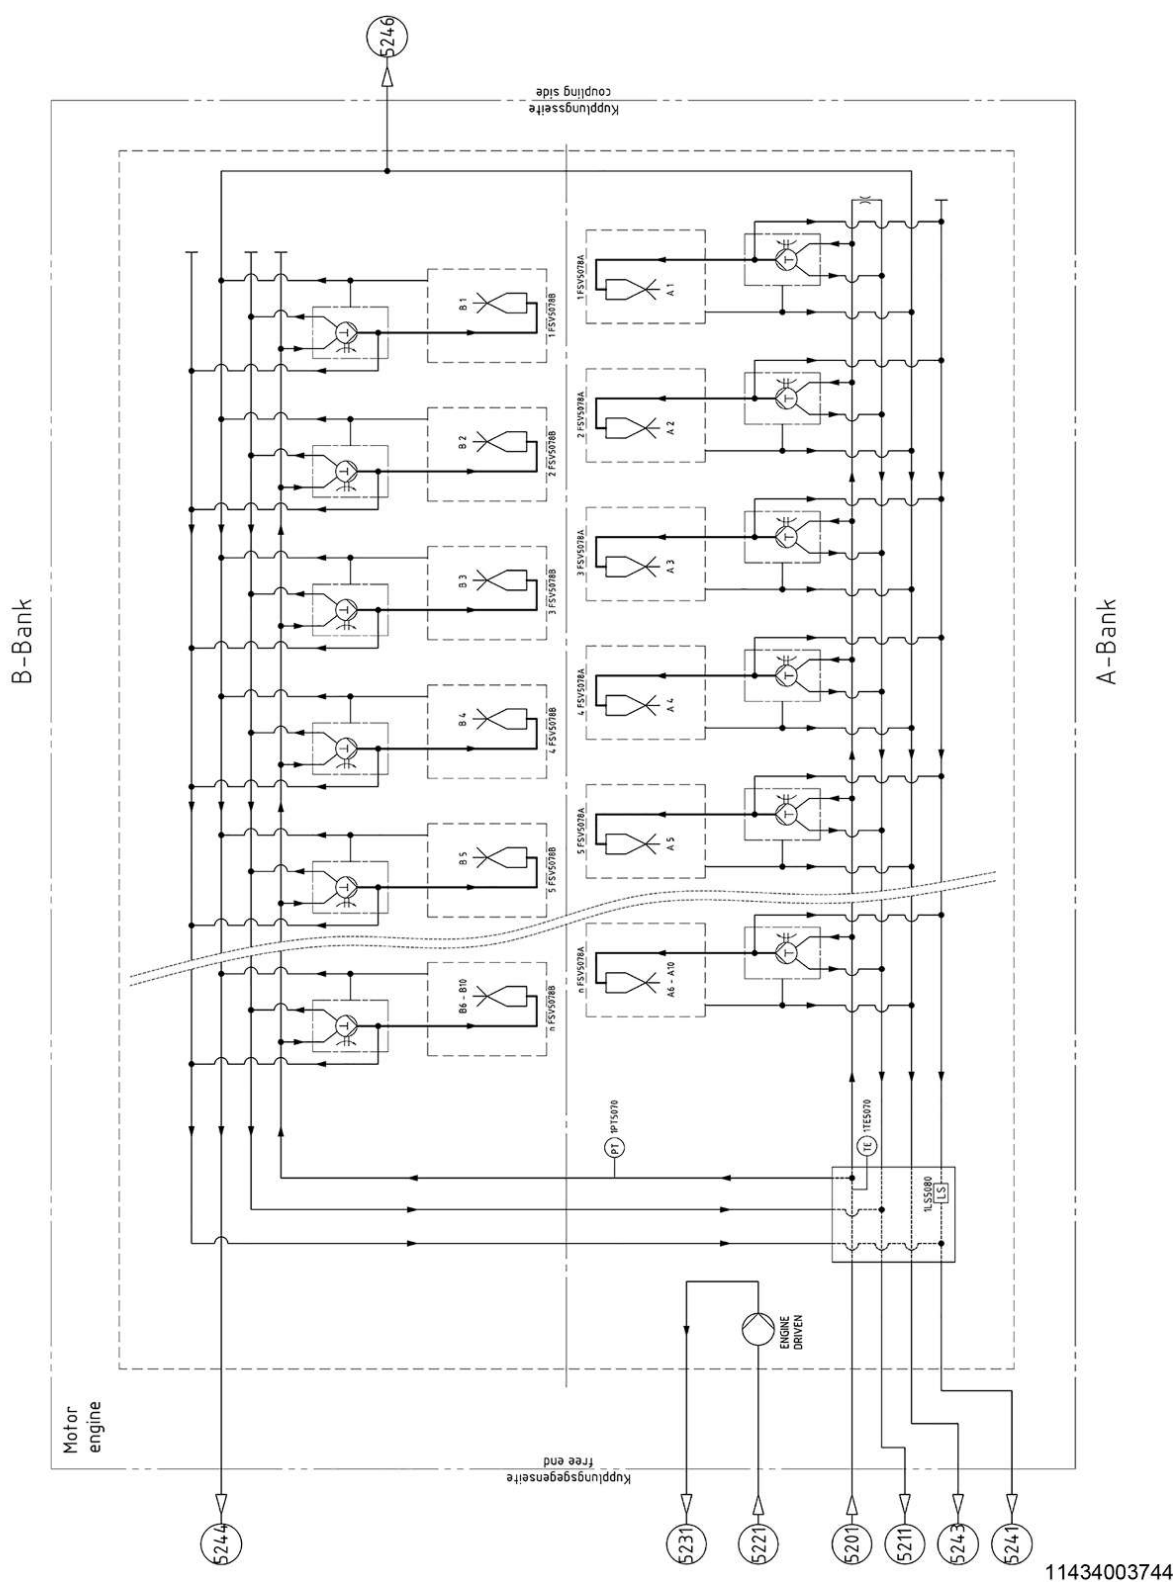

Major engine connections			
5201	Fuel oil inlet to engine (main injection system)	5241	Fuel oil break leakage drain
5211	Fuel oil outlet from engine	5243	Fuel oil leakage drain (reusable from pumps and injectors) 1
5221	Fuel oil inlet to fuel oil supply pump	5244	Fuel oil leakage drain (reusable from pumps and injectors) 2
5231	Fuel oil outlet from fuel oil supply pump	5246	Fuel oil leakage drain (reusable from pumps and injectors) 3

Figure 86: Internal fuel system – Exemplary

Note:

The drawing shows the basic internal media flow of the engine in general. Project-specific drawings thereof don't exist.

6.7.3 External fuel oil supply system

The recommended design pressure for the complete system installation is PN16.

T-003/Diesel fuel oil service tank Fuel oil is supplied into the circuit from a service or day tank. The tank is client supply so its dimensions can be customised to fit the vessel's specifications. It is normally a 'standard' header tank design, with float level control valve and fitted with vent and drain pipework. The base of the tank needs to be installed either max. 4 meters beneath or max. 6 meters above the engine crankshaft centreline (pressure loss of supply systems and piping not considered). This is to ensure the required pressure range at the inlet of the engine driven fuel oil pump (engine connection 5221), see table [Fuel, Page 94](#).

P-006/Fuel oil hand pump The fuel oil hand pump is required to fill up the system for commissioning, after maintenance of the fuel oil supply system and to improve the engine's starting behavior if the fuel oil tank is beneath crankshaft centerline. It is recommended to install the fuel oil hand pump in the supply line close to the tank. The fuel hand pump delivers fuel oil directly in front of the fuel oil supply pump P-028, see section [Internal fuel oil supply system, Page 224](#).

Before engine start and engine operation, shut-off valves from and to pump must be closed and pump must be drained! Otherwise, air can enter the fuel oil suction line via the sealing of the pump.

STR-010/Suction strainer To protect the engine driven fuel oil supply pump, an approximately 0.5 mm gauge (spherepassing mesh) strainer is to be installed at the suction side of the pump.

If a coalescer is installed, the suction strainer is not required.

TR-009/Coalescer To fulfill the water content requirements in the fuel oil (see table Requirements for diesel fuel) a coalescer (water separator) should be installed. The coalescer element mesh width has 30 micron (nominal).

For safety reason the coalescer housing is equipped with a differential pressure transmitter. A certain differential pressure indicates a clogged coalescer element and triggers an alarm, the filter cartridge must be replaced. To allow the replacement of the filter during engine operation it must be switched over to a redundant coalescer element with a manual changeover valve. In the coalescer housing a water sensor is installed. The sensor triggers an alarm if a certain water level inside the coalescer is reached. Following the water has to be drained manually.

FIL-013/Fuel oil duplex filter	The filter unit is a 5 micron (absolute) felt element depth type of duplex construction. It has a manual change over valve to allow filter cartridge change during engine operation to meet classification society requirements. The flow through the fuel oil duplex filter is equal to the delivery of the engine driven fuel oil pump, see sections Nominal values for cooler specification – 455 kW/cyl., CPP/FPP, Page 79 and Nominal values for cooler specification – 500 kW/cyl., CPP/FPP, Page 85. The fuel oil duplex filter is delivered with a differential pressure indicator. The emptying port of each filter chamber is to be fitted with a valve and a pipe to the sludge tank. If the filter elements are removed for replacing, the filter chamber must be emptied. This prevents the dirt particles remaining in the filter casing from migrating to the clean oil side of the filter. After changing the filter cartridge, the reconditioned filter chamber must be vented manually. From the fuel oil duplex filter the fuel oil is piped back to the engine (connection 5201) and circulated around the engine manifold to the fuel oil injection pumps. Then it exits the engine (connection 5211) before being piped to main pump suction via the fuel oil cooler, and pressure control valve.						
HE-007/Fuel oil cooler	The fuel oil cooler is required to cool down the fuel oil, which was heated up while circulating through the injection pumps. The cooler is normally connected to the LT cooling water system and should be dimensioned so that the MGO does not exceed a temperature of max. 45°C. Only for very light fuel oil types this temperature has to be even lower in order to preserve the minimum admissible fuel oil viscosity on engine inlet, see section Diesel fuel (DMA) specifications. <table border="1" data-bbox="544 1126 1449 1294"> <thead> <tr> <th>Engine type</th><th>Cooler capacity</th></tr> </thead> <tbody> <tr> <td>V engine</td><td>3.0 kW/cyl.</td></tr> <tr> <td colspan="2">The max. MGO throughput is approximately identical to the engine inlet fuel flow (= delivery quantity of the fuel oil supply pump).</td></tr> </tbody> </table>	Engine type	Cooler capacity	V engine	3.0 kW/cyl.	The max. MGO throughput is approximately identical to the engine inlet fuel flow (= delivery quantity of the fuel oil supply pump).	
Engine type	Cooler capacity						
V engine	3.0 kW/cyl.						
The max. MGO throughput is approximately identical to the engine inlet fuel flow (= delivery quantity of the fuel oil supply pump).							
PCV-008/Fuel oil pressure retaining valve	The recommended pressure class of the fuel oil cooler is PN16. In the fuel oil return loop a pressure control valve has to be installed, to ensure a certain fuel oil pressure at engine outlet, see section Operating/service temperatures and pressures, Page 90. It is to be adjusted so that the pressure before engine inlet can be maintained in the required range (see section Operating/service temperatures and pressures, Page 90).						
MOD-011/Fuel oil leakage module	The high-pressure fuel oil lines are double skinned and under covers to protect against fuel oil spray in the unlikely event of failure. The outer skin of the line is connected to the alarm system; any fuel oil entering the outer sheath drains to the on-engine leakage tank, below the crankshaft centreline, in which a rise in level will trigger the alarm. The drain connection (connection 5241) should be piped back to the clean leakage fuel oil tank (T-071). The operating fuel leakage is continuous and depending on engine load (see section Leakage rate, Page 96). It exits the engine (connection 5243, 5244 and 5246) under gravity, there should be no back pressure imposed on this flow as this will lead to contamination of the engine lube oil with fuel oil. The leak off fuel oil will therefore require collection in a tank and pumping back to bulk tanks should they be sited above the engine.						

Table 107: Dimensioning of the fuel oil cooler

The function of the fuel oil leakage module is to collect the fuel oil leakage of the diesel engine and to pump the fuel oil back to the fuel storage tank. The module is in operation, when the engine is also in operation. The start and stop of the pump is controlled by a level switch. In case of pump failure there is a second pump installed on the module as stand-by pump.

The leakage fuel flows pressureless (by gravity only) from the engine into this tank, therefore the module has to be installed below the engine connections.

Note that sheath drains (connection 5241) and leak off (connection 5243, 5244 and 5246) should not be connected together and run separately to the collection tank. This prevents backfilling of the sheath drain pipe thus causing false sheath drain alarms.

T-071/Clean leakage fuel oil tank

The clean leakage fuel oil tank is part of the leak-oil module, see paragraph [MOD-011/Fuel oil leakage module, Page 228](#).

FQ-003/Fuel oil flowmeter

The upstream flow rate of the engine should be displayed in the ship automation system. The flowmeter requires a by-pass to ensure a continuous fuel oil flow in case of maintenance or malfunction.

A coriolis type flowmeter is recommended for fuel oil flow measuring. The by-pass of the coriolis type flowmeter needs a shut-off valve.

If a positive displacement type flowmeter is used the by-pass needs to be equipped with a spring loaded overflow valve which opens automatically in case of blocking.


The pressure resistance of the fuel oil flowmeter should be as low as possible and considered during the system design stage.

Instrumentation

For details of the instrumentation, see section SaCoSone system overview.

Contact Everllence for technical drawings of auxiliary equipment.

External fuel oil supply system diagram

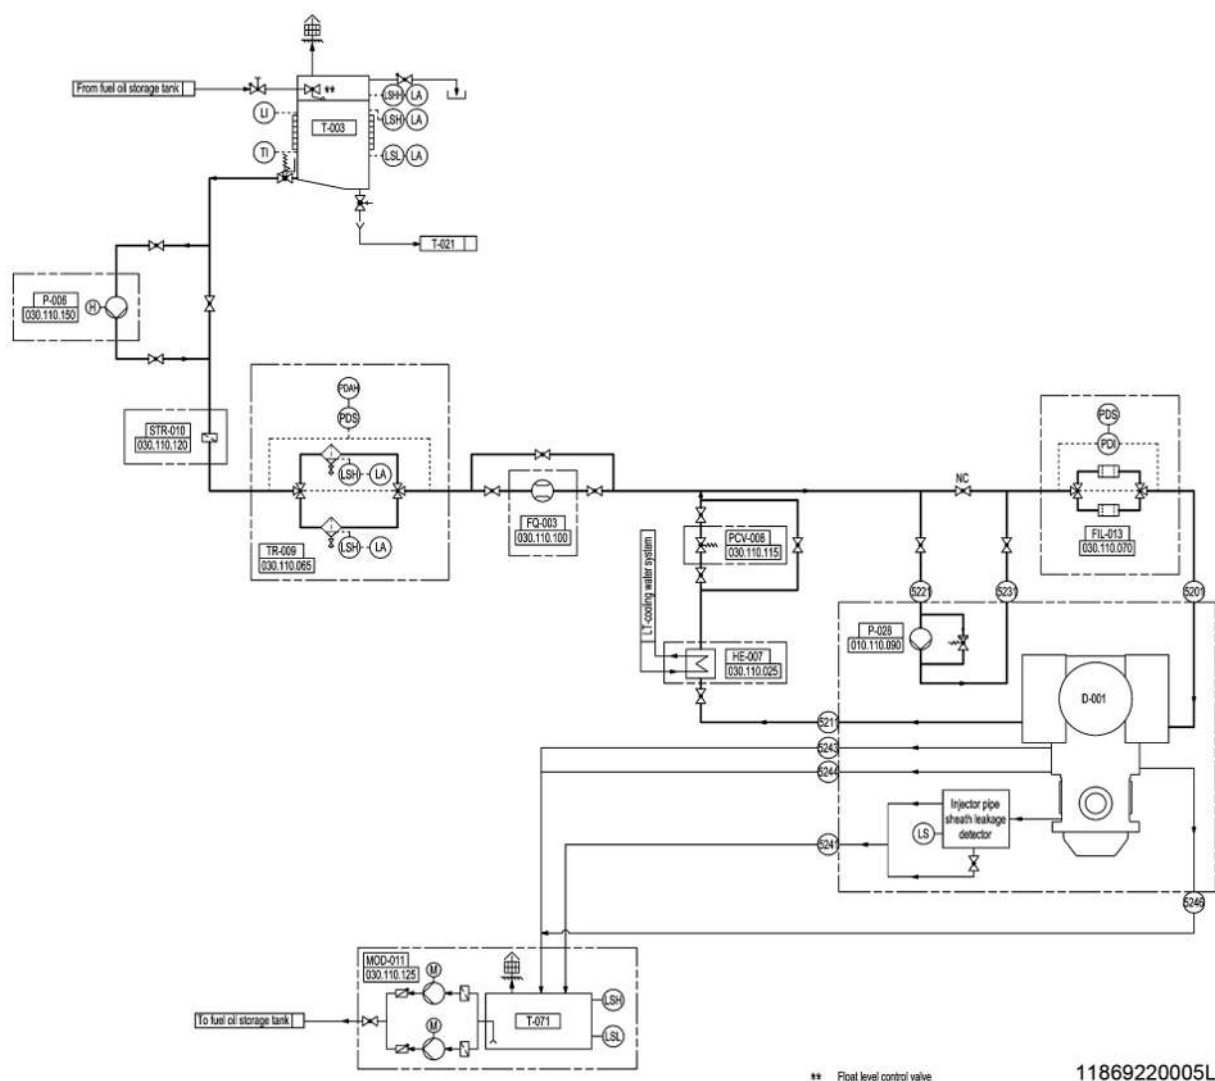

Components

- | | |
|---------|--------------------------------|
| D-001 | Diesel engine |
| FIL-013 | Fuel oil duplex filter |
| FQ-003 | Fuel oil flowmeter |
| HE-007 | Fuel oil cooler |
| MOD-011 | Fuel oil leakage module |
| P-006 | Fuel oil hand pump |
| P-028 | Fuel oil supply pump, attached |

Major cooling water engine connections

- | | |
|------|---|
| 5201 | Fuel oil inlet to engine |
| 5211 | Fuel oil outlet from engine |
| 5221 | Fuel oil inlet to fuel oil supply pump |
| 5231 | Fuel oil outlet from fuel oil supply pump |

- | | |
|---------|--|
| PCV-008 | Fuel oil pressure retaining valve |
| STR-010 | Fuel oil suction strainer |
| T-003 | Diesel fuel oil service tank |
| T-021 | Sludge tank |
| T-071 | Clean leakage fuel oil tank |
| TR-009 | Coalescer (water trap) |
| | |
| 5241 | Fuel oil break leakage drain 1 |
| 5243 | Fuel oil leakage drain (reusable from pumps and injectors) 1 |
| 5244 | Fuel oil leakage drain (reusable from pumps and injectors) 2 |
| 5246 | Fuel oil leakage drain (reusable from pumps and injectors) 3 |

Figure 87: External MGO supply system diagram

6.8 Compressed air system

6.8.1 Compressed air system description

The compressed air supply to the engine plant requires starting air receivers and starting air compressors of a capacity and air delivery rating which will meet the requirements of the relevant classification society.

Piping

The main starting pipe, which is connected to both air receivers, leads to the engine attached air starter (engine connection 7101).

Two further 8 bar pressure lines (7102 and 7105) with separate connections to both air receivers 40 bar supply the engine via pressure reducer unit (MOD-088) with control air.

A line branches from the aforementioned control air pipe to supply other air-consuming engine accessories (e.g. fuel oil automatic filter) with compressed air.

The pipes to be connected by the shipyard have to be supported immediately behind their connection to the engine. Further supports are required at sufficiently short distance.

Flexible connections for starting air (steel tube type) have to be installed with elastic fixation. The elastic mounting is intended to prevent the hose from oscillating. For detail information refer to planning and final documentation and manufacturer manual.

Galvanised steel pipes must not be used for the piping of the system.

Compressed air, at 37 bar for the starting system is supplied from the air receivers/compressors, directly to the engine mounted main air starting motor, engine connection "starting motor" (7101), via an approved flexible connection.

If supplied by Everllence, additional connections on the air receivers are provided for air requirements of the ship, for example the horn. The pipes to be connected by the shipyard have to be supported immediately behind their connection to the engine. Further supports are required at sufficiently short distance.

6.8 Compressed air system

Internal compressed air system



Components	
01	STC regulating valve, B-bank (charge air pipe)
02	STC regulating valve, B-bank (exhaust gas pipe)
03	Charge air by-pass
Connection numbers	
7101	Starting air inlet to engine
7102	Control air inlet to engine 1
04	Charge air blow-off valve (optional)
05	Emergency shut-off valve (optional)
06	Oil mist detector
7105	Control air inlet to engine 2

Figure 88: Internal compressed air system – Exemplary

Note:
The drawing shows the basic internal media flow of the engine in general. Project-specific drawings thereof don't exist.

6.8.3 External compressed air system

1 C-001, 2 C-001/Air compressor

These are multi-stage compressor sets with safety valves, cooler for compressed air and condensate traps.

The operational compressor is switched on by the pressure control at low pressure then switched off when maximum service pressure is attained.

For the V28/33D STC engine an air receiver pressure of 37 bar is required to reduce the physical size of the receiver to a minimum.

The service compressor is electrically driven; the auxiliary compressor may also be driven by a diesel engine. The capacity of both compressors should be identical.

The total capacity of the air compressors has to be capable to charge the air receivers from the atmospheric pressure to full working pressure within one hour.

Air dryer

To ensure the quality requirements of the control air in section [Specification of compressed air, Page 173](#) an air dryer may be required.

Piping

The piping should be as straight and unrestrictive as possible. Pipe diameter DN80 (2 starters).

1 T-007, 2 T-007/Starting air receivers

The installation situation of the air receivers must ensure a good drainage of condensed water. Air receiver must be installed with a downward slope sufficiently to ensure a good drainage of accumulated condensate water.


The installation also has to ensure that during emergency discharging of the safety valve no persons can be compromised.

It is not permissible to weld supports (or other) on the air receivers. The original design must not be altered. Air receivers are to be bedded and fixed by use of external supporting structures.

The standard design pressure of the starting air receivers is 40 bar.

2026-02-24 - 6.2

6.8 Compressed air system

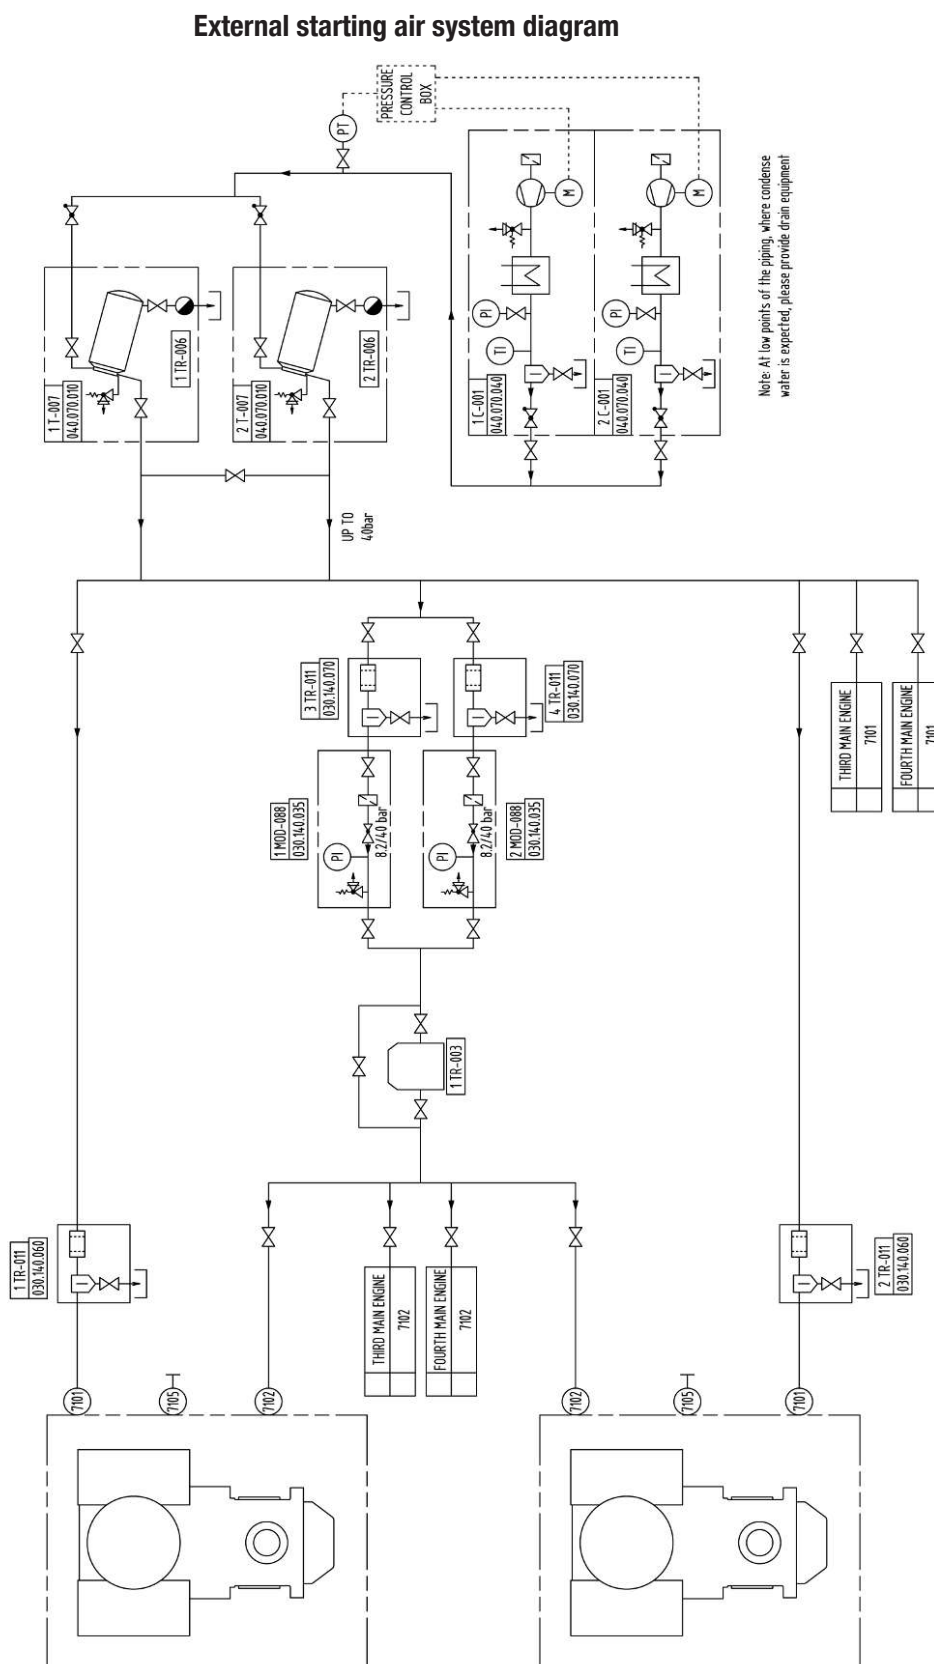

11869300012A

Components			
1,2 C-001	Air compressor	1 TR-003	Air dryer
1,2 MOD-088	Compressed air pressure reducing unit	1,2 TR-006	Automatic condensate trap
1,2 T-007	Starting air receiver	1,2,3,4 TR-011	Water separator with filter
Connection numbers			
7101	Starting inlet to engine	7105	Control air inlet 2 to emergency shut-off unit (optional)
7102	Control air inlet 1		

Figure 89: External starting air system diagram

6.8.4 External compressed air system – Dimensioning starting air receivers, compressors

Emergency case

For safety reasons upstream of engine connection 7105 a small air receiver, with non-return-valve at its inlet, is required.

Starting air receivers

The starting air supply is to be split up into not less than two starting air receivers of nominally the same size, which can be used independently of each another.

The capacity of the air receivers have to be designed so that at least six engine starts without replenishment are possible.

The exact number of required starts depends on the arrangement of the propulsion system and on the special requirements of the classification society.

Before engine connection control air inlet (7102) and "emergency shut-off valve" (7105) an air dryer (10 K below ambient temperature) and a 40 µm filtration has to be installed.

Before engine connections "emergency shut-off valve" (7105) a Vmin = 15 litre shut-off air receiver has to be installed.

Compressors

According to most classification societies, two or more air compressors must be provided. At least one of the air compressors must be driven independently of the main engine and must supply at least 50% of the required total capacity.

The total capacity of the air compressors has to be capable to charge the receivers from the atmospheric pressure to full pressure of 37 bar within one hour.

The compressor capacities are calculated as follows:

$$P = \frac{V \times 40}{1000}$$

P [m³/h]	Total volumetric capacity of the compressors
V [litres]	Total volume of the starting air receivers at 37 bar service pressure

Diesel-mechanical main engine

As a rule, compressors of identical ratings should be provided. An emergency compressor, if provided, is to be disregarded in this respect.

In case of mechanical-propulsion drive without shifting clutch but with shaft driven alternator, consult Everllence.

Calculation formula for starting air receivers see below:

$$V = \frac{V_{st} \times f_{Drive} \times (z_{st} + z_{safe})}{(p_{max} - p_{min})}$$

V [litre]	Required receiver capacity
V _{st} [litre]	Air consumption per nominal start
f _{Drive}	Factor for drive type (1.0 = diesel-mechanic, 1.5 = alternator drive)
z _{st}	Number of starts required by the classification society
z _{Safe}	Number of starts as safety margin
p _{max} [bar]	Maximum starting air pressure
p _{min} [bar]	Minimum starting air pressure

Other consumers (e.g. auxiliary engines, ship air etc.) are not accounted for in the above formula. If these are connected to the starting air receiver, the capacity of the receiver must be increased accordingly, or an additional separate air receiver has to be installed.

Contact Everllence for technical drawings of auxiliary equipment.

System instrumentation

For details of the instrumentation, see section SaCoSone system overview.

6.9 Engine room ventilation and intake air

6.9.1 External general information

Engine room ventilation system

Its purpose is:

- Supplying the engines and auxiliary boilers with combustion air.
- Carrying off the radiant heat from all installed engines and auxiliaries.

Intake air engine

The intake air of the engine must be free from spray water, snow, dust and oil mist.

This is achieved by:

- Louvres, protected against the head wind, with baffles in the back and optimally dimensioned suction space so as to reduce the air flow velocity to 1–1.5 m/s.
- Self-cleaning air filter in the suction space (required for dust-laden air, e.g. cement, ore or grain carrier).
- Sufficient space between the intake point and the openings of exhaust air ducts from the engine and separator room as well as vent pipes from lube oil and fuel oil tanks and the air intake louvres (the influence of winds must be taken into consideration).
- Positioning of engine room doors on the ship's deck so that no oil-laden air and warm engine room air will be drawn in when the doors are open.
- Arranging the separator station at a sufficiently large distance from the turbochargers.

As a standard, the engines are equipped with turbochargers with air intake silencers and the intake air is normally drawn in from the engine room.

In tropical service a sufficient volume of air must be supplied to the turbocharger(s) at outside air temperature. For this purpose there must be an air duct installed for each turbocharger, with the outlet of the duct facing the respective intake air silencer, separated from the latter by a space of approximately 1.5 m (see figure [Example: Exhaust gas ducting arrangement, Page 277](#)). No water of condensation from the air duct must be permissible to be drawn in by the turbocharger. The air stream must not be directed onto the exhaust manifold.

If the ship operates at arctic conditions, an air preheater must be applied to maintain the engine room temperature above 5°C. In order to reduce power for air preheating, the engines can be supplied by a separate system directly from outside, see section [Intake air ducting in case of arctic conditions, Page 238](#).

Air fans are to be designed so as to maintain a positive air pressure of 50 Pa (5 mm WC) in the engine room.

Radiant heat

The heat radiated from the main and auxiliary engines, from the exhaust manifolds, waste heat boilers, silencers, alternators, compressors, electrical equipment, steam and condensate pipes, heated tanks and other auxiliaries is absorbed by the engine room air.

The amount of air V required to carry off this radiant heat can be calculated as follows:

$$V = \frac{Q}{\Delta t \times c_p \times \rho t}$$

V [m³/h]	Air required
Q [kJ/h]	Heat to be dissipated
Δt [°C]	Air temperature rise in engine room (10–12.5)
c_p [kJ/kg·K]	Specific heat capacity of air (1.01)
ρt [kg/m³]	Air density at 35°C (1.15)

Ventilator capacity

The capacity of the air ventilators (without separator room) must be large enough to cover at least the sum of the following tasks:

- The combustion air requirements of all consumers.
- The air required for carrying off the radiant heat.

A rule-of-thumb applicable to plants operating on residual fuel is 20–24 m³/kWh.

Moreover it is recommended to apply variable ventilator speed to regulate the air flow. This prevents excessive energy consumption and cooling down of engines in stand-by.

Maximum engine room temperature

The engine room ventilation must ensure a maximum engine room temperature, with following boundary conditions:

- Maximum air temperature in the area of the engine and its components $\leq 45^\circ\text{C}$.
- Maximum air temperature at least 5 K below the flash point of any liquids, that is present within the engine room.

6.9.2 External air supply with or without arctic conditions**General recommendations for external intake air system of vessels**

The design of the intake air system ducting is crucial for reliable operation of the engine. The following points need to be considered:

- (1) Every single engine must be provided with a dedicated intake air system. It is not allowed to combine air intake systems of different engines.
- (2) According to classification rules, it may be required for arctic operation to install two air inlets from the exterior, one at starboard and one at portside.
- (3) It must be prevented that exhaust gas and oil dust is sucked into the intake air duct as fast filter blocking might occur.

(4) In case of arctic operation, suitable corrosion and low temperature resistant materials should be applied. Stainless steel S316 L might be suitable. For non-arctic operation, a steel duct with C5-M-coating acc. DIN EN ISO 12944 might be sufficient.

(5) Inside the duct, there must not be any parts (e.g. bolts, nuts, stiffening, etc.) that could fall off and move towards the engine. Installations, that are absolutely necessary (e.g. light behind filter wall) must be specially secured (self-locking nuts, screwed covers instead of clamped covers etc.).

(6) Due to the air flow, load changes and other external forces, (especially during ice breaking, if applicable) the intake air pipe is subject to heavy vibrations. Additionally engine and propeller exciting frequencies have to be taken into account. This has to be considered within the overall layout and the intake air duct needs to be reinforced sufficiently.

(7) Thermal expansion has to be considered for the layout and foundation of the duct (e.g. flexible mounting, additional compensators).

(8) Suitable drainage arrangements to remove any water from the intake air ducting should be provided. Backflow of air through drains has to be avoided (e.g. by syphons) and regularly checked for proper functioning. Adequate heating is required to prevent icing of drains.

(9) The air duct and its components need to be insulated properly. Especially a vapor barrier has to be applied to prevent atmospheric moisture freezing in the insulation material.

(10) An (automatic) shut-off flap should be installed to prevent a chimney effect and cooling down of engine during stand-still (maintenance or stand-by of engine). This flap is to be monitored and engine start should only be allowed in fully-open position. As an alternative, the intake system can be closed by a roller shutter or tarpaulin in front of the filter.

(11) The overall pressure drop of the intake air system ducting and its components is to be limited to 20 mbar. Moreover the differential pressure of the intake air filter must be monitored to fulfill this requirement. For additional safety, other components as the droplet separator and the weather hood can be monitored by differential pressure devices.

During commissioning and maintenance work, checking of the air intake system back pressure by means of a temporarily connected measuring device may become necessary. For this purpose, a measuring socket is to be provided approximately 1–2 metres before the turbocharger, in a straight length of pipe at an easily accessible position. Standard pressure measuring devices usually require a measuring socket size of 1/2".

(12) The turbocharger as a flow machine requires a uniform inflow. Therefore, the ducting must enable an air flow without disturbances or constrictions. To prevent non-uniform compressor inlet flow conditions, the duct design should consider the following:

- Avoid or minimise the number of elbows.
- Avoid multiple/repetitive deflections with a flow turn angle > 45°.
- Avoid combinations of flow turns in multiple planes.
- For engines with two turbochargers it must be ensured, that both turbochargers have identical conditions for the air supply, otherwise this would result in decreasing the surge stability.

(13) To prevent stalling, any intake air flow that exhibits a swirl counterrotating against the compressor wheel rotation must be avoided.

(14) It is recommended to verify the layout of the intake air piping by CFD calculations up to the entry of the compressor of the turbocharger.

(15) The maximum specified air flow speed of **20-25 m/s** should not be exceeded at any location of the pipe.

(16) A silencer is recommended to reduce the noise emissions from engine inlet and charge air blow-off. Sound power levels can be found in the relevant section of the Project Guide. Care must be taken, that no insulation material can escape from the silencer, which can fuse into glass spheres in the combustion chamber.

Components of intake air ducting

The whole system and its components must be designed suitably robust to withstand pressure peaks occurring from turbocharger surge. This will not happen during normal operation, but it could occur at fast load changes of the engine. This can happen 2–3 times consecutively, until the turbocharger comes back to its normal working range.

The table below shows values at engine inlet connection with a suitable intake air ducting. An unfavorable intake air duct design can also lead to higher values.

Type	Variation	Frequency	Comment
Pressure oscillation	± 40 mbar, 5–10 Hz	Permanent	Normal operation/constant load
Peak pressure (shock wave)	± 300 mbar	Sporadically	Engine emergency stop/turbocharger surge

The ambient air, which is led to engine by the intake air duct, needs to be conditioned by several components as shown in figure [External intake air supply system, Page 242](#). It needs to be cleaned according to the requirements in section [Specification of intake air \(combustion air\), Page 172](#). This could be done by the following components:

- **Section for cleaning of intake air (1–4)**

A weather hood (1) in combination with a snow trap (2) removes coarse dirt, snow and rain. A heated droplet separator (3) subsequently separates remaining water droplets or snow from the air. An appropriate filter cleans the intake air from particles. (4). A metal grid (e.g. 10x10 mm) after filter wall at intake air room is necessary to avoid filter elements or lost parts getting into air intake system. As a minimum, inlet air must be cleaned by an ISO coarse 45% class filter as per DIN EN ISO 16890. If there is a risk of high inlet air contamination, filter efficiency should be at least ISO ePM10 50% according to DIN EN ISO 16890. See figure [External intake air supply system, Page 242](#).

- **Combustion air silencer (5)**

Noise emissions of engine inlet and charge air blow-off can be reduced by a silencer in the intake air duct. It is recommended to apply a mesh (5a) at the outlet of the silencer to protect the turbocharger against any loose parts (e.g. insulation material of silencer, rust etc.) from the intake air duct. This mesh is to be applied even if the silencer will not be supplied. A drain close to the turbocharger is required to separate condensate water. See section [Noise, Page 104](#).

- **Overpressure flap (6) (optional)**

Depending on the system volume and chosen components, it might be necessary to install an overpressure flap between silencer and engine. Peak pressure pulses (e.g. during emergency stop) are conducted into the engine room via this flap, preventing possible damage to the filter and silencer.

- **Shut-off flap/blind plate (7)**

It is recommended to install a shut-off flap to prevent cooling down of the engine during longer standstills under arctic conditions. This flap should be monitored by the engine automation system to prevent engine starting with a closed flap.

As an alternative, the intake system can be closed by a roller shutter or tarpaulin in front of the filter.

- **Compensator (8) and transition piece (9)**

A steel compensator (rubber might also be considered) has to be installed directly vertically upstream of the 90° transition piece behind the turbocharger. A rigid support must be provided as close as possible upstream of the compensator. It has to be noted, that this compensator is solely foreseen to compensate engine-borne movements. Additional compensators might be necessary to cope for thermal expansion.


- **Strainer for commissioning phase (9a)**

To prevent residues from installation phase entering the engine during commissioning, a strainer or protective mesh must be installed as close as possible to the turbocharger. After the running-in is finished, the strainer must be removed and exchanged by an intermediate pipe. Final performance measurement and engine setting shall be done without an intake air strainer.

- **Charge air blow-off or recirculation**

For arctic conditions, an increased firing pressure, which is caused by higher density of cold air, is prevented by an additional valve, which blows off charge air (11). A compensator (10) connects the engine with the charge air blow-off piping. The blown-off air is taken after (cold blow-off) the charge air cooler or before the charge air cooler (hot blow-off) and is circulated (12) back in the intake air duct or blown out via an additional silencer. A homogenous temperature profile and a correct measurement of intake air temperature in front of compressor has to be achieved. For this a minimum distance of five times the diameter of the intake air duct between inlet of blown-off air and the measuring point must be kept.

Within section [Engine operation under arctic conditions, Page 57](#) additional information is given and boundary conditions for the layout of the piping are stated.

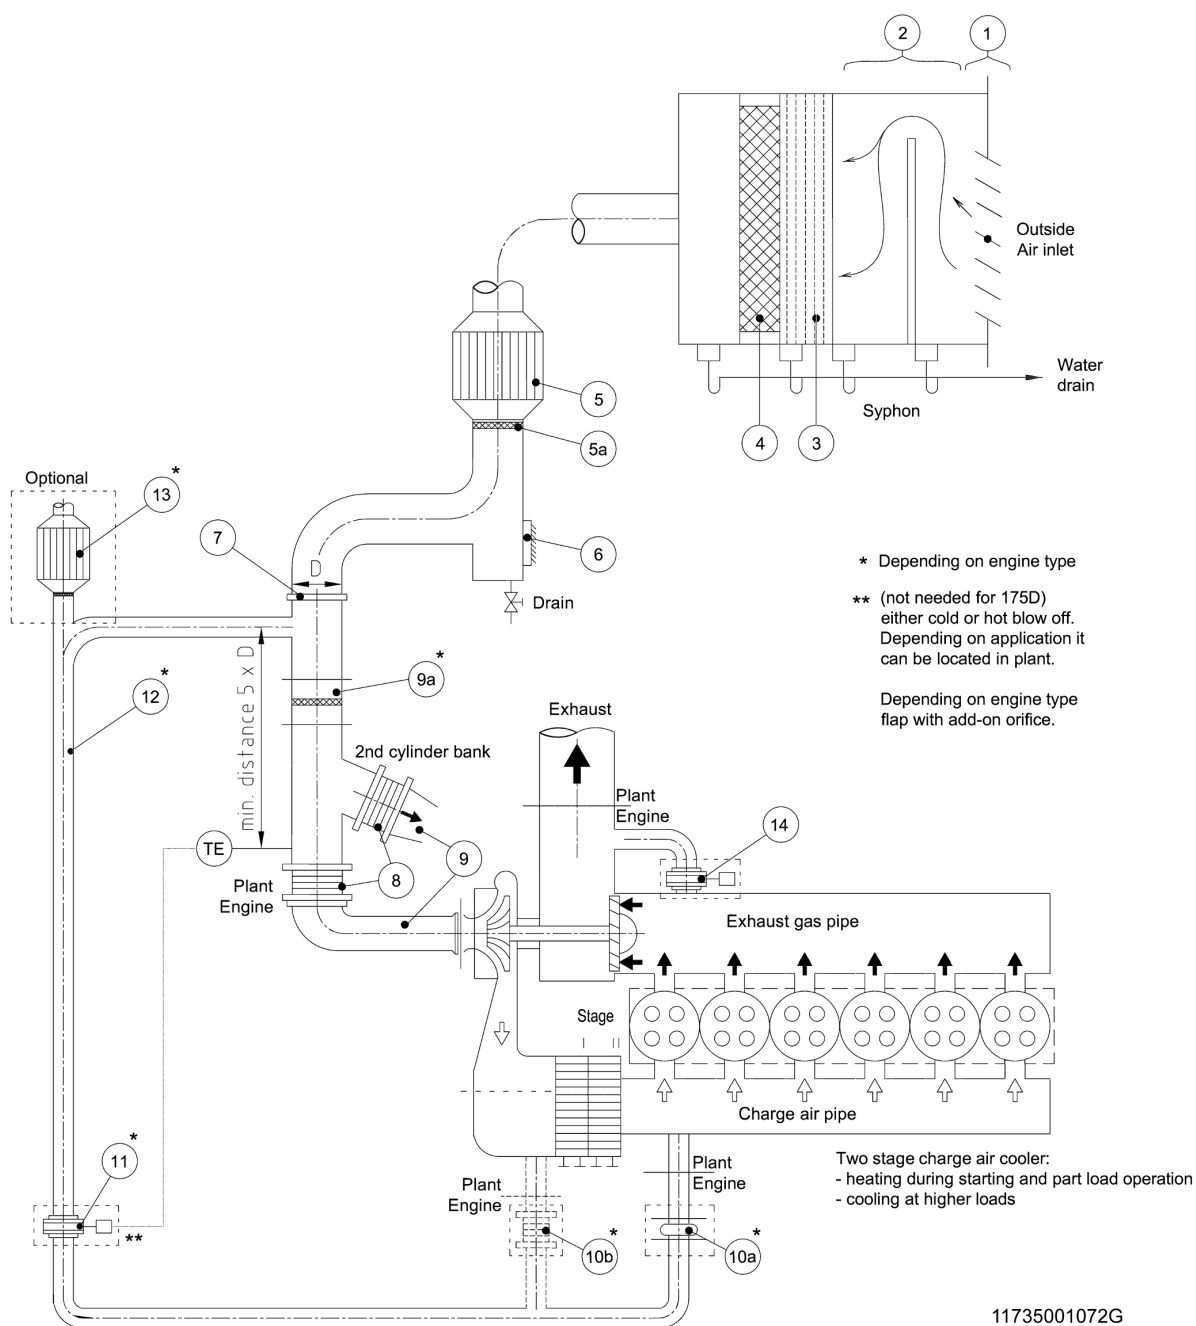

- | | |
|--|--|
| 1 Weather hood | 9 Transition piece |
| 2 Snow trap | 9a Intermediate pipe with strainer for running-in phase (to be removed afterwards) 030.120.190 |
| 3 Heated droplet separator | 10a Rubber bellow expansion joint – Cold blow-off |
| 4 Air intake filter 030.120.010 | 10b Metal bellow expansion joint – Hot blow-off |
| 5 Combustion air silencer 030.130.040 | 11 Charge air blow-off valve |
| 5a Protective mesh | 12 Charge air blow-off pipe |
| 6 Overpressure flap (optional) | 13 Charge air blow-off silencer |
| 7 Blind plate/shut-off flap (for maintenance case) | 14 Waste gate (if required for relevant engine type) |
| 8 Metal bellow expansion joint combustion air (rubber might be considered) | |

Figure 90: External intake air supply system

6.10 Exhaust gas system

6.10.1 External exhaust gas system – General information

Layout

The flow resistance in the exhaust system has a very large influence on the fuel consumption and the thermal load of the engine. The values given in this document are based on an exhaust gas system which flow resistance does not exceed 50 mbar. If the flow resistance of the exhaust gas system is higher than 50 mbar, contact Everlence for project-specific engine data.

Note:

20 mbar resistance for the Everlence SCR-LPC or 37 mbar for the Everlence SCR-LPS as part of the total resistance have to be considered.

The pipe diameter selection depends on the engine output, the exhaust gas volume and the system back pressure, including silencer and SCR (if fitted). The back pressure also being dependent on the length and arrangement of the piping as well as the number of bends. Sharp bends result in very high flow resistance and should therefore be avoided. If necessary, pipe bends must be provided with guide vanes.

It is recommended not to exceed a maximum exhaust gas velocity of approximately 40 m/s, at stack outlet 35 m/s.

Installation

When installing the exhaust system, the following points must be observed:

- The exhaust pipes of two or more engines must not be joined.
- The V28/33D STC has two turbochargers. To avoid interaction of the exhaust gas flows, the exhaust pipe of at least one turbocharger (preferably from Bank A) must have a length of minimum five times of its diameter before being joined.
- Because of the high temperatures involved, the exhaust pipes must be able to expand. The expansion joints to be provided for this purpose are to be mounted between fixed-point pipe supports installed in suitable positions. One compensator is required just after the outlet casing of the turbocharger (see section [Position of the outlet casing of the turbocharger, Page 279](#)) in order to prevent the transmission of forces to the turbocharger itself. These forces include those resulting from the weight, thermal expansion or lateral displacement of the exhaust piping. For this compensator/expansion joint one sturdy fixed-point support must be provided.

- The exhaust piping should be elastically hung or supported by means of dampers in order to prevent the transmission of sound to other parts of the vessel.
- The exhaust piping is to be provided with water drains, which are to be regularly checked to drain any condensation water or possible leak water from exhaust gas boilers if fitted.
- During commissioning and maintenance work, checking of the exhaust gas system back pressure by means of a temporarily connected measuring device may become necessary. For this purpose, two measuring sockets need to be provided approximately 1 to 2 metres after the exhaust gas outlet of the turbocharger, in a straight length of pipe at an easily accessed position. Standard pressure measuring devices usually require a measuring socket size of 1/2". This measuring socket is to be provided to ensure back pressure can be measured without any damage to the exhaust gas pipe insulation.

Exhaust piping insulation

The exhaust gas pipe system has to be insulated to reduce the maximum surface temperature to the level required by both the classification society and SOLAS and to avoid temperatures below the dew point. Therefore the complete exhaust gas system (from outlet of turbocharger, silencer, boiler to outlet stack) should be sufficiently insulated. Also, to avoid temperatures below the dew point, resulting in excessive water formation within the pipe, the exhaust gas piping to the outside, including boiler, if fitted and silencer, should be insulated thus avoiding intensified corrosion and soot deposits on the interior surface of the exhaust gas pipe. When fast engine load changes occur, these deposits might flake off and be entrained by exhaust in the form of soot flakes. The flange connection on the turbocharger outlet, as well as the adjacent round flanges of the adaptor or transition piece, must also be covered with insulating collars, for reasons of safety. Insulation and covering of the compensator must not restrict its freedom of movement. The relevant provisions concerning accident prevention and those of the classification societies and SOLAS requirements must be observed.

Exhaust silencer – Mode of operation


The silencer, normally of client supply, usually operates on the absorption principle, this design being very effective throughout a wide frequency band. The flow path, running through the silencer in a straight line, ensures optimum noise reduction with minimum flow resistance and therefore low back pressure.

Silencer installation

If possible, the silencer should be installed towards the end of the exhaust line; the exact position can be adapted to the space available (from vertical to horizontal). If the silencer has a spark arrester, it must be ensured that the cleaning ports are easily accessible.

Contact Everllence for technical drawings of auxiliary equipment.

Exhaust gas and charge air system diagram

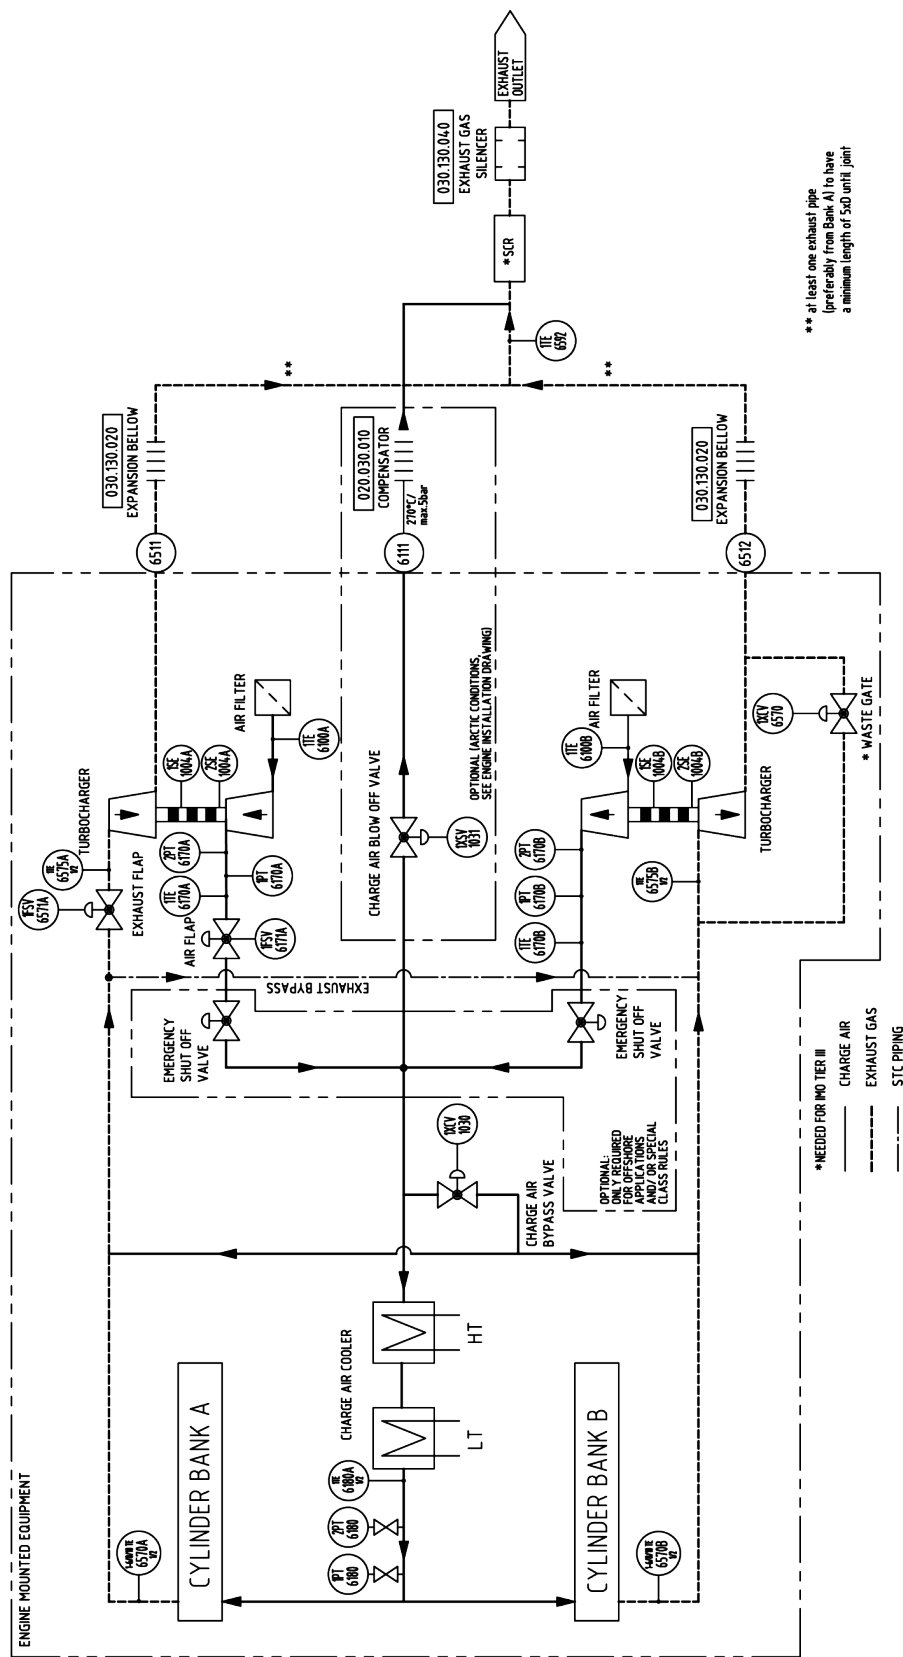

11869310004F

6.10 Exhaust gas system

6 Engine supply systems

- 6111 OPTIONAL: Charge air blow off
- 6512 Outlet exhaust gas
- 6511 Outlet exhaust gas

Figure 91: Exhaust gas and charge air system diagram with STC

6.10.2 External components and assemblies of the exhaust gas system

Exhaust gas silencer and exhaust gas boiler

Mode of operation	The silencer operates on the absorption and resonance principle so it is effective in a wide frequency band. The flow path, which runs through the silencer in a straight line, ensures optimum noise reduction with minimum flow resistance. A spark arrestor should be provided in the exhaust gas system (e.g. integrated in the silencer). Note: Spark arrestors are mandatory for certain ship types.
Installation	If possible, the silencer should be installed towards the end of the exhaust line. A vertical installation situation is to be preferred in order to avoid formations of gas fuel pockets in the silencer. The cleaning ports of the spark arrestor are to be easily accessible. Note: Water entry into the silencer and/or boiler must be avoided, as this can cause damages of the components (e.g. forming of deposits) in the duct.
Exhaust gas boiler	To utilise the thermal energy from the exhaust, an exhaust gas boiler producing steam or hot water may be installed.
Insulation	The exhaust gas system (from outlet of turbocharger, silencer, catalyst, boiler to the outlet stack) is to be insulated to reduce the external surface temperature and airborne noise to the required level. The relevant provisions concerning accident prevention and those of the classification societies must be observed. The insulation is also required to avoid temperatures below the dew point on the interior side. In case of insufficient insulation intensified corrosion and soot deposits on the interior surface are the consequence. During fast load changes, such deposits might flake off and be entrained by exhaust in the form of soot flakes. Insulation and covering of the compensator must not restrict its free movement.

6.11 SCR system

6.11.1 General

The SCR system uses aqueous urea solution and a catalyst material to transform the pollutant nitrogen oxides into harmless nitrogen and water vapor. The main components of the SCR system are described in the following section.

For further information read section SCR – Special notes.

2026-02-24 - G.2

6.11.2 As-delivered conditions and packaging

All components will be delivered and packaged in a seaworthy way (with dry agent, wooden boxing, shrink wrapped). Black carbon steel components will be coated with an anti-corrosive painting. Stainless steel components will not be coated.

The original packaging should not be removed until the date of installation.

The physical integrity of the packaging must be checked at the date of delivery.

6.11.3 Transportation and handling

Compressed air reservoir module (MOD-085)

Transport of the compressed air reservoir module can be organised by crane, via installed metal eyelets on the top side or fork-lifter.

Urea pump module (MOD-084)

Transport of the urea pump module can be organised by crane, via installed metal eyelets on the top side.

Dosing unit (MOD-082)

Transport of the dosing unit can be organised by crane, via installed metal eyelets on the top side.

Urea injection lance and mixing unit (MOD-087)

Transport of the mixing unit can be organised by crane, via two installed metal eyelets. For horizontal lifting it is sufficient using one of the metal eyelets.

Using a vertical way, the two cables each fixed on one metal eyelet have to be stabilised by a transversal bar.

Note:

The metal eyelets are designed to carry only the segments of the mixing unit, further weights are not allowed (e.g. complete welded mixing pipe).

SCR reactor (R-001)

Transport of the reactor can be organised by crane, via installed metal eyelets on the top side.

SCR cabinet

Transport of the SCR cabinet can be organised by crane, via installed metal eyelets on the top side.

6.11.4 Storage

Compressed air reservoir module (MOD-085), urea pump module (MOD-084), dosing unit (MOD-082), SCR cabinet and sensor elements have to be stored in dry and weather-resistant conditions.

Catalyst elements shall be handled free from shocks and vibrations. Furthermore, catalyst elements have to be stored in dry and weather-resistant conditions. Keep oils or chemicals away from catalyst elements. Seaworthy packaging is only a temporary protection.

6.11.5 Components and assemblies of the SCR system

Catalyst elements

The catalyst elements are placed in metallic frames, so called modules. Due to the honeycomb structure of the catalyst elements, the catalytic surface is increased. The active component vanadium pentoxide (V_2O_5) in the surface supports the reduction of NO_x to harmless nitrogen.

The effectivity of the catalytic material decreases over time because of poisoning via fuel oil components or thermal impact. The durability depends on the fuel type and conditions of operation.

The status of catalyst deactivation is monitored continuously and the amount of urea injected is adapted according to the current status of the catalyst.

Compressed air reservoir module (MOD-085) and soot blowing system (MOD-086)

The compressed air required for the operation of the SCR system is provided by the compressed air reservoir module. It receives its compressed air via the ship's compressed air grid. For the quality requirements read section [Specification of compressed air, Page 173](#). The main supply line feeds the compressed air reservoir module, where a compressed air tank is installed. This high-pressure tank is a reservoir with enough capacity to ensure the supply of the dosing unit and the air consumption for the periodically cleaning of the catalysts' surface, by avoiding fluctuations in the soot blowing system. In case of black out the volume of the tank will be used for flushing the urea line and nozzle. The module has to be positioned close to the reactor and the dosing unit. The maximum length of the compressed air line to the soot blowing system is 10 m.

The soot blower valves are positioned upstream each catalyst layer in order to clean the complete surface of the catalyst elements by periodical air flushing. The soot blowing always has to be in operation while engine running.

Urea pump module (MOD-084)

The urea pump module boosts urea to the dosing unit and maintains an adequate pressure in the urea lines. Upstream of the supply pump, a filter is installed for protection of solid pollutants. Downstream, the module is equipped with a return line to the urea storage tank with a pressure relief valve to ensure the required urea flow.

The urea pump module has to be positioned close to the urea storage tank. The pump accepts a suction height of 1.5 m and a maximum pressure loss of 2 bar. One urea pump module can supply up to four SCR systems.

For requirements regarding redundancy, contact Everllence.

Note:

Urea quality according section [Specification of urea solution, Page 174](#) is required. For urea consumption calculation for Tier III read section [Urea consumption for emission standard IMO Tier III, Page 74](#).

Dosing unit (MOD-082)

The dosing unit controls the flow of urea to the injection nozzle based on the operation of the engine. Furthermore it regulates the compressed air flow to the injector.

In order to avoid clogging due to the evaporation of urea in the urea pipe and in the nozzle, a line between compressed air line and urea line is installed. An installed solenoid valve will open to flush and cool the urea line and nozzle with compressed air before and after injecting urea into the exhaust gas.

The dosing unit has to be installed close to the urea injection lance and mixing unit (maximum pipe length 5 m).

Urea injection lance and mixing unit (MOD-087)

The urea solution will be injected into the exhaust gas using a two-phase nozzle. The urea will be atomised with compressed air. The evaporation of the urea occurs immediately when the urea solution gets in contact with the hot exhaust gas.

The urea injection and the mixing unit have to be positioned according to Everlence requirements. In general, the mixing section is between 2.6–3.8 m long and of DN 500 to DN 2,300. The mixing duct is a straight pipe upstream of the reactor.

SCR reactor (R-001)

Each engine is equipped with its own SCR reactor and it is fitted in the exhaust gas piping without a by-pass. The SCR reactor housing is a steel structure. The reactor configuration is vertical and consists of several layers of catalysts. For horizontal installation, contact Everlence. The reactor is equipped with differential pressure and temperature monitoring, a maintenance door for service and the soot blowing system for each layer.

The maximum temperature of the exhaust gas is 450°C and a minimum exhaust gas temperature is required to ensure a reliable operation. Therefore temperature indicators are installed in the inlet and outlet of the reactor in order to monitor and control the optimum operating range.

The SCR reactor is capable of attenuating the sound according to the following table.

F _m in Hz	31.5	63	125	250	500	1,000
D _{TL} in dB	4	4	4	6	8	12

Table 108: Sound attenuation capability of the SCR reactor



Figure 92: P&ID SCR system diagram

6.11.6 Installation of the SCR system

	All modules are checked regarding pressure and tightness.
Catalyst elements	For handling the catalyst elements sufficient space and supply tracks have to be foreseen. Depending on the amount of catalyst elements transport devices like carriages, pulleys, fork lifter or elevators are required.
Reactor and soot blowing system	A service space of recommended 760 mm in front of the inspection doors of the reactor has to be foreseen for mounting and dismounting the catalyst elements, as well as for service and maintenance of the soot blower equipment and sensors.
Reactor and piping	In case of a bend before the reactor inlet, a bend radius of minimum one time of the exhaust gas pipe diameter has to be considered.
Mixing unit	The mixing unit is designed for vertical or horizontal installation. Bend on the downstream side has to be in accordance to above mentioned "Reactor and Piping". Upstream of the mixing unit a bend can be installed according the Everllence requirements mentioned on the planning drawing.

6.11.7 Recommendations

	All parts mentioned in this paragraph are not Everllence scope of supply.
Piping in general	All piping's have to be in accordance to section Specification of materials for piping, Page 181 . Piping for fluids shall be mounted in an increasing/decreasing way. Siphons should be avoided, drainage system be foreseen.
Exhaust gas piping	The complete inside wall of the exhaust gas piping between engine outlet and SCR reactor inlet should not be coated by any protection material. Poisoning of the catalyst honeycombs could occur.
Intake air equipment, compressed air supply	Silicates in exhaust gas can cause capital damage of the catalyst elements of the exhaust gas after treatment system (SCR). Therefore, it has to be ensured that no silicates can reach and poison the catalyst by related systems. Possible sources for silicates could be e.g.: - Intake air silencer of low quality (absorption material might get loose). - Filters in compressed air system for SCR (adsorption filters containing silica gel).
Preferred materials	All materials used for the construction of tanks and containers including tubes, valves and fittings for storage, transportation and handling must be compatible with urea 40% solution to avoid any contamination of urea and corrosion of device used. In order to guarantee the urea quality the following materials for tank, pipes and fittings are compatible: Stainless steel (1.4301 or 1.4509) or urea-resistant plastics (e.g. PA12). For gaskets EPDM or FKM. Piping for compressed air see section Specification of materials for piping, Page 181 .
Unsuitable materials	Unsuitable materials for tank, pipes and fittings are among others: Aluminum, unalloyed steel, galvanised steel, copper and brass. In case incompatible material is used, clogging of urea filter inside the pump module may occur, or even worse, the catalyst elements may be damaged by catalyst poisons derived from this material. In this case, exchanging the catalyst modules may be necessary.

Urea tank

Store this material in cool, dry, well-ventilated areas. Regarding the urea storage temperature, the requirements of the respective manufacturer information or applicable standards (e.g. ISO 18611-3) are to be observed. The storage capacity of the urea tank should be designed depending on ship load profile and bunker cycle.

The urea supply line should be provided with a strainer and a non-return valve in order to assure a correct performance for the suction of the urea pump, which is installed downstream the tank. A level switch with the possibility to read out the signal will protect the pump of a dry run. A return line from the urea pump module over a pressure relief valve is entering the tank.

Urea solution quality

Use of good quality urea is essential for the operation of an SCR catalyst. Using urea not complying with the specification below e.g. agricultural urea, can either cause direct operational problems or long term problems like deactivation of the catalyst. For quality requirements, see section [Specification of urea solution, Page 174](#).

Insulation

The quality of the insulation has to be in accordance with the safety requirements. All insulations for service and maintenance spaces have to be dismountable. The delivered modules have no fixations, if fixations are necessary take care about the permissible material combination. Regarding max. permissible thermal loss see section Boundary conditions for SCR operation.

Water trap

Water entry into the reactor housing must be avoided, as this can cause damage and clogging of the catalyst. Therefore a water trap has to be installed, if the exhaust pipe downstream of the SCR reactor is facing upwards.

7 Engine room planning

7.1 Installation and arrangement

7.1.1 General details

Apart from a functional arrangement of the components, the shipyard is to provide for an engine room layout ensuring good accessibility of the components for servicing.

The cleaning of the cooler tube bundle, the emptying of filter chambers and subsequent cleaning of the strainer elements, and the emptying and cleaning of tanks must be possible without any problem whenever required.

All of the openings for cleaning on the entire unit, including those of the exhaust silencers, must be accessible.

There should be sufficient free space for temporary storage of pistons, camshafts, turbocharger etc. dismantled from the engine. Additional space is required for the maintenance personnel. The panels on the engine sides for inspection of the bearings and removal of components must be accessible without taking up floor plates or disconnecting supply lines and piping. Free space for installation of a torsional vibration meter should be provided at the crankshaft end.

A very important point is that there should be enough room for storing and handling vital spare parts so that replacements can be made without loss of time.

In planning marine installations with two or more engines driving one propeller shaft through a multi-engine transmission gear, provision must be made for a minimum clearance between the engines because the crankcase panels of each engine must be accessible. Moreover, there must be free space on both sides of each engine for removing pistons or cylinder liners.

Note:

Everllence delivered scope of supply is to be arranged and fixed by proven technical experiences as per state of the art. Therefore the technical requirements have to be taken in consideration as described in the following documents subsequent:

- Order related engineering documents.
- Installation documents of our sub-suppliers for vendor specified equipment.
- Operating manuals for diesel engines and auxiliaries.
- Project Guides of Everllence.

Any deviations from the principles specified in the aforementioned documents require a previous approval by Everllence.

Arrangements for fixation and/or supporting of plant related equipment deviating from the scope of supply delivered by Everllence, not described in the aforementioned documents and not agreed with us are not permissible.

For damages due to such arrangements we will not take over any responsibility nor give any warranty.

7.1.2 Installation drawings


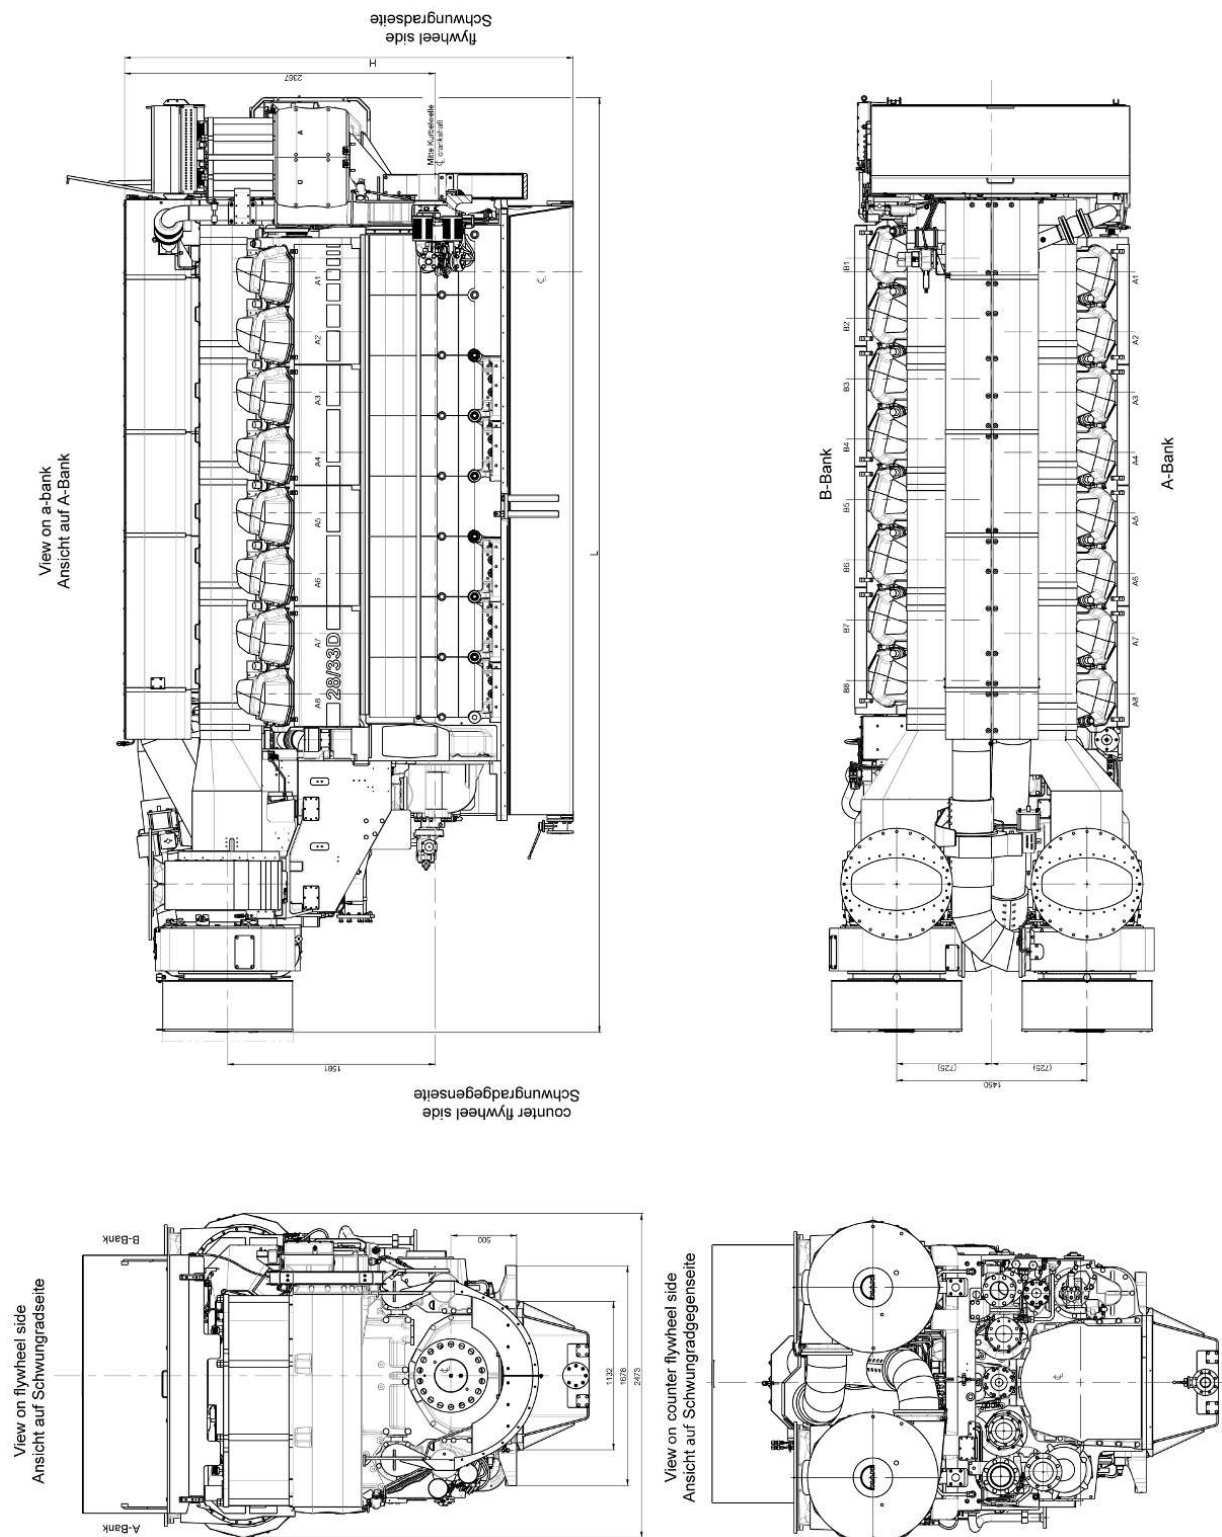


Figure 93: Installation drawing 16V engine with duplex filter (standard) and low oil sump

No. of cylinders, config.	H (low oil sump)	L
	mm	
12V	3,419	6,217
16V		7,137
20V		8,057
The dimensions are given for guidance only.		
The figures show a possible design of the engine. The equipment can be combined differently.		

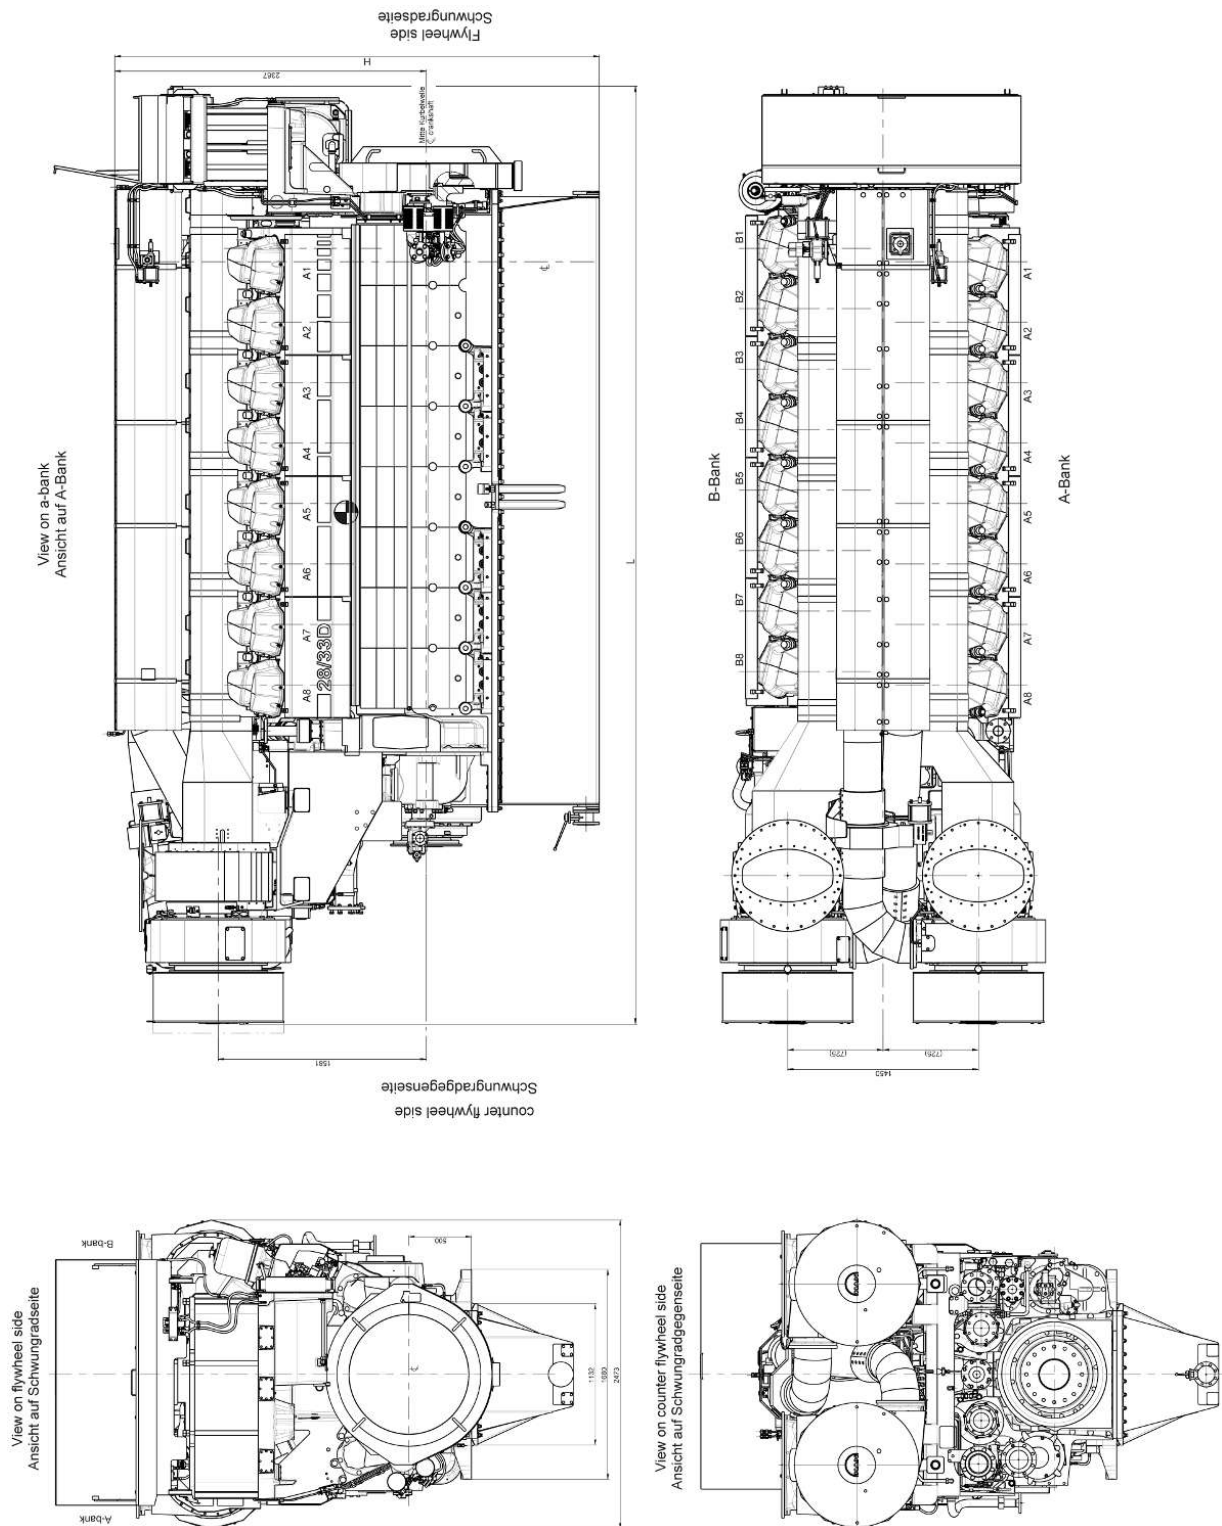

No. of cylinders, config.	H (deep oil sump)	L
	mm	
12V	3,683	6,217
16V		7,137
20V		8,057

The dimensions are given for guidance only.
The figures show a possible design of the engine. The equipment can be combined differently.

7.1.3 Removal dimensions


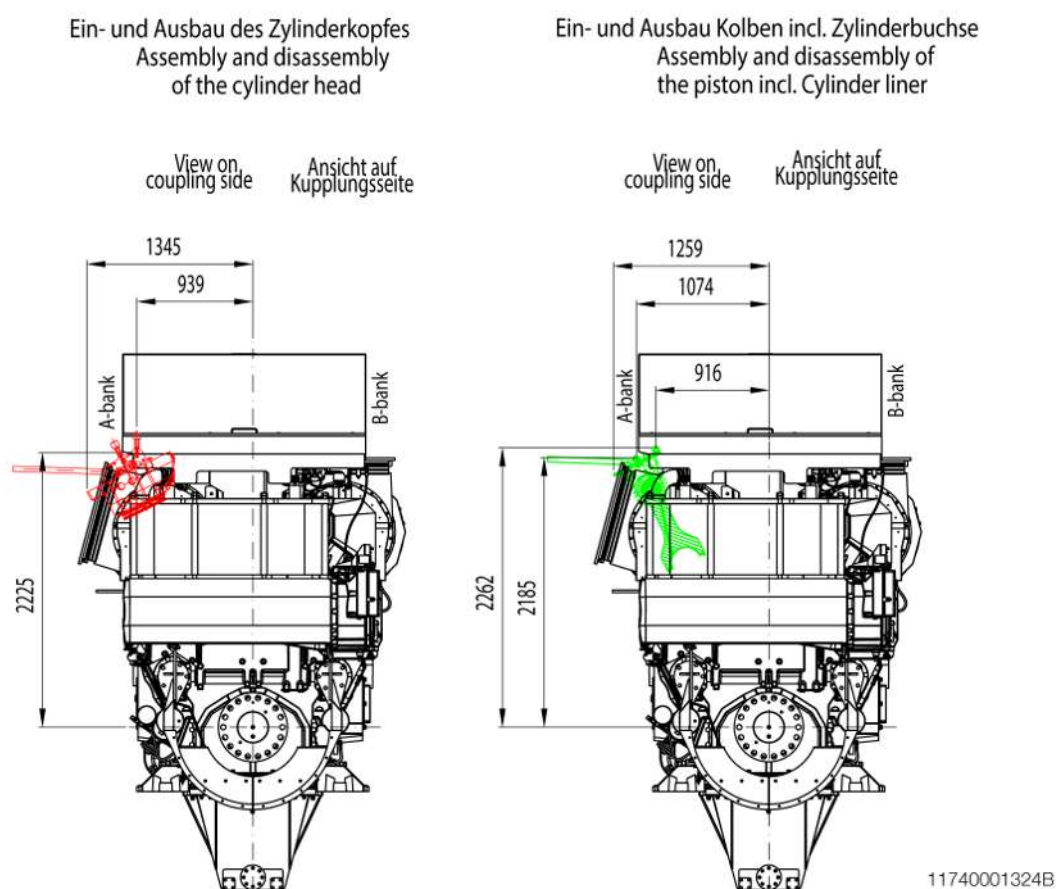


Figure 95: Removal dimensions of cylinder head and piston including cylinder liner

REMOVAL THE CHARGE-AIR COOLER BUNDLE LADELUFTKÜHLER-BÜNDELAUSBAU


Anhängevorrichtung für Ladeluftkühler
Suspension device for intercooler

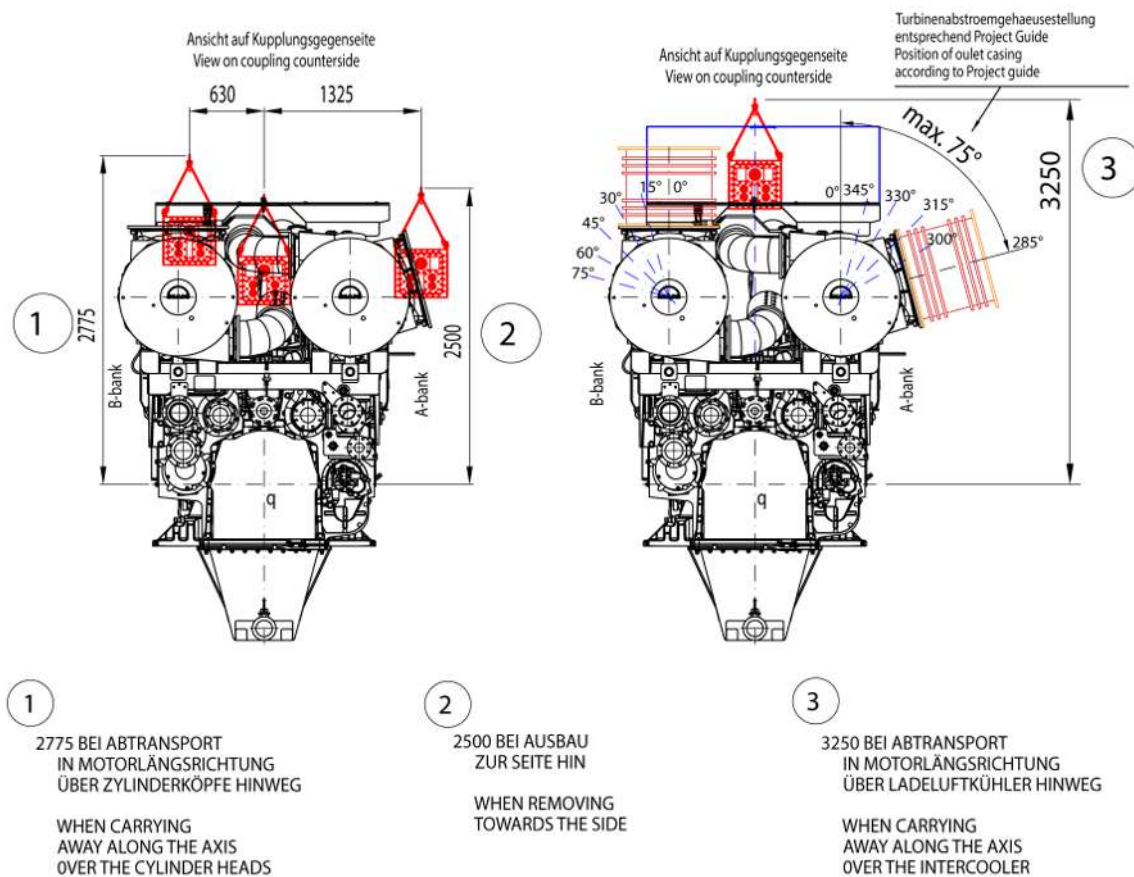

11740001324B

Figure 96: Removal dimensions of charge air cooler bundle

1	When carrying away along the axis over the cylinder heads
2	When removing towards the side
3	When carrying away along the axis over the intercooler
Capacity of suspension device for intercooler: 825 kg	

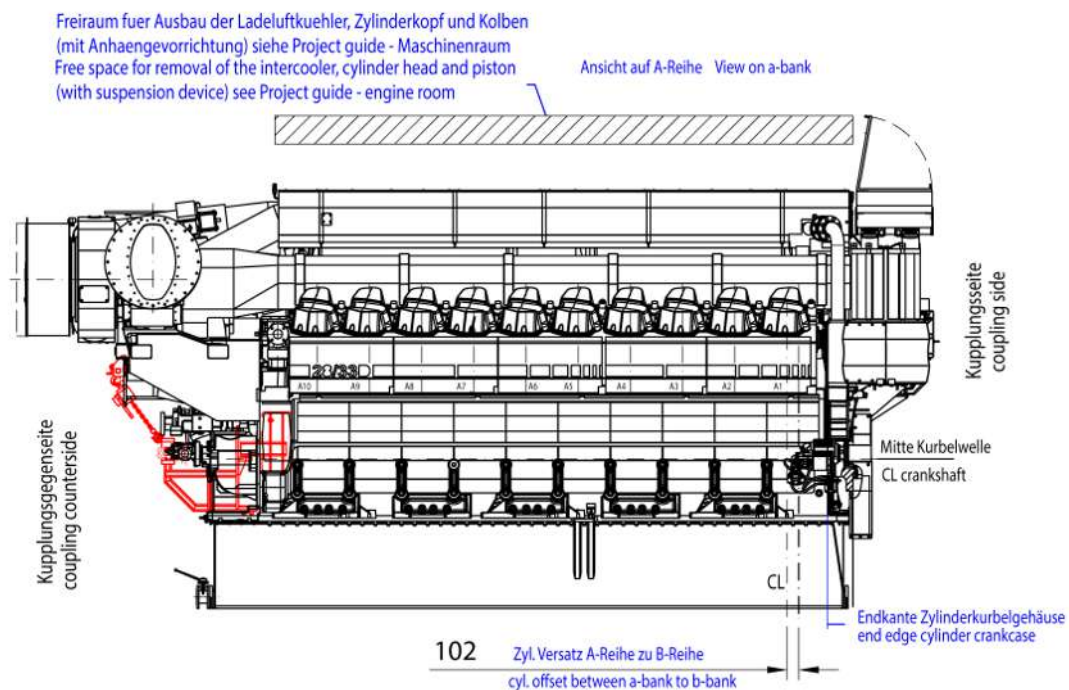

11740001324B

7.1 Installation and arrangement

7 Engine room planning

Figure 97: Removal dimensions of lube oil pump and fuel pump


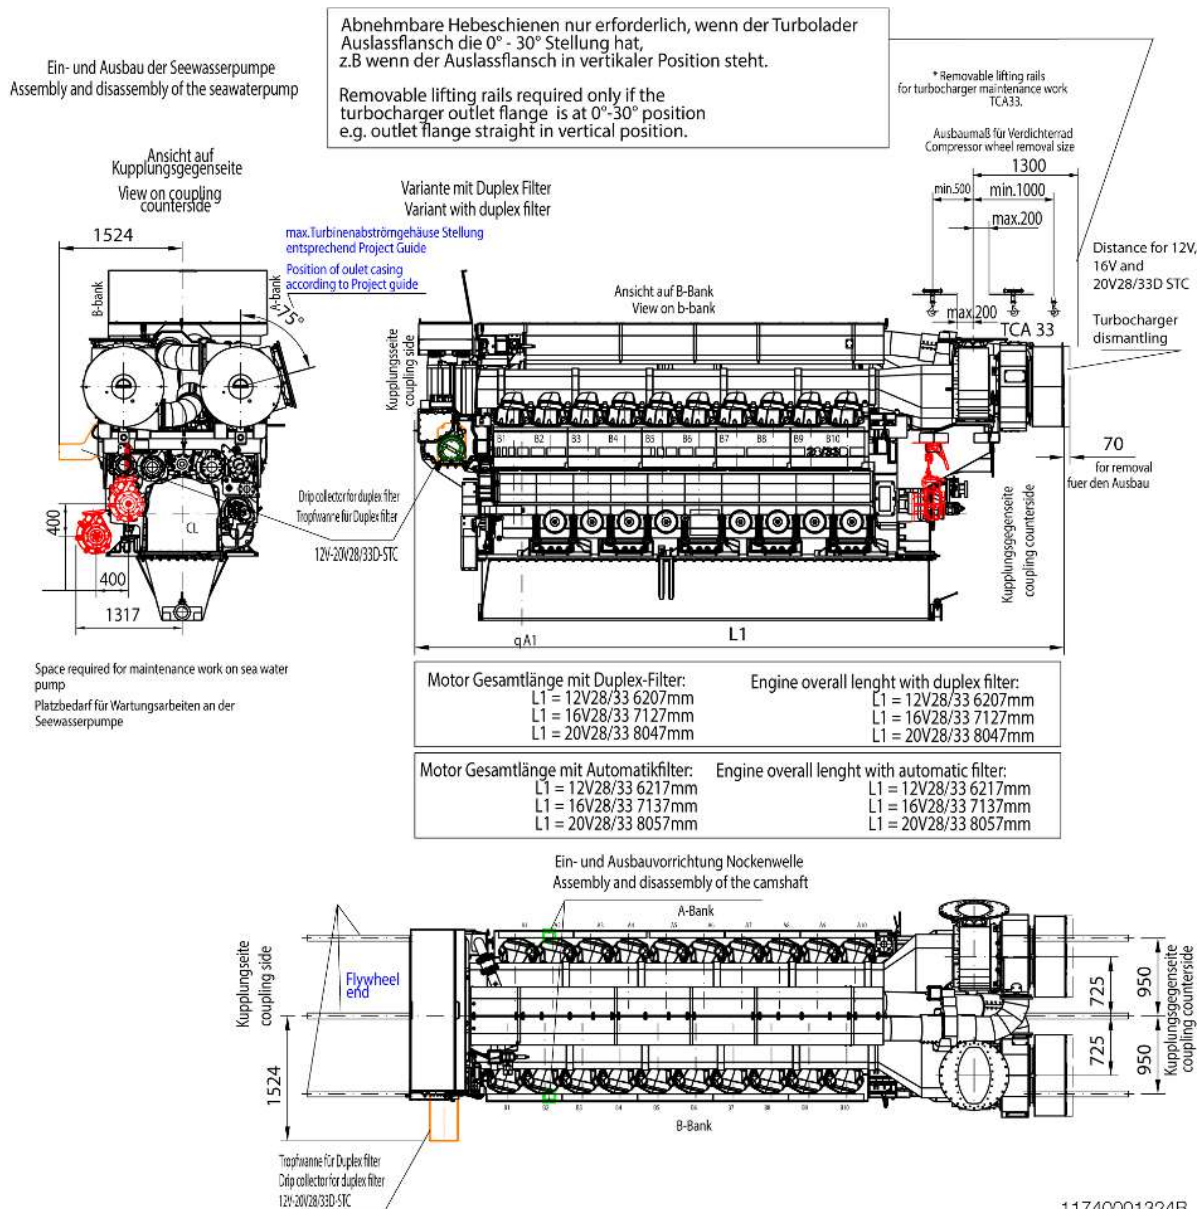


Figure 98: Removal dimensions of lube oil duplex filter, lube oil automatic filter, centrifuge, turbocharger, compressor wheel and seawater pump

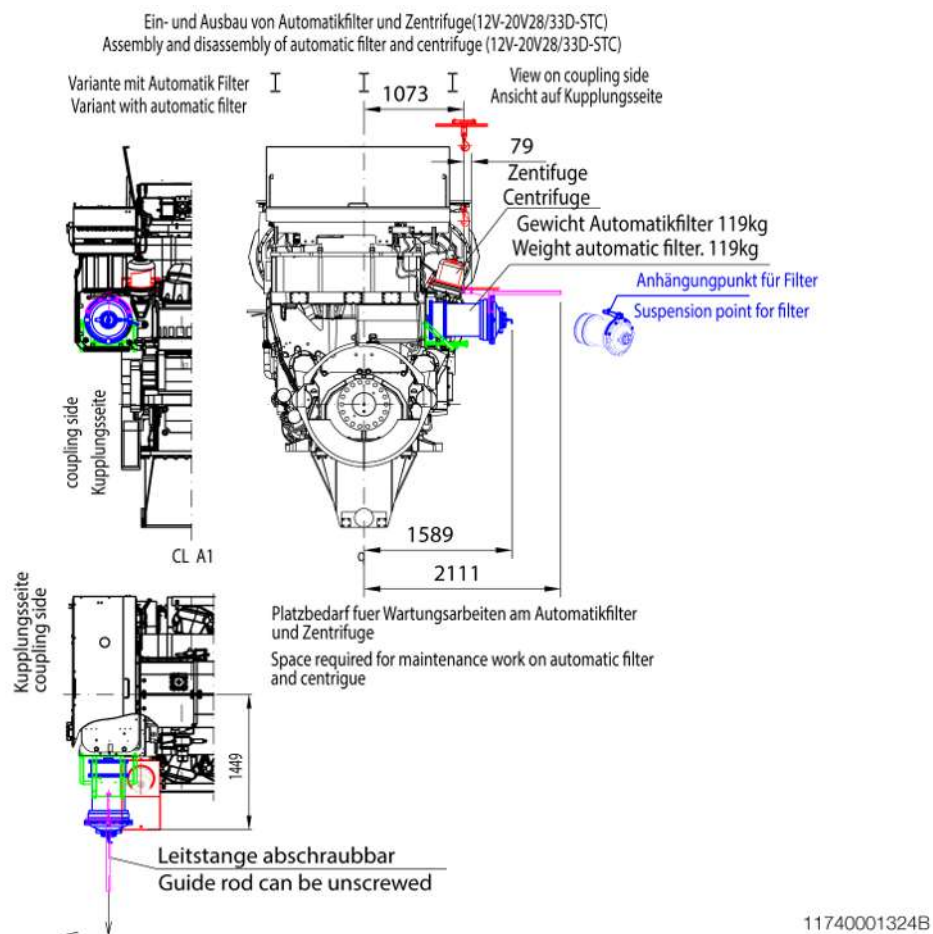

7.1 Installation and arrangement

7 Engine room planning

Figure 99: Removal dimensions of seawater pump, lube oil automatic filter, centrifuge, camshaft and turbocharger

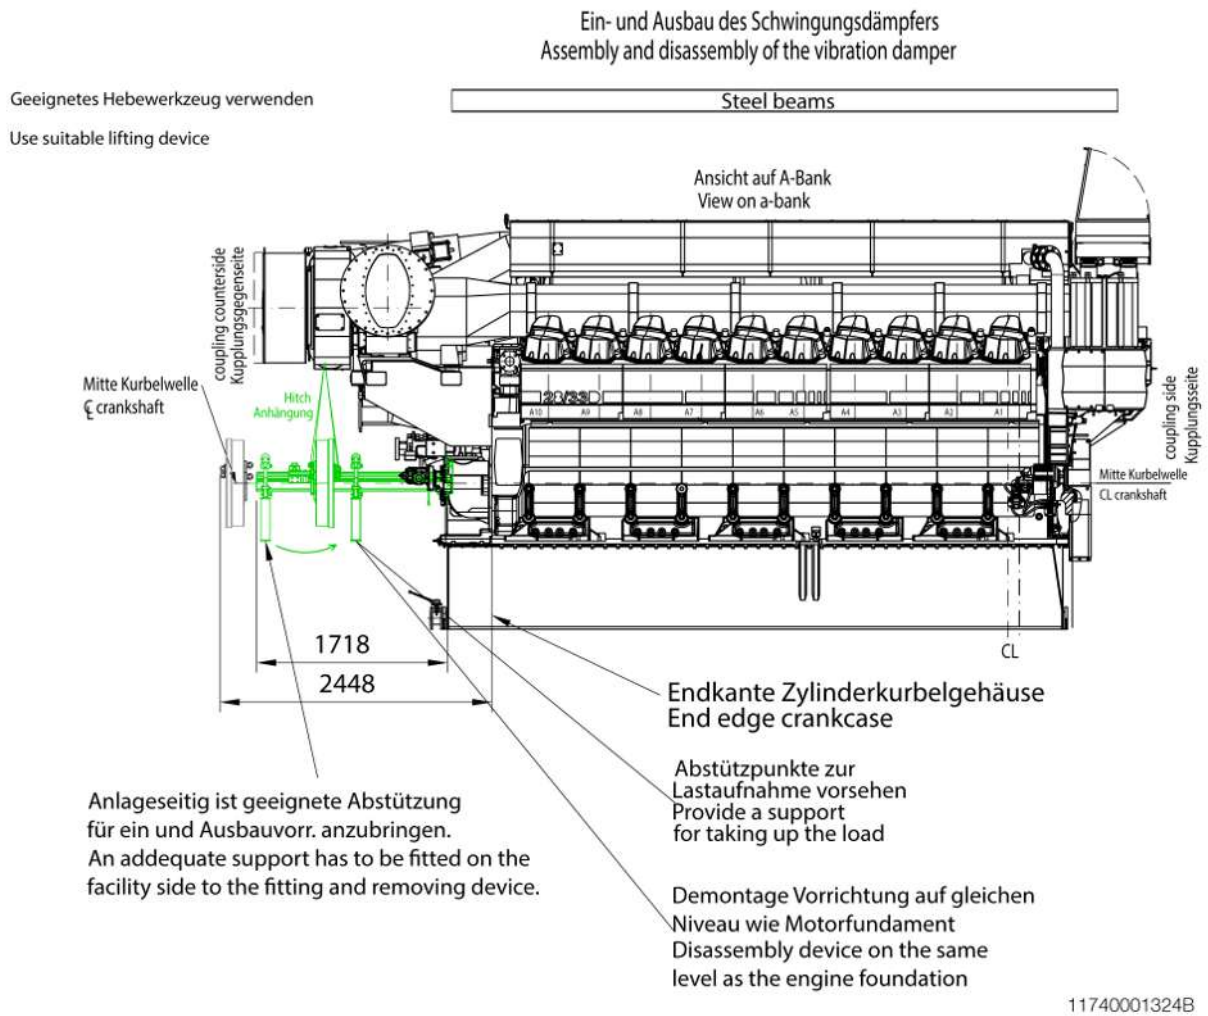


Figure 100: Removal dimensions of vibration damper

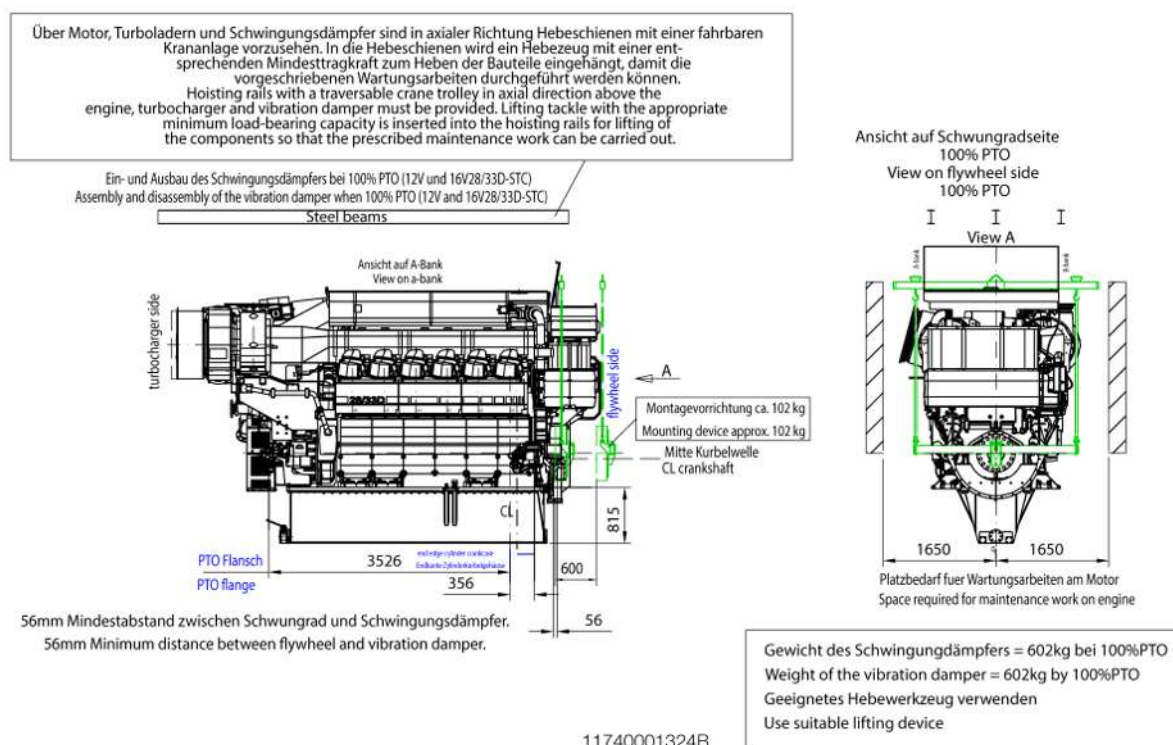


Figure 101: Removal dimensions of vibration damper PTO 100%

7.1.4 3D Engine Viewer – A support programme to configure the engine room

Everllence offers a free-of-charge online programme for the configuration and provision of installation data required for installation examinations and engine room planning: The 3D Engine Viewer .

Easy-to-handle selection and navigation masks permit configuration of the required engine type, as necessary for virtual installation in your engine room.

In order to be able to use the 3DEngine Viewer, register on our website under:

[Everllence Extranet](#)

After successful registration, the 3D Engine Viewer are available under:

[3D Engine Viewer](#)

[3D GenSet Viewer](#)

by clicking onto the requested application.

In only three steps, you will obtain professional engine room data for your further planning:

- Selection
Select the requested output, respectively the requested type.
- Configuration
Drop-down menus permit individual design of your engine according to your requirements. Each of your configurations will be presented on the basis of isometric models.
- View

The models of the 3D Engine Viewer include all essential geometric and planning-relevant attributes (e.g. connection points, interfering edges, exhaust gas outlets, etc.) required for the integration of the model into your project.

The configuration with the selected engines can now be easily downloaded.

For 2D representation as:

- .pdf
- .dwg
- .dxf

for 3D as:

- .dgn
- .stp
- .sat
- .igs
- 3D-dxf
- and many others

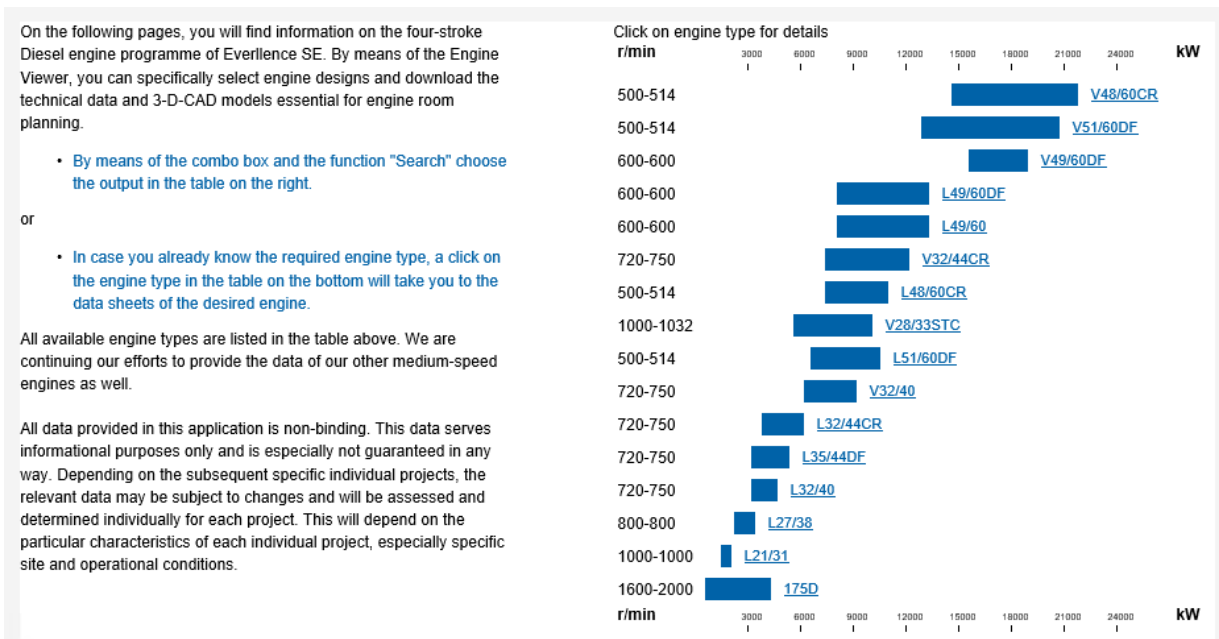


Figure 102: Selection of engine

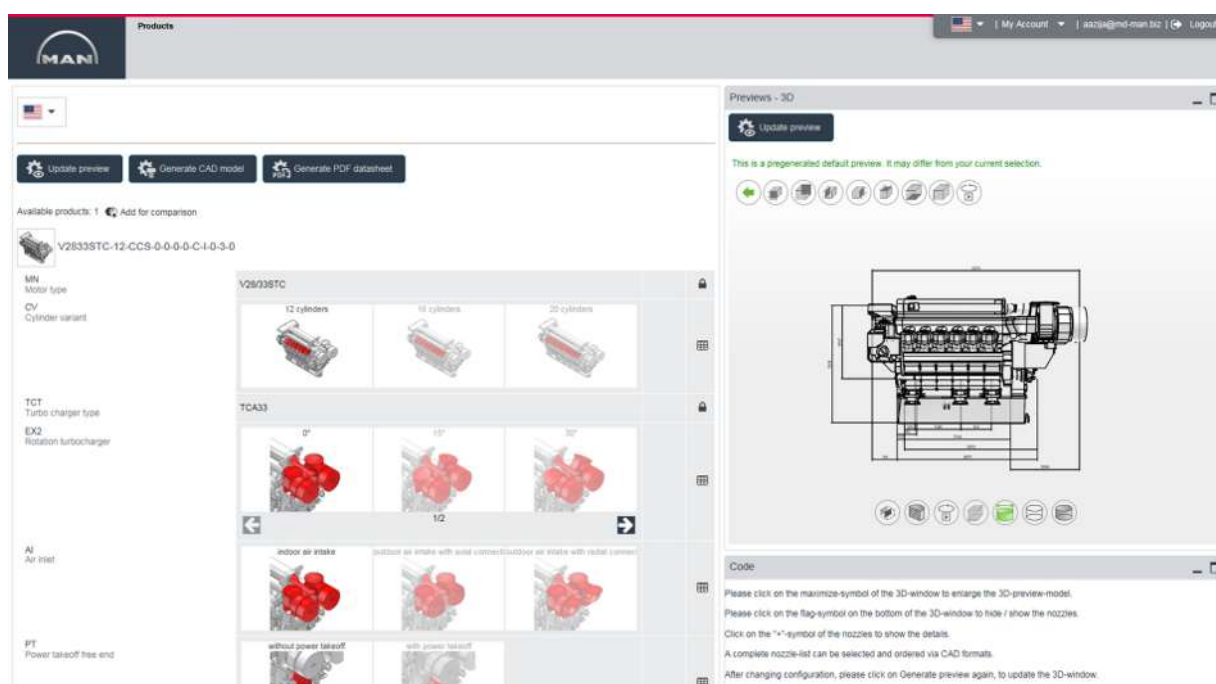


Figure 103: Preselected standard configuration

7.1.5 Lifting device

Lifting gear with varying lifting capacities are to be provided for servicing and repair work on the engine, turbocharger and charge air cooler.

Engine

Component weights

For servicing the engine an overhead traveling crane is required. The lifting capacity shall be sufficient to handle the heaviest component that has to be lifted during servicing of the engine and should foresee extra capacity e.g. to overcome the break loose torque while lifting cylinder heads. The overhead traveling crane can be chosen with the aid of the following table:

Components	Unit	Approximate weights
Cylinder head complete	kg	282
Piston with piston pin, connecting rod (for piston removal) and cylinder liner		320
Charge air cooler		789
Lube oil cooler		1,142

Table 109: Component weights

Crane arrangement

The rails for the crane are to be arranged in such a way, that the crane can cover the whole engine +1,000 mm at both sides. Three rails are required, each one over the cylinders and one over the centre line of the engine.

The hook position must reach along the engine axis, past the centreline of the first and the last cylinder, so that valves can be dismantled and installed without pulling at an angle.

Crane design

Similarly, the crane must be able to reach the tie rod at the ends of the engine. In cramped conditions, eyelets must be welded under the deck above, to accommodate a lifting pulley.

The required crane capacity is to be determined by the crane supplier.

It is necessary that:

- There is an arresting device for securing the crane while hoisting if operating in heavy seas
- There is a two-stage lifting speed
Precision hoisting approximately = 0.5 m/min
Normal hoisting approximately = 2 – 4 m/min

Places of storage

In planning the arrangement of the crane, a storage space must be provided in the engine room for the dismantled engine components which can be reached by the crane. It should be capable of holding two rocker arm casings, two cylinder covers and two pistons. If the cleaning and service work is to be carried out here, additional space for cleaning troughs and work surfaces should be planned.

Transport to the workshop

Grinding of valve cones and valve seats is carried out in the workshop or in a neighbouring room.

Transport rails and appropriate lifting tackle are to be provided for the further transport of the complete cylinder cover from the storage space to the workshop. For the necessary deck openings, see following figures and tables.

Turbocharger

Section [Turbocharger assignments, Page 29](#) shows which turbocharger type should be used for which engine variant.

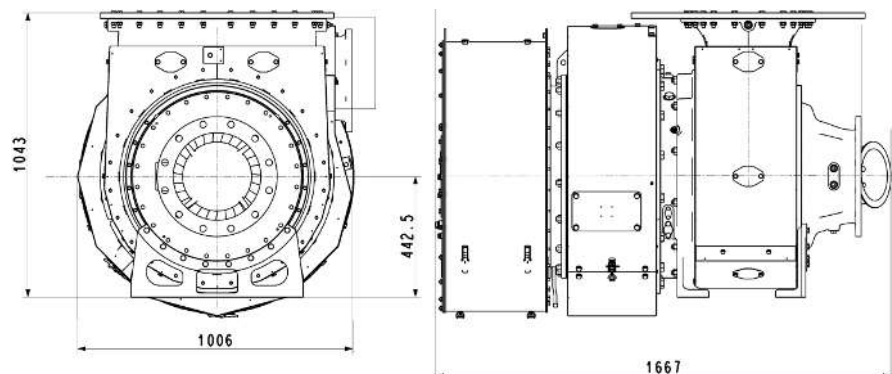
Turbocharger dimensions

Figure 104: Exemplary illustration of TCA33

Hoisting rail

A hoisting rail with a mobile trolley is to be provided over the centre of the turbocharger running parallel to its axis, into which a lifting tackle is suspended with the relevant lifting power for lifting the parts, which are mentioned in the table(s) below, to carry out the operations according to the maintenance schedule.

Turbocharger		TCA33
Compressor casing	kg	328
Turbine inlet casing axial		68
Silencer		241
Turbine rotor		54

Withdrawal space dimensions

Turbocharger		TCA33
Space for removal of silencer	mm	156

Table 110: Hoisting rail of the axial turbocharger

The withdrawal space shown in section [Removal dimensions, Page 257](#) and in the table(s) in paragraph Hoisting rail is required for separating the silencer from the turbocharger. The silencer must be shifted axially by this distance before it can be moved laterally.

Minimum distance required for dismantling clearance for the filter silencer is 70 mm, however 500 mm is recommended.

Make sure that the silencer can be removed either downwards or upwards or laterally and set aside, to make the turbocharger accessible for further servicing. Pipes must not be laid in these free spaces.

Fan shafts

The engine combustion air is to be supplied towards the intake silencer in a duct ending at a point 1.5 m away from the silencer inlet. If this duct impedes the maintenance operations, for instance the removal of the silencer, the end section of the duct must be removable. Suitable suspension lugs are to be provided on the deck and duct.

Gallery

If possible the ship deck should reach up to both sides of the turbocharger (clearance 50 mm) to obtain easy access for the maintenance personnel. Where deck levels are unfavourable, suspended galleries are to be provided.

Charge air cooler

One unit is installed on the 12V engine and two units are installed on the 16V and 20V engines.

No. of cylinders, config.	Weight (per unit)	Length (L)	Width (B)	Height (H)
	kg	mm	mm	mm
12V	710	2,338	445	410
16V	420	1,303	445	410
20V	600	1,763	445	410

Table 111: Weights and dimensions of charge air cooler bundle

For further information contact Everllence.

7.1.6 Space requirement for maintenance

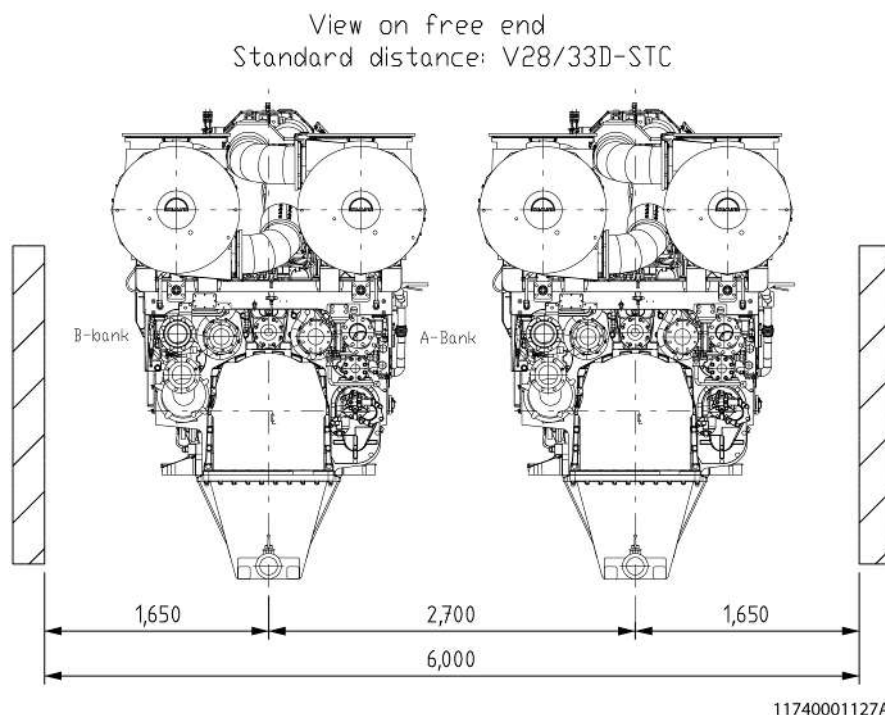


Figure 105: Space requirement for maintenance

7.1.7 Major spare parts

In accordance with the rules of the classification society "DNV GL" we only supply those spare parts specified in the following list which refer to original equipment supplied by us. Spare parts for monitoring and remote control equipment are included in the relevant items of the scope of supply.

Note:

Navigation range A = unrestricted range.

Scope of supply for 1 ship

	Quantity	Description
Crankshaft bearing	1	Crankshaft bearing shells, 2-part of each kind, tie-rods and cross pin with nuts
	1	Thrust bearing ring (two part) for 1 locating bearing
Connecting rod and main piston	1	Upper and lower connecting rod bearing shell, with bolts (and nuts where provided)
	1	Piston pin bush
	1	Piston pin
	2	Lock ring for piston pin
	1	Main piston with piston rings, piston pin, connecting rod, bearing shells, bolts and nuts, ready for fitting
	1	Compression and oil scraper rings for 1 main piston

	Quantity	Description
Cylinder liner and cylinder head	1	Cylinder liner with seals, ready for fitting
	1	Cylinder head with valves and seals
	2	Bolts with nuts, for fixing one cylinder head
Valves in cylinder head	2	Inlet valve with valve guide and valve seat ring
	2	Exhaust valve with valve guide and valve seat ring
	12/16/20	Fuel injection valve (for 1 engine 12V/16V/20V) with injection pipes
Miscellaneous	1	Air start motor
	1	Seals for cylinder liner, support ring ¹⁾ , cooling water overflow, valves in cylinder head ¹⁾ , between cylinder head and charge-air pipe, between cylinder head and exhaust gas pipe, to push rod jacketing ¹⁾ and to valve protection cap ¹⁾ sufficient for 1 cylinder
	1	Expansion joint for exhaust gas pipe on the engine

¹⁾ where provided.

Note:
Subject to modification. Consumed spare parts should be replaced immediately.

Table 112: Scope of supply

Turbocharger weight schedule

Turbocharger		TCA33
Silencer	kg	241
Compressor casing		328
Turbine rotor		54
Turbocharger		1,430
Space for removal of silencer	mm	156

Table 113: Hoisting rail for TCA33 turbocharger


Maintenance items

Major spare parts	Weight [kg]
Air by-pass valve	2
Camshaft journals	35
Camshaft gears	65
Camshaft gears – Intermediate	80
Camshaft segment	50
Charge air cooler 12V	754
Charge air cooler 16V	870 (2 x 435)
Charge air cooler 20V	1,220 (2 x 610)
Connecting rod – Complete with bush, bearing and bolts	91
Crankshaft gear	32
Cylinder head covers (main)	7

Major spare parts	Weight [kg]
Cylinder head with valves (less covers and valve gear)	275
Cylinder liner without cutting ring	133
Explosion relief valve and door	12
Fuel filter element (off engine)	8
Fuel injection pump	9
Fuel injector	6.5
Fuel circulating pump	12
Main bearing (lower + upper)	3
Main bearing caps	72
Oil filter element	8
Lube oil pump with attached fuel pump	285
Piston with piston pin	70
Compressed air starter motor	30
Tappet housing assembly	55
Turbocharger	1,430
Vibration damper 12V, 16V	579
Vibration damper 20V	595
Water pump – High temperature	90
Water pump – Jacket water	90
Water pump – Seawater	250
All weights quoted are for guidance only.	

Table 114: Maintenance items

7.1.8 Major spare parts – Main dimensions








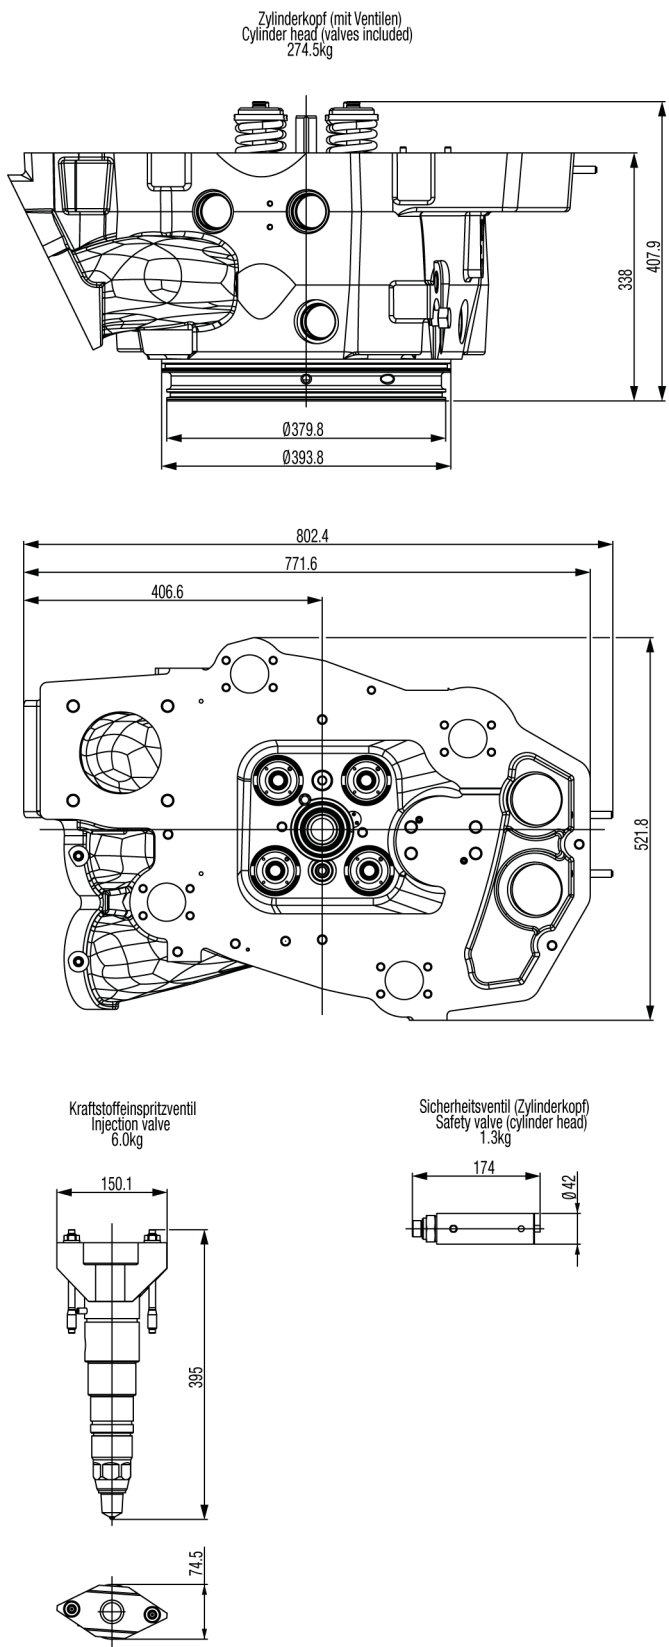


11000230922

2026-02-24 - 6.2


7.1 Installation and arrangement

7 Engine room planning

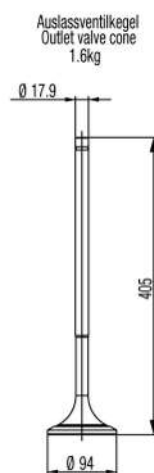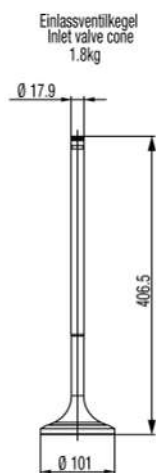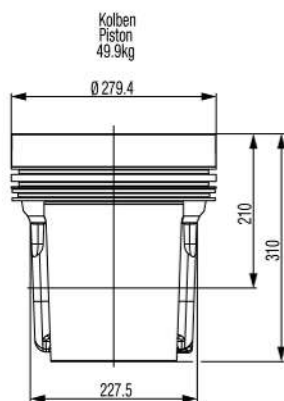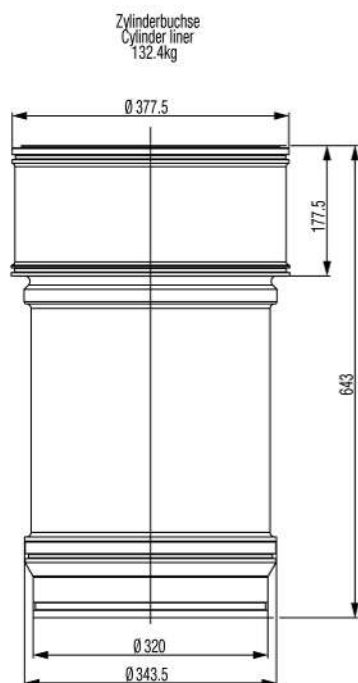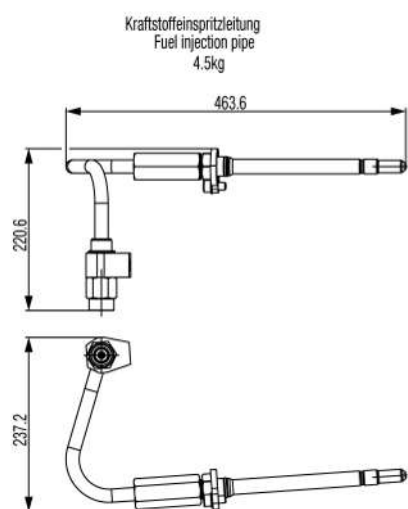

11000230922

11000230922

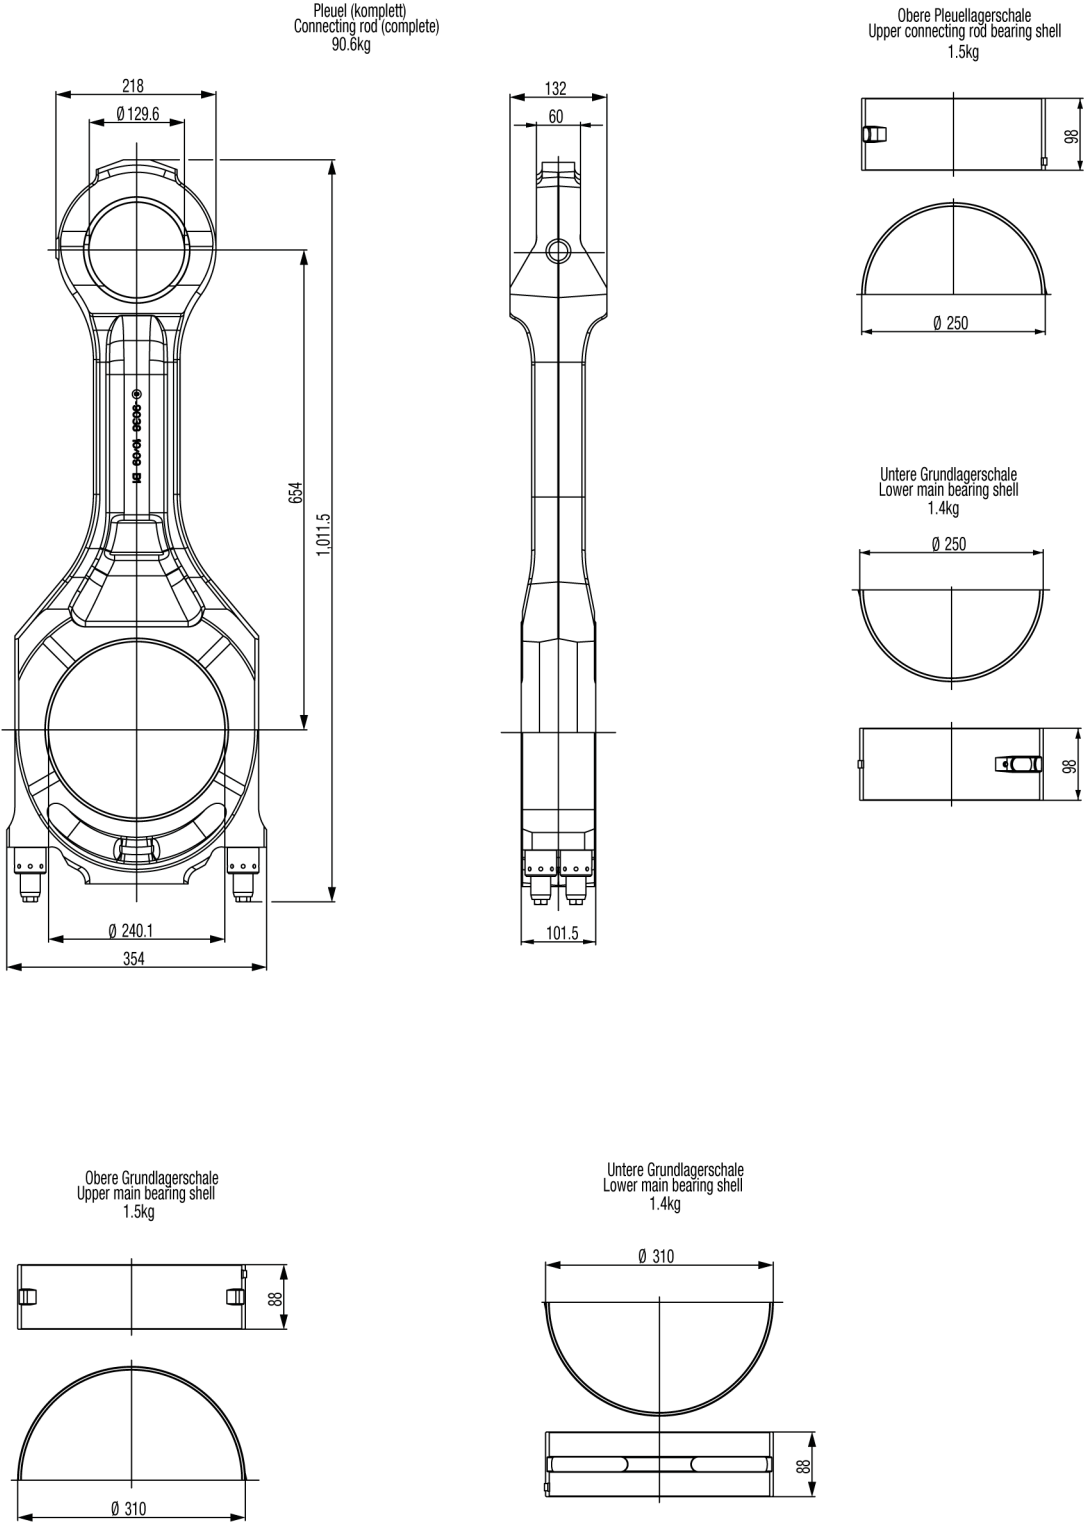



7.1 Installation and arrangement

7 Engine room planning



11000230922

2026-02-24 - 6.2

Druckluftanlasser für Motorrechtslauf
Compressed air starter for engine clockwise rotation
39.5kg

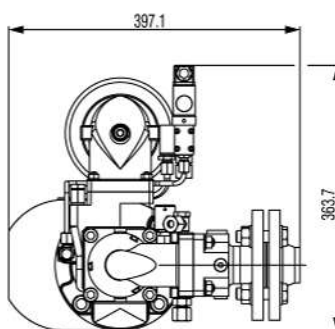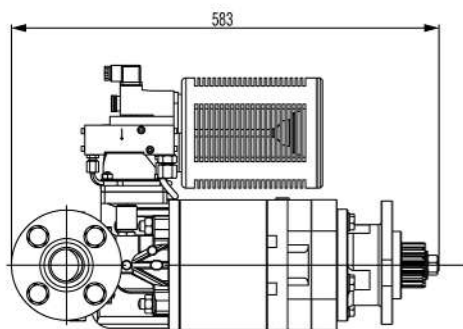


Druckluftanlasser für Motorlinkslauf
Compressed air starter for engine counter clockwise rotation
39.5kg

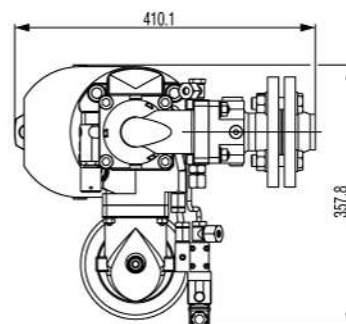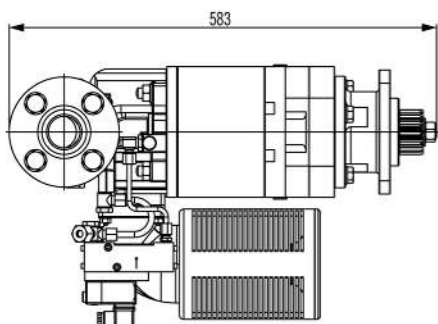


11000230922

Abgaskompensator (Zwischen Leitungsteilstücken)
Exhaust gas expansion joint (between pipes)
5.0kg




Abgaskompensator (für STC-Leitung)
Exhaust gas expansion joint (in STC-pipe)
4.3kg




11000230922





Hochdruckpumpe
High pressure pump
9.2kg

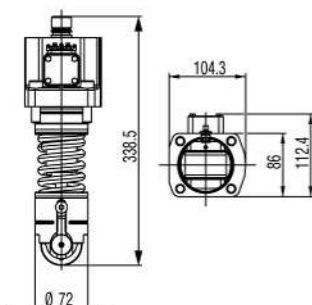

Abgaskompensator (vor Turbolader)
Exhaust gas expansion joint (before turbo charger)
31.8kg

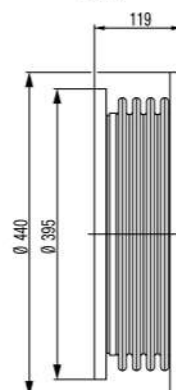

11000230922

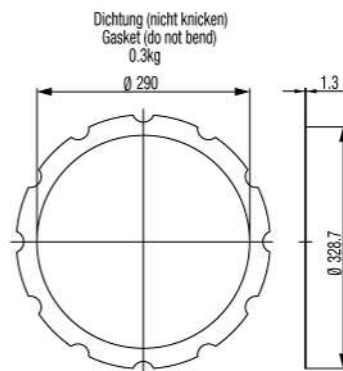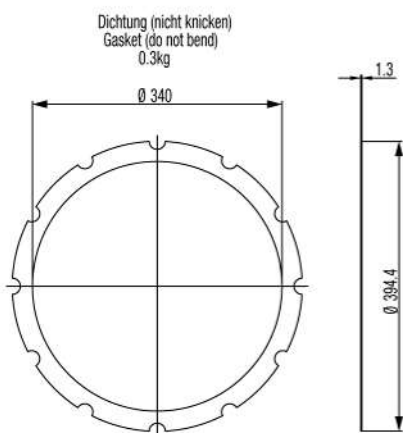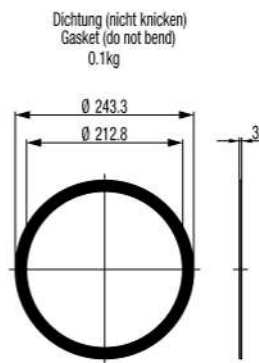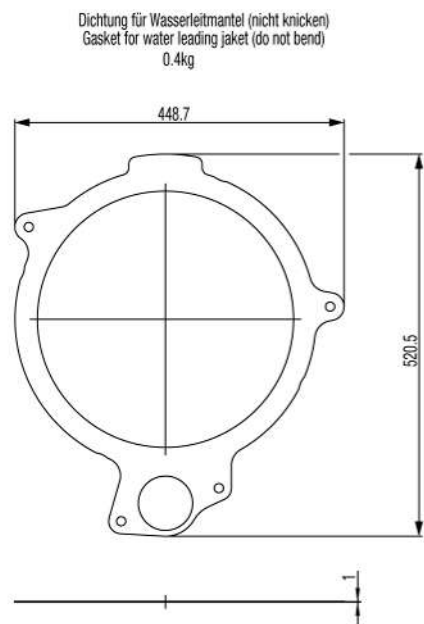

11000230922

7.1.9 Mechanical propulsion system arrangement

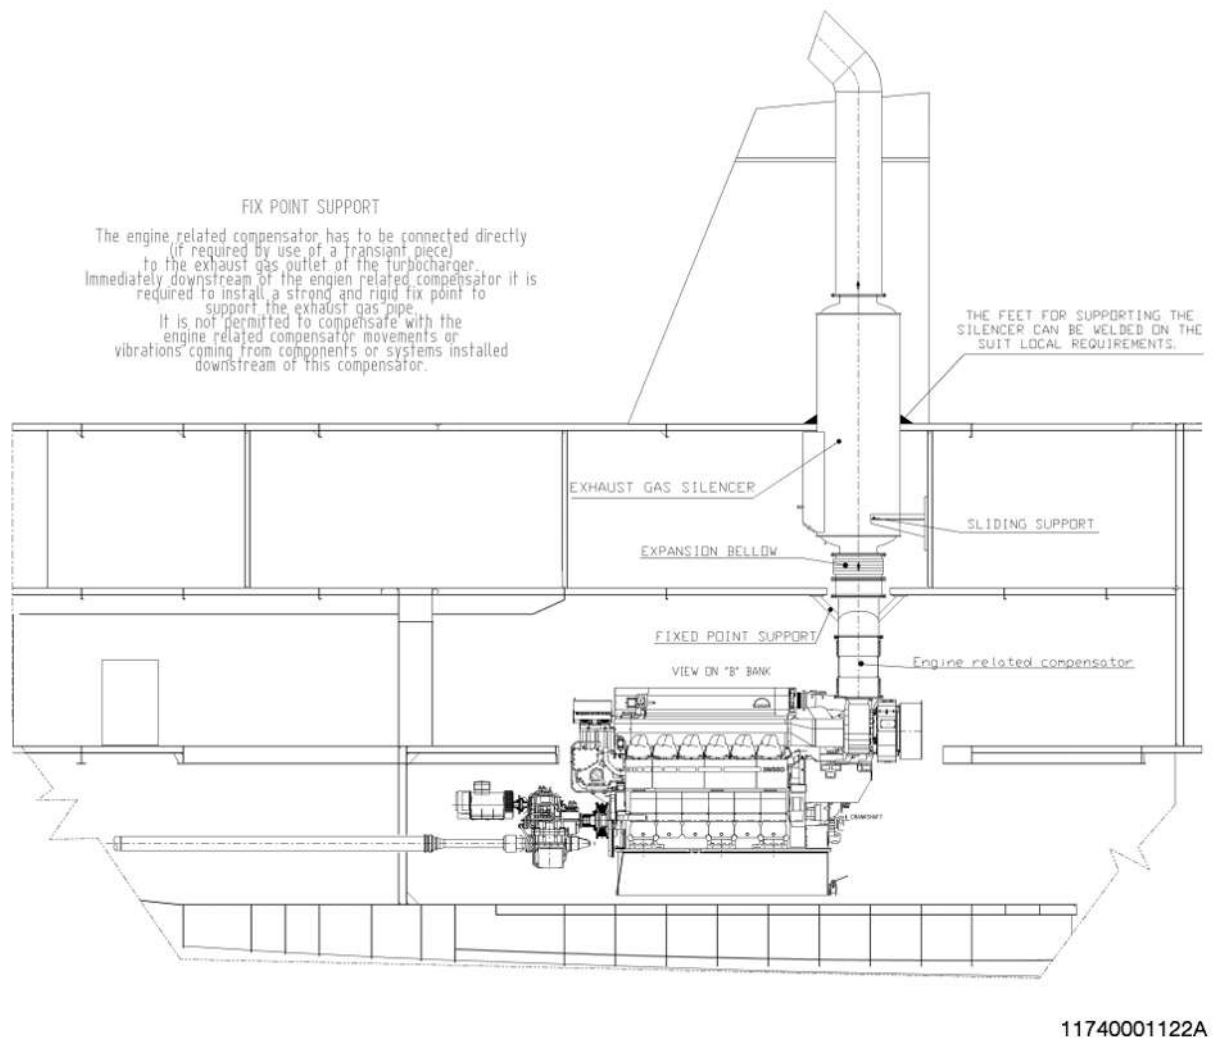


Figure 106: Example: Mechanical propulsion system arrangement – Exhaust gas section

Fix point support

The engine related compensator has to be connected directly to the exhaust gas outlet of the turbocharger (installation of compensator vertically or max. 45° position after turbocharger).

In case that the compensator cannot be directly connected to the exhaust gas outlet of the turbocharger, contact Everllence.

Immediately downstream of the engine related compensator it is required to install a strong and rigid fix point to support the exhaust gas pipe.

It is not permitted to compensate with the engine related compensator movements or vibrations coming from components or systems installed downstream of this compensator.

7.2 Exhaust gas ducting

7.2.1 Example: Ducting arrangement

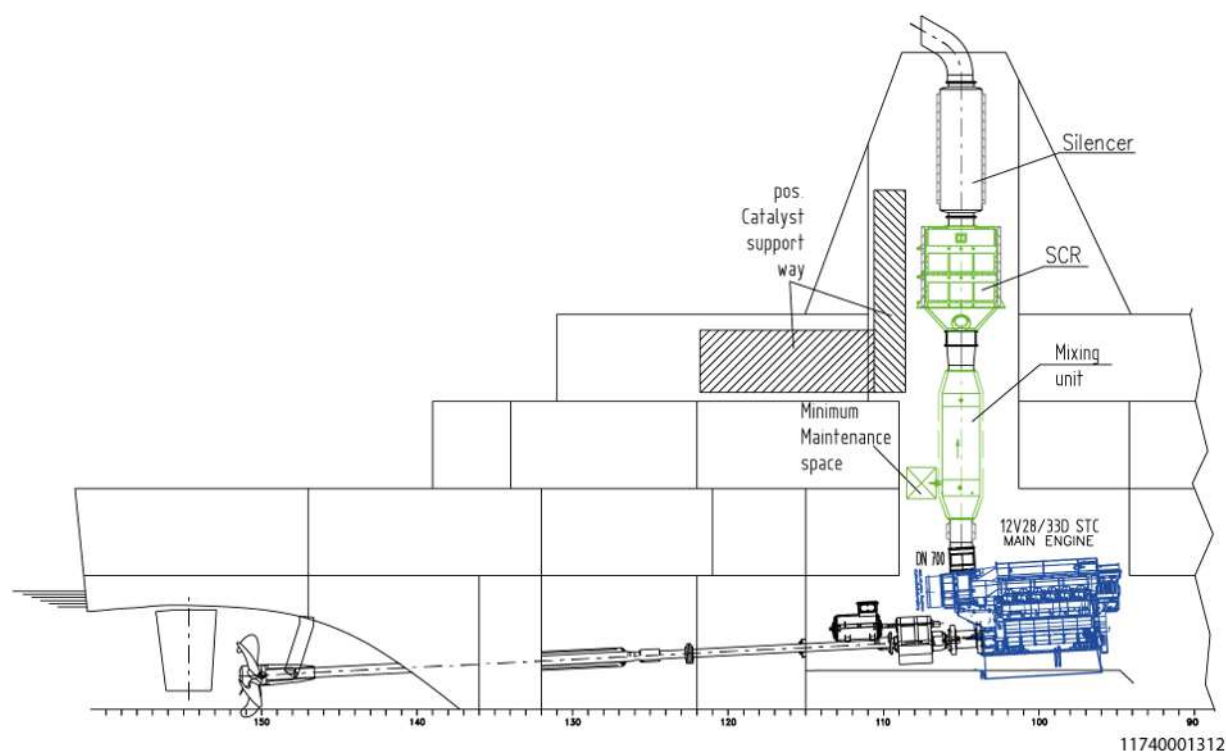


Figure 107: Example: Exhaust gas ducting arrangement

Fix point support

The engine related compensator has to be connected directly to the exhaust gas outlet of the turbocharger (installation of compensator vertically or max. 45° position after turbocharger). In case that the compensator cannot be directly connected to the exhaust gas outlet of the turbocharger, contact Everlence. Immediately downstream of the engine related compensator, it is required to install a strong and rigid fix point to support the exhaust gas pipe. It is not permitted to compensate with the engine related compensator movements or vibrations coming from components or systems installed downstream of this compensator.

7.2.2 External general details for Tier III SCR system duct arrangement

Everlence recommends that the SCR reactor housing should be mounted before all other components (e.g. boiler, silencer) in the exhaust duct, coming from the engine side. A painting on the inside wall of the exhaust duct in front of the SCR system is not permissible.

All of the spaces/openings for cleaning and maintenance on the entire unit, including air reservoir module, dosing unit and reactor housing with soot-blowers must be accessible.

We strongly recommend that in front of the reactor housing sufficient space for the maintenance personal and/or for the temporary storage of the catalyst honeycombs has to be foreseen (see section [SCR system, Page 246](#)).

Catalyst elements could reach a weight of 25 kg, the reactor openings could reach a total weight of about 70 kg, Everllence strongly recommends a lifting capability above the reactors.

A very important point is the transportation way and storage space of the catalyst honeycombs within the funnel for supply of the SCR reactor during maintenance or catalyst refreshment, one reactor could contain more than 100 elements.

To avoid time-consuming or implementation of a scaffolding, Everllence strongly recommends at minimum a lifting device in the funnel or any kind of material elevator. A porthole from outside rooms on level with the reactor housing is also a possibility, as far as those rooms could be supplied with the catalyst honeycombs.

7.2.3 Position of the outlet casing of the turbocharger

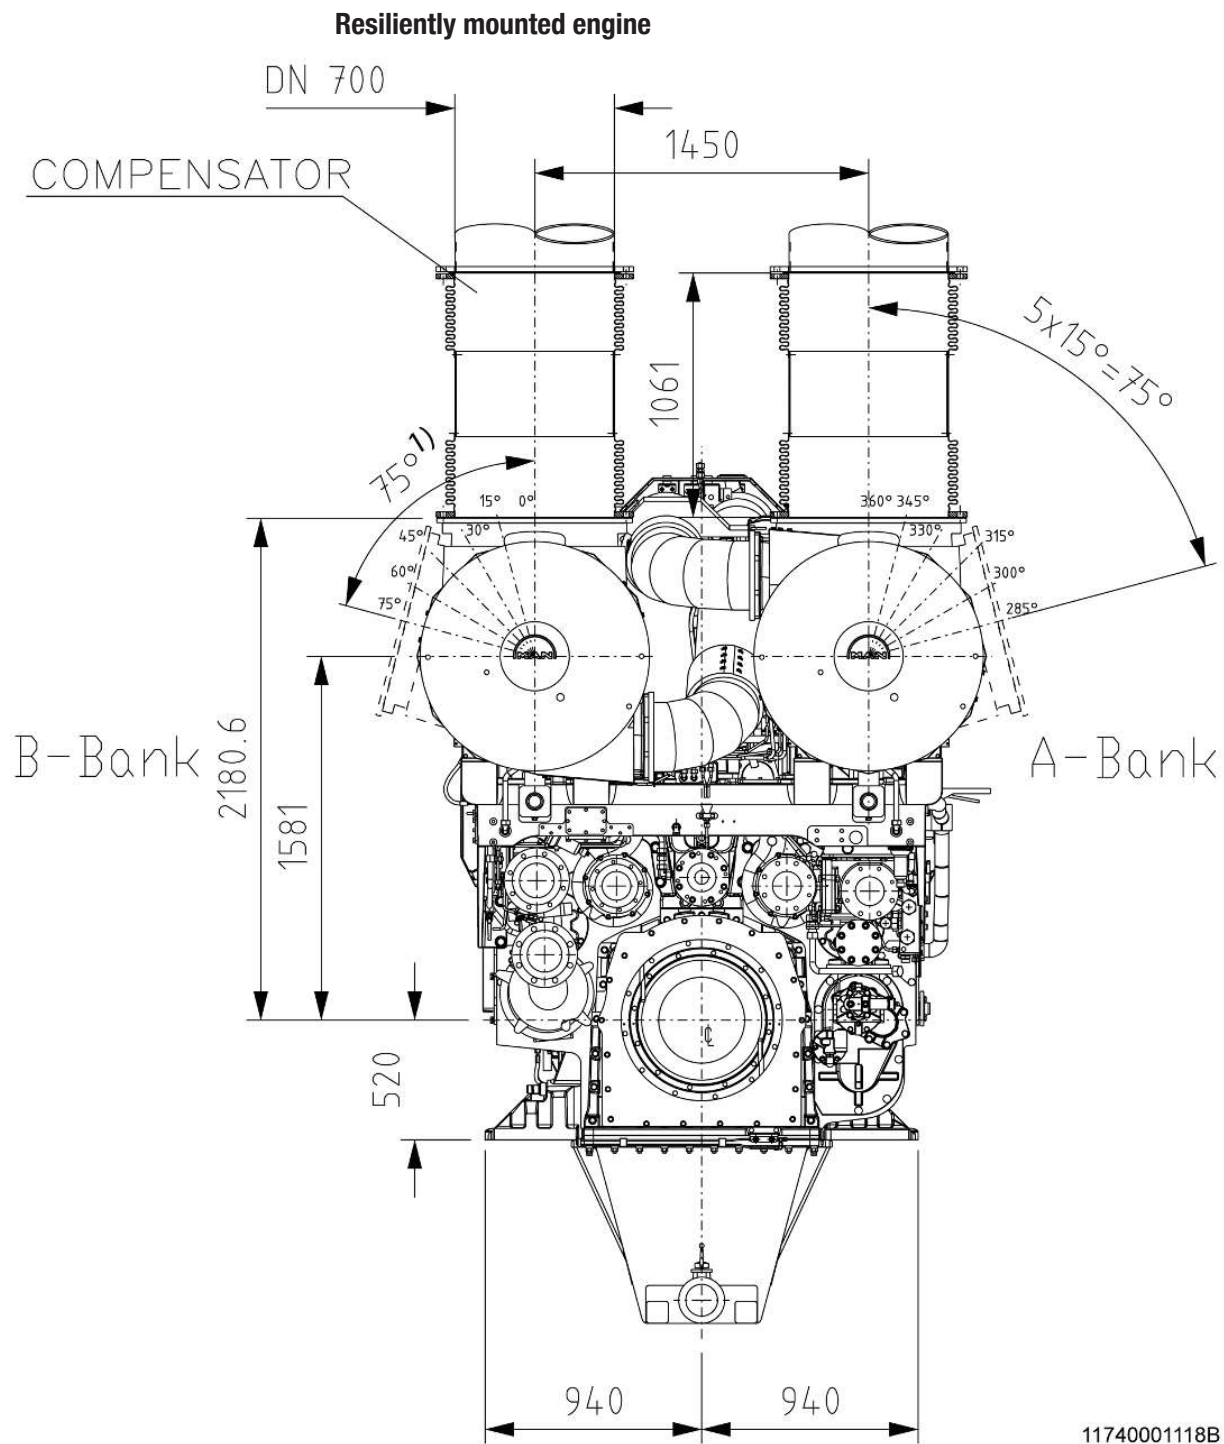


Figure 108: Possible positions of the outlet casing of the turbocharger – View on counter coupling side

Note:

¹⁾ In case of attached wastegate (valid for all Tier III applications) the position of the outlet casing of the turbocharger on B-Bank needs to be "0°".

This page is intentionally left blank

8 Annex

8.1 Safety instructions and necessary safety measures

The following list of basic safety instructions, in combination with further engine documentation like user manual and working instructions, should ensure a safe handling of the engine. Due to variations between specific plants, this list does not claim to be complete and may vary with regard to project-specific requirements.

8.1.1 General

There are risks at the interfaces of the engine, which have to be eliminated or minimised in the context of integrating the engine into the plant system. Responsible for this is the legal person which is responsible for the integration of the engine.

Following prerequisites need to be fulfilled:

- Layout, calculation, design and execution of the plant have to be state of the art.
- All relevant classification rules, regulations and laws are considered, evaluated and are included in the system planning.
- The project-specific requirements of Everllence regarding the engine and its connection to the plant are implemented.
- In principle, the more stringent requirements of a specific document is applied if its relevance is given for the plant.

8.1.2 Safety equipment and measures provided by plant-side

- Proper execution of the work

Generally, it is necessary to ensure that all work is properly done according to the task trained and qualified personnel.

All tools and equipment must be provided to ensure adequate accessible and safe execution of works in all life cycles of the plant.

Special attention must be paid to the execution of the electrical equipment. By selection of suitable specialised companies and personnel, it has to be ensured that a faulty feeding of media, electric voltage and electric currents will be avoided.

- Fire protection

A fire protection concept for the plant needs to be executed. All from safety considerations resulting necessary measures must be implemented. The specific remaining risks, e.g. the escape of flammable media from leaking connections, must be considered.

Generally, any ignition sources, such as smoking or open fire in the maintenance and protection area of the engine is prohibited.

Smoke detection systems and fire alarm systems have to be installed and in operation.

- Electrical safety

Standards and legislations for electrical safety have to be followed. Suitable measures must be taken to avoid electrical short circuit, lethal electric shocks and plant specific topics as static charging of the piping through the media flow itself.

- Noise and vibration protection

The noise emission of the engine must be considered early in the planning and design phase. A soundproofing or noise encapsulation could be necessary. The foundation must be suitable to withstand the engine vibration and torque fluctuations. The engine vibration may also have an impact on installations in the surrounding of the engine, as galleries for maintenance next to the engine. Vibrations act on the human body and may dependent on strength, frequency and duration harm health.

- Thermal hazards

In workspaces and traffic areas hot surfaces must be isolated or covered, so that the surface temperatures comply with the limits by standards or legislations.

- Composition of the ground

The ground, workspace, transport/traffic routes and storage areas have to be designed according to the physical and chemical characteristics of the excipients and supplies used in the plant.

Safe work for maintenance and operational staff must always be possible.

- Adequate lighting

Light sources for an adequate and sufficient lighting must be provided by plant-side. The current guidelines should be followed (100 Lux is recommended, see also DIN EN 1679-1).

- Working platforms/scaffolds

For work on the engine working platforms/scaffolds must be provided and further safety precautions must be taken into consideration. Among other things, it must be possible to work secured by safety belts. Corresponding lifting points/devices have to be provided.

- Setting up storage areas

Throughout the plant, suitable storage areas have to be determined for stabling of components and tools.

It is important to ensure stability, carrying capacity and accessibility. The quality structure of the ground has to be considered (slip resistance, resistance against residual liquids of the stored components, consideration of the transport and traffic routes).

- Engine room ventilation

An effective ventilation system has to be provided in the engine room to avoid endangering by contact or by inhalation of fluids, gases, vapours and dusts which could have harmful, toxic, corrosive and/or acid effects.

The engine room ventilation must ensure a maximum engine room temperature, with following boundary conditions:

- Maximum air temperature in the area of the engine and its components $\leq 45^{\circ}\text{C}$.
- Maximum air temperature at least 5 K below the flash point of any liquids, that is present within the engine room.

- Venting of crankcase and turbocharger

With crankcase ventilation the gases/vapours originating from crankcase and turbocharger are not ignitable. For multi-engine plants, each engine has to be ventilated separately. The engine ventilation of different engines must not be connected.

In case of an installed suction system, it has to be ensured that it will not be stopped until at least 20 minutes after engine shutdown.

- Intake air filtering

In case air intake is realised through piping and not by means of the turbocharger's intake silencer, appropriate measures for air filtering must be provided. It must be ensured that particles exceeding 5 µm will be re-strained by an air filtration system.

- Quality of the intake air

It has to be ensured that combustible media will not be sucked in by the engine.

Intake air quality according to the section [Specification of intake air \(combustion air\), Page 172](#) has to be guaranteed.

- Emergency stop system

The emergency stop system requires special care during planning, realisation, commissioning and testing at site to avoid dangerous operating conditions. The assessment of the effects on other system components caused by an emergency stop of the engine must be carried out by plant-side.

- Fail-safe 24 V power supply

Because engine control, alarm system and safety system are connected to a 24 V power supply this part of the plant has to be designed fail-safe to ensure a regular engine operation.

- Hazards by rotating parts/shafts

Contact with rotating parts must be excluded by plant-side (e.g. free shaft end, flywheel, coupling).

- Safeguarding of the surrounding area of the flywheel

The entire area of the flywheel has to be safeguarded by plant-side.

Special care must be taken, inter alia, to prevent from: Ejection of parts, contact with moving machine parts and falling into the flywheel area.

- Securing of the engine's turning gear

The turning gear has to be equipped with an optical and acoustic warning device. When the turning gear is first activated, there has to be a certain delay between the emission of the warning device's signals and the start of the turning gear. The gear wheel of the turning gear has to be covered. The turning gear should be equipped with a remote control, allowing optimal positioning of the operator, overlooking the entire hazard area (a cable of approximately 20 m length is recommended). Unintentional engagement or start of the turning gear must be prevented reliably.

It has to be prescribed in the form of a working instruction that:

- The turning gear has to be operated by at least two persons.
- The work area must be secured against unauthorised entry.
- Only trained personnel is permissible to operate the turning gear.

- Securing of the starting air pipe

To secure against unintentional restarting of the engine during maintenance work, a disconnection and depressurisation of the engine's starting air system must be possible. A lockable starting air stop valve must be provided in the starting air pipe to the engine.

- Securing of the turbocharger rotor

To secure against unintentional turning of the turbocharger rotor while maintenance work, it must be possible to prevent draught in the exhaust gas duct and, if necessary, to secure the rotor against rotation.

- Consideration of the blow-off zone of the crankcase cover's relief valves

During crankcase explosions, the resulting hot gases will be blown out of the crankcase through the relief valves. This must be considered in the overall planning.

- Installation of flexible connections

For installation of flexible connections follow strictly the information given in the planning and final documentation and the manufacturer manual.

Flexible connections may be sensitive to corrosive media. For cleaning only adequate cleaning agents must be used (see manufacturer manual). Substances containing chlorine or other halogens are generally not permissible.

Flexible connections have to be checked regularly and replaced after any damage or lifetime given in manufacturer manual.

- Connection of exhaust port of the turbocharger to the exhaust gas system of the plant

The connection between the exhaust port of the turbocharger and the exhaust gas system of the plant has to be executed gas tight and must be equipped with a fire proof insulation.

The surface temperature of the fire insulation must not exceed 220°C.

In workspaces and traffic areas, a suitable contact protection has to be provided whose surface temperature must not exceed 60°C.

The connection has to be equipped with compensators for longitudinal expansion and axis displacement in consideration of the occurring vibrations (the flange of the turbocharger reaches temperatures of up to 450°C).

- Media systems

The stated media system pressures must be complied. It must be possible to close off each plant-side media system from the engine and to depressurise these closed off pipings at the engine. Safety devices in case of system over pressure must be provided.

- Drainable supplies and excipients

Supply system and excipient system must be drainable and must be secured against unintentional recommissioning (EN 1037). Sufficient ventilation at the filling, emptying and ventilation points must be ensured. The residual quantities which must be emptied have to be collected and disposed of properly.

- Spray guard has to be ensured for liquids possibly leaking from the flanges of the plant's piping system. The emerging media must be drained off and collected safely.

- Charge air blow-off (if applied)

The piping must be executed by plant-side and must be suitably isolated. In workspaces and traffic areas, a suitable contact protection has to be provided whose surface temperature must not exceed 60°C.

The compressed air is blown-off either outside the vessel or into the engine room. In both cases, installing a silencer after blow-off valve is recommended. If the blow-off valve is located upstream of the charge air cooler, air temperature can rise up to 200°C. It is recommended to blow-off hot air outside the plant.

- Signs

- Following figure shows exemplarily the risks in the area of a combustion engine. This may vary slightly for the specific engine.

This warning sign has to be mounted clearly visibly at the engine as well as at all entrances to the engine room.



Figure 109: Warning sign E11.48991-1108

- Prohibited area signs.

Depending on the application, it is possible that specific operating ranges of the engine must be prohibited.

In these cases, the signs will be delivered together with the engine, which have to be mounted clearly visibly on places at the engine which allow intervention of the engine operation.

- Optical and acoustic warning device

Communication in the engine room may be impaired by noise. Acoustic warning signals might not be heard. Therefore it is necessary to check where at the plant optical warning signals (e.g. flash lamp) should be provided.

In any case, optical and acoustic warning devices are necessary while using the turning gear and while starting/stopping the engine.

8.2 Programme for Factory Acceptance Test (FAT)

1 Purpose

This instruction specifies the standard of tests and checks to be carried out during Factory Acceptance Tests (FAT) of marine engines. The following tests and checks are based on the rules and regulations of the classification societies as well as the ISO standards 3046 and 15550 in their versions at the time when this instruction is published and which have to be conducted to fulfill the requirements of a standard FAT.

2 Scope

This instruction is valid for all employees of companies and business units mentioned below, and is binding for all employees, which are affected by this instruction within the scope of their duties. The respective manager has to ensure that the employees know and observe this instruction. It is valid for marine applications of medium-, and high speed engines with a nominal speed up to 1000rpm and engine driving generators.

Valid for the following locations: Augsburg; Aurangabad; Saint-Nazaire

Valid for the following business units: SBU E

Valid for the following departments: FR-EE; RM-IN-PE; PEAA

3 Terms and definitions

Term	Definition
FAT	Factory Acceptance Test
CPP	Controllable Pitch Propeller
FPP	Fixed Pitch Propeller
IACS	International Association of Classification Societies

4 Engine testing

The complete test of a medium speed engine on a test bed requires several days. Therefore, the test is separated into two periods, the pre-test and the demonstration test. The pre-test is an internal test, which is partially to be done in presence of the classification society if required. The demonstration test is to verify the engine quality and observance of contractually agreed terms and conditions in presence of classification society and customer. For each engine, an engine specific procedure for the demonstration test has to be generated based on the tests and checks of point 4.2 of this instruction and contractual agreements with the customer. Additional test requests by the classification society have to be considered in the test procedure. Under the following points the standard scope of pre-test and demonstration test is specified.

4.1 Pre-tests (internal tests)

The pre-test is divided into tests and checks to be carried out prior to the first engine start and subsequent checks during engine operation. The main focus is to detect and fix technical issues and adjust the engine before starting the demonstration tests. Some checks of the pre-tests are required by classification rules. Before conducting these tests the corresponding surveyor of the classification society has to be informed about the pre-test date in time.

Figure 110: Programme for Factory Acceptance Test (FAT) – Part 1

4.1.1 Main tests and check before first engine start

- a) check crank web deflection after alignment of the engine (results to be stated in FAT protocol)
- b) flushing of all media systems (lube oil, fuel oil, water)
- c) visual check of engine including cam shaft and crank shaft housing (before first engine start and subsequently during operation)
- d) test of alarm and safety system. The requirements of the classification society and engine manufacturer specification (check of safety functions F0387EN) must be fulfilled. The test results must be stated in the FAT protocol.

4.1.2 Function and performance check

Limits and requirements for each test can be found in project guides, rules of classification societies and internal specifications of the engine manufacturer. The internal testing of engines is generally specified in the Guideline "F0387EN" of the engine manufacturer. The following points represent the minimum of tests to be conducted to ensure the functionality and performance of the engine.

- a. Start of tests and calculation of start air consumption in gas and diesel operation. To be done at least once per shipset for each engine type. The results have to be stated in each FAT protocol for reference.
- b. Thermographic inspection (according to working instruction W0202EN - Surface Temperature Examination on Engines and Components for Marine Application) of engine insulation for confirmation of SOLAS surface temperature requirements.
- c. Noise level and vibration measurements according to ISO 10816-6 and manufacturer guidelines (only to be carried out and stated in the FAT protocol if there is a contractual obligation).
- d. Integration tests to be conducted on each engine, except if the tests have already been conducted on an identical engine of the same vessel or a sister vessel (same yard, same shipping company, same type of vessel). The scope of the tests has to be agreed upon with the classification society for selected cases based on the FMEA required in UR M44/M78 of IACS. For the alarm and safety system, an engine-independent test is carried out in advance and witnessed by the classification society. In the case of the FAT, only engine-related tests, such as the injection module failures, are additionally witnessed.
- e. Performance Check: The engine performance is to be tested at the load points listed in table 1. Further information can be found under point 4.3 of this instruction. Performance readings must be stated in the FAT protocol. The specific fuel consumption has to be recorded and calculated to ISO-conditions in all load points, except in idle operation.
- f. Governor test (load drop): Sudden load drop from full load to zero load. Results must be stated in the FAT protocol.
- g. Check of attached engine flaps and valves (blow off, blow by, waste gate, jet assist).
- h. Visual check for leakages on fuel oil, lube oil and water systems of the engine (check of connecting flanges, screw connections and inspection drillings).
- i. Surge test of turbocharger on new engine configurations during the turbocharger-matching process. Results not to be stated in the FAT protocol.
- j. Cylinder liner inspection (only engines ≥ 32 cm liner diameter) of one cylinder liner per engine by borescope. Evaluation of the cylinder liner surface according to Q10.09121-3325 "Visual Test Cylinder Liner Inspection after Running-In". In case of additional inspections (e.g. dismantling of piston) during demonstration tests the borescope inspection is omitted.)

Figure 111: Programme for Factory Acceptance Test (FAT) – Part 2

4.2 Demonstration tests

The demonstration test is a final quality approval of the engine before its delivery in presence of the classification and the customer. The demonstration test has to be done according to the engine-specific test procedure (demonstration test), confirmed by the classification society and customer. The test procedure has to be sent to the classification society and customer one-week prior to the demonstration test at the latest. The scope of the FAT-procedure (demonstration test) is based on the following standards:

- a. Switch from liquid to gas operation and back at minimum and nominal load.
- b. One gas start (only on dual fuel engines with gas start functionality)
- c. Performance Check: The engine performance has to be tested on the load points listed in table 1. Further information can be found under point 4.3 of this instruction.
- d. Visual check of crank case, camshaft, rollers and gear drive after engine stop.

Optional tests and inspections only by request of the classification society, contractual agreement with customer or by indication of irregularities.

4.3 Engine performance check

The engine performance check has to be done on all load points listed in table 1. Engines for generator application (incl. diesel-electric dredger) have to be tested on the generator curve. Engines for CPP-application and diesel-mechanic dredger application with propulsion function have to be tested on the recommend combinator curve of the engine manufacturer. Engines for diesel-mechanic propulsion application with fixed pitch propeller (exclusively mechanical pump drive) and water jet application have to be tested on the recommended FPP-curve of MAN-ES. Engines with ECOMAP function have to be tested on the standard full load map only. Additional mappings can be tested according to a contractual agreement with the customer. Between pre-tests and demonstration tests minor adjustments for engine optimization are allowed. These adjustments must not lead to an excess of the engine specifications in any load point and have to be stated in the FAT-protocol. The performance parameter to be measured are specified in ISO 15550. For all measurement devices the calibration tolerances of this standard are to be fulfilled and the given calibration intervals of the specific manufacturers have to be considered. The calibrations have to fulfil the requirements given by the QM-system and the documentation of the calibration have to be available at any time. All performance data of the engines have to be within the specification limits (documents: List of measuring and control devices, quality criteria of engine) of the engine manufacturer. The performance readings have to be conducted according to the specified instructions of the engine manufacturer.

Figure 112: Programme for Factory Acceptance Test (FAT) – Part 3

	Test points	Factory Acceptance Test (FAT)			
		Pre- Tests		Demonstration tests	
Diesel engines	100 %	-		60min*	
	110 %	-		M	
	85% (nominal continuous cruise power)**	-		M	
	Minimum speed at full constant torque - (mechanical pump drive only)	-		M	
	75%	M		-	
	50%	M		-	
	25%	M		-	
	Idle*** (only engines driving generators)	M		-	
Dual Fuel (DF-) engines		Gas mode	Diesel mode	Gas mode	Diesel mode
	100%	-	-	60min*	60min*
	110%	-	-	-	M
	85% (nominal continuous cruise power)**	-	-	M	M
	75%	M	M	-	-
	50%	M	M	-	-
	25%	M	M	-	-
	Idle*** (only engines driving generators)	-	M	-	-
* 2 readings have to be done at an interval of 30 min. On DF-engines only one reading in Diesel and one in Gas-mode. ** Replaces the 90% load point of classification rules. M = Minimum 15 minutes and steady-state conditions reached (acc. Instruction conducting a measurement of MAN-ES) Idle*** Nominal engine speed For all trial conditions provision should be made for time needed by the Surveyor to carry out visual inspections					

Table 1: Engine performance check

8.2 Programme for Factory Acceptance Test (FAT)

8 Annex

Figure 113: Programme for Factory Acceptance Test (FAT) – Part 4

4.4 Handling of quality issues

A major purpose of the engine test run is to find and to fix potential quality issues during the pre-tests of the engine (before FAT). All quality issues are generally to be handled according to the official process for quality assurance of the engine manufacturer. With the beginning of the engine FAT all quality issues should have been solved. In case of any open issues, customer and classification society have to be informed prior the beginning of the FAT. Existing and upcoming quality issues during FAT have to be documented in the FAT protocol. Measures to fix these quality issues have to be defined by the manufacturer with agreement of customer and classification society.

During FAT the quality of the product (engine, Genset) has to be inspected as a final step before delivery. The goal is to conduct the engine operation without any unexpected alarm, shut down or load reduction. It has to be ensured that the engine functionality is given as expected and applicable regulations (class rules, emission rules) and contractual agreements are fulfilled. Any abnormalities which might lead to functional impact during further engine operation on board have to be eliminated before the engine is handed over to the customer.

In case of any changes needed after delivery of the engines (e.g. change of components, software), this must be implemented latest during commissioning. These changes and elimination of the failure has to be ensured and documented by the commissioning staff of the engine manufacturer.

4.5 After engine operation

After finishing the test program, the engine has to be preserved according to working instruction W0176EN. The fuel delivery system of diesel-mechanic drives has to be adjusted so that overload power cannot be delivered during engine operation on board. Engines driving electrical generators have to be adjusted so that 110% rated power is possible.

4.6 FAT – protocol

All operations, events, findings, further measures and agreements have to be documented in one and the same engine specific FAT protocol of MAN-ES. The final FAT-protocol has to be reviewed by the surveyor of the classification society and a copy has to be handed out to the customer. The FAT protocol contains the following information:

- Cover sheet
- Signature sheet with representatives
- Operating record for all engine operation points
- Information about the fuel oil characteristics
- Line records for governor test or load jump tests
- Check of safety functions of engine and test bed before first start of the engine
- Visual inspection sheet with conducted checks and documentation of engine conditions
- Crank web deflection measurement for cold condition (check of alignment on test bed)
- Emission-relevant identification numbers, software version numbers
- Firing pressure comparison
- Starting test incl. air consumption calculation of reference engine
- Characteristic NOx emission Map (only for variable speed engines and parent engine protocols)
- Operating data sheet to estimate the engine output
- Calibration informations about fuel oil, fuel gas and torque measurement devices

Figure 114: Programme for Factory Acceptance Test (FAT) – Part 5

5 References - applicable documents always refer to the current version unless stated otherwise.

- IACS-regulations and regulations of classification societies
- ISO 15550, ISO 3046, ISO 10816-6
- F0387EN Checklist for Rigging Up, Connecting, Commissioning, Performing the Test Run and Performing the Customer Acceptance Test for a Combustion Engine on the Test Bed
- W0202EN - Surface Temperature Examination on Engines and Components for Marine Application
- W0176EN Preserving Internal Engine Compartments of Medium-Speed Four-Stroke Diesel Engines after Test Run
- W0221EN Sampling of Fuel Oil
- Instruction I0158 - Guideline for Conducting a Measurement at the Test Beds (only for use of EDS-System)
- Q10.09054-0005 - Fuel Oil Consumption Measurement of Diesel Engines on Test Bed
- Q10.09121-3325 - Visual Test Cylinder Liner Inspection after Running-In

6 Annexes

The annexes always refer to the current version unless not stated otherwise.

- Annex 1 [example of engine performance reading](#)

Figure 115: Programme for Factory Acceptance Test (FAT) – Part 6

8.3 Engine running-in

Prerequisites

Engines require a running-in period in case one of the following conditions applies:

- When put into operation on site, if
 - after test run the pistons or bearings were dismantled for inspection or
 - the engine was partially or fully dismantled for transport.
- After fitting new drive train components, such as cylinder liners, pistons, piston rings, crankshaft bearings, big-end bearings and piston pin bearings.
- After the fitting of used bearing shells.
- After long-term low-load operation, see section [Low-load operation, Page 51](#).

Supplementary information

Operating Instructions

During the running-in procedure the unevenness of the piston-ring surfaces and cylinder contact surfaces is removed. The running-in period is completed once the first piston ring perfectly seals the combustion chamber. i.e. the first piston ring should show an evenly worn contact surface. If the engine is subjected to higher loads, prior to having been running-in, then the hot exhaust gases will pass between the piston rings and the contact surfaces of the cylinder. The oil film will be destroyed in such locations. The result is material damage (e.g. burn marks) on the contact surface of the piston rings and the cylinder liner. Later, this may result in increased engine wear and high lube oil consumption.

The time until the running-in procedure is completed is determined by the properties and quality of the surfaces of the cylinder liner, the quality of the fuel and lube oil, as well as by the load of the engine and speed. The running-in periods indicated in following figures may therefore only be regarded as approximate values.

Operating media

Liquid fuel engines

The running-in period may be carried out preferably using DMA.

The fuel used must meet the quality standards see section [Specification for engine supplies, Page 159](#) and the design of the fuel system.

Dual fuel engines

Dual fuel engines are run in using liquid fuel mode with the fuel intended as the pilot fuel.

Gas fuel engines

For the running-in of gas four-stroke engines it is best to use the gas which is to be used later in operation.

Lube oil

The running-in lube oil must match the quality standards, with regard to the fuel quality.

Engine running-in

Cylinder lubrication (optional)

The cylinder lubrication must be switched to "Running In" mode during completion of the running-in procedure. This is done at the control cabinet or at the control panel (under "Manual Operation"). This ensures that the cylinder lubrication is already activated over the whole load range when the engine

Checks	starts. The running-in process of the piston rings and pistons benefits from the increased supply of oil. Cylinder lubrication must be returned to "Normal Mode" once the running-in period has been completed. Inspections of the bearing temperature and crankcase must be conducted during the running-in period: ▪ The first inspection must take place after 10 minutes of operation at minimum speed. ▪ An inspection must take place after operation at full load respectively after operational output level has been reached. The bearing temperatures (camshaft bearings, big-end and main bearings) must be determined in comparison with adjoining bearings. For this purpose an electrical sensor thermometer may be used as a measuring device. At 85% load and at 100% load with nominal speed, the operating data (ignition pressures, exhaust gas temperatures, charge air pressures, etc.) must be measured and compared with the acceptance report.
Standard running-in programme	Dependent on the application the running-in programme can be derived from the figures in paragraph Diagram(s) of standard running-in, Page 294. During the entire running-in period, the engine output has to be within the marked output range. Critical speed ranges are thus avoided.
Running-in during commissioning on site	Most four-stroke engines are subjected to a test run at the manufacturer's premises. As such, the engine has usually been run in. Nonetheless, after installation in the final location, another running-in period is required if the pistons or bearings were disassembled for inspection after the test run, or if the engine was partially or fully disassembled for transport.
Running-in after fitting new drive train components	If during revision work the cylinder liners, pistons, or piston rings are replaced, a new running-in period is required. A running-in period is also required if the piston rings are replaced in only one piston. The running-in period must be conducted according to following figures or according to the associated explanations. The cylinder liner may be re-honed according to working instructions 050.05, if it is not replaced. A transportable honing machine may be requested from one of our service and support locations.
Running-in after refitting used or new bearing shells (crankshaft, connecting rod and piston pin bearings)	When used bearing shells are reused, or when new bearing shells are installed, these bearings have to be run in. The running-in period should be 3 to 5 hours under progressive loads, applied in stages. The instructions in the preceding text segments, particularly the ones regarding the "Inspections", and following figures must be observed. Idling or no-load operation at higher speeds for long periods should be avoided if at all possible.
Running-in after low-load operation	Continuous operation in the low-load range may result in substantial internal pollution of the engine. Residue from fuel and lube oil combustion may cause deposits on the top-land ring of the piston exposed to combustion, in the piston ring channels as well as in the inlet channels. Moreover, it is possible that the charge air and exhaust pipes, the charge air cooler, the turbocharger and the exhaust gas tank may be polluted with oil. Since the piston rings have adapted themselves to the cylinder liner according to the running load, increased wear resulting from quick acceleration and possibly with other engine trouble (leaking piston rings, piston wear) should be expected.

Therefore, after a longer period of low-load operation (≥ 500 hours of operation) a running-in period should be performed again, depending on the power, according to following figures.

Also for instruction see section [Low-load operation, Page 51](#).

Note:

For further information, you may contact the Everlence customer service or the customer service of the licensee.

Diagram of standard running-in

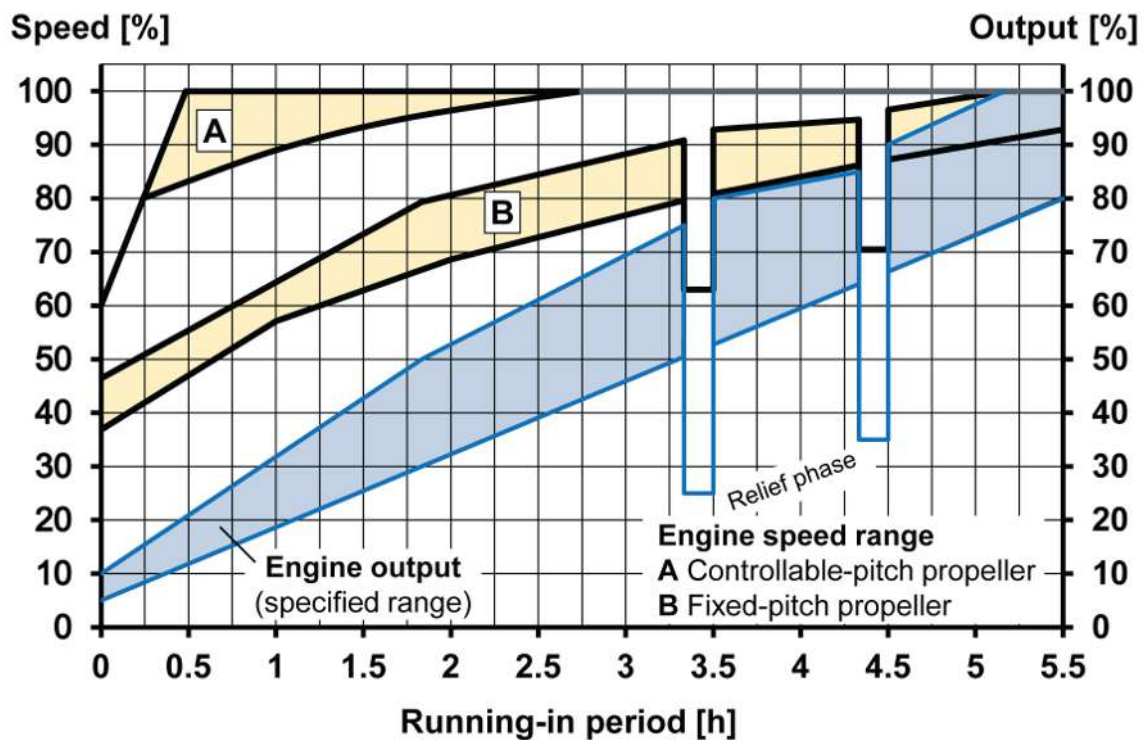


Figure 116: Standard running-in programme for marine engines (variable speed)

8.4 Definitions

Auxiliary GenSet/auxiliary generator operation

A generator is driven by the engine, hereby the engine is operated at constant speed. The generator supplies the electrical power not for the main drive, but for supply systems of the vessel.

Load profile with focus between 40% and 80% load.

Engine's certification for compliance with the NO_x limits according D2 Test cycle. See within section [Engine ratings \(output\) for different applications, Page 43](#) if the engine is released for this kind of application and the corresponding available output $P_{\text{Application}}$.

Blackout

The classification societies define blackout on board ships as a loss of the main source of electrical power resulting in the main and auxiliary machinery to be out of operation and at the same time all necessary alternative energies (e.g. start air, battery electricity) for starting the engines are available.

Dead ship condition

The classification societies define dead ship condition as follows:

- The main propulsion plant, boilers and auxiliary machinery are not in operation due to the loss of the main source of electrical power.
- In restoring propulsion, the stored energy for starting the propulsion plant, the main source of electrical power and other essential auxiliary machinery is assumed not to be available.
- It is assumed that means are available to start the emergency generators at all times. These are used to restore the propulsion.

Designation of engine sides

- Coupling side, CS
The coupling side is the main engine output side and is the side to which the propeller, the alternator or other working machine is coupled.
- Free engine end/counter coupling side, CCS
The free engine end is the front face of the engine opposite the coupling side.

Designation of cylinders

The cylinders are numbered in sequence, from the coupling side, 1, 2, 3 etc. In V engines, looking on the coupling side, the left hand bank of cylinders is designated A, and the right hand bank is designated B. Accordingly, the cylinders are referred to as A1-A2-A3 or B1-B2-B3, etc.

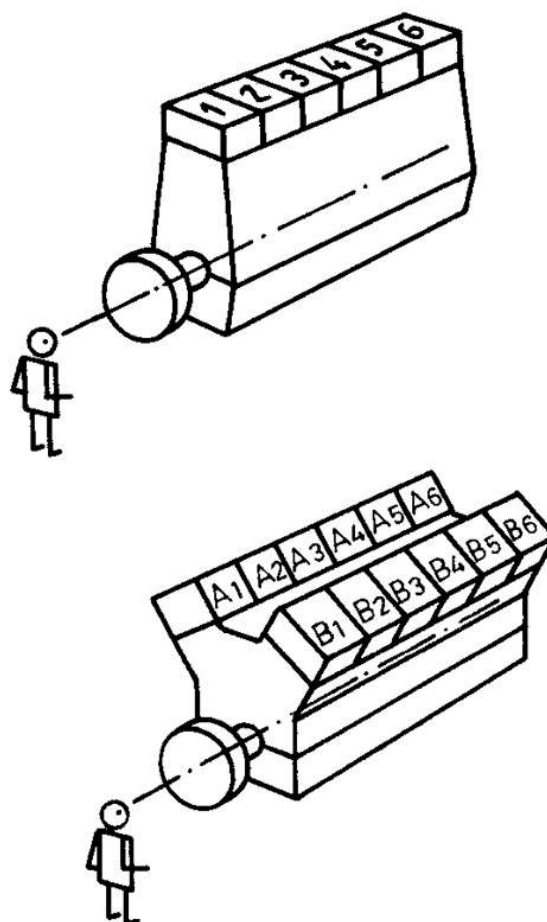


Figure 117: Designation of cylinders

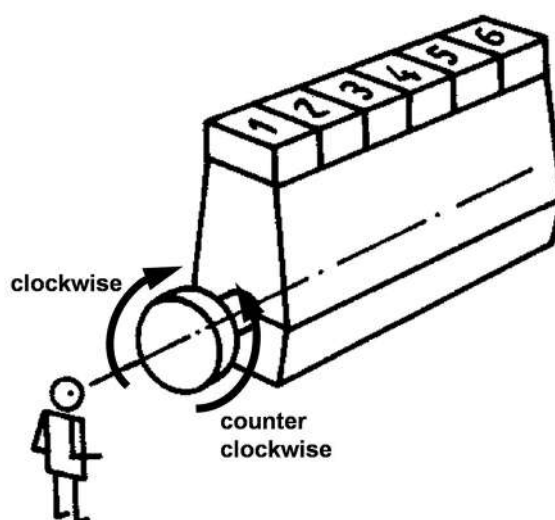
Direction of rotation

Figure 118: Designation: Direction of rotation seen from flywheel end

Electric propulsion

The generator being driven by the engine supplies electrical power to drive an electric motor. The power of the electric motor is used to drive a controllable pitch or fixed pitch propeller, pods, thrusters, etc.

Load profile with focus between 80% and 95% load.

Engine's certification for compliance with the NO_x limits according E2 Test cycle. See within section [Engine ratings \(output\) for different applications, Page 43](#) if the engine is released for this kind of application and the corresponding available output $P_{Application}$.

GenSet

The term "GenSet" is used, if engine and electrical alternator are mounted together on a common base frame and form a single piece of equipment.

Gross calorific value (GCV)

This value supposes that the water of combustion is entirely condensed and that the heat contained in the water vapor is recovered.

Idling operation

Idling/Idling operation refers to operation:

- Before the engine is coupled to the propulsion system or to the mechanical dredge pump
- Of the GenSet with open Genoswitch

A distinction is made between:

- Idling at minimum speed and
- Idling at rated speed

Mechanical propulsion with controllable pitch propeller (CPP)

A propeller with adjustable blades is driven by the engine.

The CPP's pitch can be adjusted to absorb all the power that the engine is capable of producing at nearly any rotational speed.

Load profile with focus between 80% and 95% load.

Engine's certification for compliance with the NO_x limits according E2 Test cycle. See within section [Engine ratings \(output\) for different applications, Page 43](#) if the engine is released for this kind of application and the corresponding available output $P_{Application}$.

Mechanical propulsion with fixed pitch propeller (FPP)

A fixed pitch propeller is driven by the engine. The FPP is always working very close to the theoretical propeller curve (power input $\sim n^3$). A higher torque in comparison to the CPP even at low rotational speed is present.

Load profile with focus between 80% and 95% load.

Engine's certification for compliance with the NO_x limits according E3 Test cycle. See within section [Engine ratings \(output\) for different applications, Page 43](#) if the engine is released for this kind of application and the corresponding available output $P_{Application}$.

Multi-engine propulsion plant

In a multi-engine propulsion plant at least two or more engines are available for propulsion.

Net calorific value (NCV)

This value supposes that the products of combustion contain the water vapor and that the heat in the water vapor is not recovered.

No-load operation

As soon as the engine has been coupled, or a GenSet with closed Geno switch has been connected to electrical grid and no load has yet been delivered, this is named as no-load operation.

Offshore application

Offshore construction and offshore drilling place high requirements regarding the engine's acceleration and load application behaviour. Higher requirements exist also regarding the permissible engine's inclination.

Due to the wide range of possible requirements such as flag state regulations, fire fighting items, redundancy, inclinations and dynamic positioning modes all project requirements need to be clarified at an early stage.

Output

- ISO standard output (as specified in DIN ISO 3046-1)
Maximum continuous rating of the engine at nominal speed under ISO conditions, provided that maintenance is carried out as specified.
- Operating-standard-output (as specified in DIN ISO 3046-1)
Maximum continuous rating of the engine at nominal speed taking in account the kind of application and the local ambient conditions, provided that maintenance is carried out as specified. For marine applications this is stated on the type plate of the engine.
- Fuel stop power (as specified in DIN ISO 3046-1)
Fuel stop power defines the maximum rating of the engine theoretical possible, if the maximum possible fuel amount is used (blocking limit).
- Rated power (in accordance to rules of DNV)
Maximum possible continuous power at rated speed and at defined ambient conditions, provided that maintenances carried out as specified.
- Output explanation
Power of the engine at distinct speed and distinct torque.
- 100% output
100% output is equal to the rated power only at rated speed. 100% output of the engine can be reached at lower speed also if the torque is increased.
- Nominal output
= rated power.
- MCR
Maximum continuous rating.
- ECR
Economic continuous rating = output of the engine with the lowest fuel consumption.

Overload power (at FAT or SAT/sea trial)

Only if required by rules of classification societies, it is admitted to operate the engine at 110% of rated power for a maximum of 1 h in total as part of the FAT or SAT/sea trial and in addition a maximum of 1 h in total as part of the commissioning of the plant. Engine operation has to be done under supervision of trained Everllence personal.

Single-engine propulsion plant

In a single-engine propulsion plant only one single-engine is available for propulsion.

Suction dredger application (mechanical drive of pumps)

For direct drive of a suction dredger pump by the engine via gear box the engine speed is directly influenced by the load on the suction pump.

The power demand of the dredge pump needs to be adapted to the operating range of the engine, particularly while start-up operation. Load profile with focus between 80% and 100% load.

Engine's certification for compliance with the NO_x limits according C1 Test cycle. See within section [Engine ratings \(output\) for different applications, Page 43](#) if the engine is released for this kind of application and the corresponding available output P_{Application}.

Water jet application

A marine propulsion system that creates a jet of water that propels the vessel. The water jet propulsion is always working close to the theoretical propeller curve (power input ~ n³). With regard to its requirements the water jet propulsion is identical to the mechanical propulsion with FPP.

Load profile with focus between 80% and 95% load.

Engine's certification for compliance with the NO_x limits according E3 Test cycle. See within section [Engine ratings \(output\) for different applications, Page 43](#) if the engine is released for this kind of application and the corresponding available output P_{Application}.

Weight definitions for SCR

- Handling weight (reactor only):
This is the "net weight" of the reactor without catalysts, relevant for transport, logistics, etc.
- Operational weight (with catalysts):
That's the weight of the reactor in operation, that is equipped with a layer of catalyst and the second layer empty – as reserve.
- Maximum weight structurally:
This is relevant for the static planning purposes maximum weight, that is equipped with two layers catalysts.

8.5 Abbreviations

Abbreviation	Explanation
BN	Base number
CBM	Condition based maintenance
CCM	Crankcase monitoring system
CCS	Counter coupling side
CS	Coupling side
DLC	Data Logging Cabinet
DMA	Gas oil
DMB	Diesel oil
ECR	Economic continuous rating
EDS	Engine diagnostics system
GCV	Gross calorific value
GVU	Gas Valve Unit
HFO	Heavy fuel oil
HT CW	High temperature cooling water
LT CW	Low temperature cooling water
MCR	Maximum continuous rating
MN	Methane number
NCV	Net calorific value
OMD	Oil mist detection
SaCoS	Safety and control system
SAT	Site acceptance test
SECA	Sulphur emission control area
SP	Sealed plunger
STC	Sequential turbocharging
TAN	Total acid number
TBO	Time between overhaul
TC	Turbocharger
TC	Temperature controller
ULSHFO	Ultra low sulphur heavy fuel oil

8.6 Symbols

Note:
The symbols shown should only be seen as examples and can differ from the symbols in the diagrams.

DESIGNATION	SYMBOL	CODE	DESIGNATION	SYMBOL	CODE
MAIN CIRCUIT (FLOW DIRECTION SHOWN)			FLEXIBLE PIPE CONNECTION		EH
SECONDARY CIRCUIT			EXPANSION BELLOWS (STEEL)		EB
CONTROL AIR PIPE, PULSE LINE, ELECTRICAL LINE			2/2 (TWO-PORT, TWO-POSITION) DIRECTIONAL CONTROL SOLENOID-OPERATED VALVE		
CAPILLARY TUBE (WITH THERMOSTATIC REGULATORS)			3/2 (THREE-PORT, TWO-POSITION) DIRECTIONAL CONTROL VALVE		
LAGGED PIPE			GENERAL SHUT-OFF VALVE		V
STEAM HEATED PIPE (HEAVY FUEL OIL OPERATION, MAIN CIRCUIT)			GATE VALVE		GV
ELECTRICALLY HEATED PIPE (HEAVY FUEL OIL OPERATION, MAIN CIRCUIT)			STRAIGHT-WAY VALVE		V

Figure 119: Symbols used in functional and pipeline diagrams 1

2026-02-24 - 6.2

DESIGNATION	SYMBOL	CODE	DESIGNATION	SYMBOL	CODE
ANGLE VALVE		V	GENERAL SHUT-OFF VALVE, MOTOR DRIVEN		MOV
VALVE WITH MINIMUM FLOW		V	QUICK ACTING SHUT-OFF VALVE		V
GENERAL THREE-WAY VALVE		CK	SAFETY VALVE (STRAIGHT WAY)		PSV
THREE-WAY VALVE		V	SAFETY VALVE (ANGLE)		PSV
COCK		CK	BACK PRESSURE VALVE (STRAIGHT WAY)		BPV
SHUT-OFF VALVE WITH VENTILATION		V	BACK PRESSURE VALVE (ANGLE)		BPV
NON-RETURN VALVE		NRV	DIAPHRAGM VALVE (PNEUMATICALLY-OPERATED)		DV
NON-RETURN VALVE (CAN BE SHUT OFF)		NRV	DIAPHRAGM SHUTTLE VALVE		DV
ANGLE NON-RETURN VALVE		NRV	MOTORISED VALVE		MOV
SOLENOID-OPERATED VALVE		SOV	GENERAL THREE-WAY VALVE, MOTOR DRIVEN		MOV
SOLENOID-OPERATED VALVE (AUTOMATIC VENT)		SOV	MOTORISED SHUTTLE VALVE		MOV
GENERAL SHUT-OFF VALVE, GENERAL DRIVE		V	GENERAL SHUT-OFF VALVE WITH TRANSATORY MOTON VALVE		V

Figure 120: Symbols used in functional and pipeline diagrams 2

DESIGNATION	SYMBOL	CODE	DESIGNATION	SYMBOL	CODE
PISTON-OPERATED VALVE		POV	PRESSURE REDUCING VALVE		PCV
SHUTTLE VALVE WITH DRIVE PISTON		POV	PRESSURE CONTROL VALVE		PCV
SELF-CLOSING VALVE (STRAIGHT WAY)		QV	TEMPERATURE REGULATOR (SELF-ACTUATING DISTRIBUTION VALVE)		TCV
SELF-CLOSING VALVE (ANGLE)		QV	TEMPERATURE REGULATOR (SELF-ACTUATING MIXING VALVE)		TCV
AUTOMATIC OPENING VALVE		V	TEMPERATURE CONTROL VALVE, ELECTRICALLY CONTROLLED		TCV
FLOAT VALVE		LOV	VANE HAND PUMP		P
SPRING-LOADED ADJUSTABLE PRESSURE LIMITING VALVE		PCV	WATER TRAP		TR
SAFETY VALVE		PSV	OIL TRAP		TR
FLOW-CONTROL VALVE, ADJUSTABLE			CONDENSATE TRAP, CAN BE SHUT OFF		TR
NON-RETURN VALVE, UNIDIRECTIONAL FLOW			ACCUMULATOR, GAS CYLINDER		
NON-RETURN VALVE WITH SPRING, NORMALLY CLOSED			OILER		
PILOTED NON-RETURN VALVE WITH SPRING, FLOW IN BOTH DIRECTIONS POSSIBLE DUE TO CONTROL PRESSURE			HEATING COIL (STEAM OR WATER)		H

Figure 121: Symbols used in functional and pipeline diagrams 3



DESIGNATION	SYMBOL	CODE	DESIGNATION	SYMBOL	CODE
PLUG-IN HEATER (STEAM OR WATER)		H	SUCTION STRAINER		STR
PLUG-IN HEATER (ELECTRIC)		H	SUCTION BELL		SB
BACKFLOW PREVENTER (DISCOTYP)		NRV	FLAME TRAP		GS
NON-RETURN FLAP		NRF	VENT		
STRAINER		STR	VENT WITH FLAME TRAP		
FUNNEL (OPEN)		FU	VENT, OUTBOARD ABOVE DECK		
FUNNEL (CLOSED)		FU	VENT CAP		
OVERFLOW CHECK TANK, DISCHARGE FUNNEL		FU	Withdrawal point for fuel oil sample		

Figure 122: Symbols used in functional and pipeline diagrams 4

8.7 Preservation, packaging, storage

8.7.1 General

Introduction

Engines are internally and externally treated with preservation agent before delivery. The type of preservation and packaging must be adjusted to:

- Means of transport
- Type and period of storage

Improper storage may cause severe damage to the product.

Packaging and preservation of engine

The type of packaging depends on:

- The requirements imposed with transport and storage period
- Climatic and environmental effects
- Which preservative agents are used

As standard, the preservation and packaging of an engine is designed for a storage period of 12 month and for sea transport.

Note:

The packaging must be protected against damage. It must only be removed when:

- A follow-up preservation is required
- The packaged material is to be used
- Shortly before operating the engine

The condition of the packaging must be checked regularly and repaired in case of damage. Especially a VCI packaging can only provide a proper corrosion protection if it is intact and completely closed.

In addition, the engine interiors are protected by vapour phase corrosion protection. Inner compartments must not be opened while transportation and storage. Otherwise, a re-preservation of the opened compartment will be required. The inner corrosion protection can remain inside the engine.

If bare metal surfaces get exposed for example, by disassembly of the coupling device, the unprotected metal must be treated with agent "f" according to the list of recommended anti-corrosion agents ([Corrosion protection](#)).

This especially applies to the tie rod where the lifting device has been mounted.

In case of an installed intake air filter there is a steel plate cover or similar around the filter fleece, which has to be used during transportation and storage.

Note:

During storage and in case of a follow-up preservation the crankshaft must not be turned. If the crankshaft is turned, usually for the first time after preservation this will be done during commissioning, the preservation is partially removed. If the engine is to be stored again for a period thereafter, then adequate re-preservation is required.

Preservation and packaging of loose equipment

Unless stated otherwise in the customer specification, the preservation and packaging of loose equipment and engine parts which are dismantled for transport, must be carried out such that:

- The preservation and packaging of loose equipment and engine parts will not be damaged during transport
- The corrosion protection remains fully intact for at least 12 months when stored in a roofed dry room

Transport

Transport and packaging of the engine, loose equipment and engine parts must be coordinated.

After transportation, any damage to the corrosion protection and packaging must be rectified, and/or Everllence must be notified immediately.

8.7.2 Storage location and duration

Storage location of engine	Storage location As standard, the engine is packaged and preserved for outdoor storage. The storage location must meet the following requirements: ▪ Engine is stored on firm and dry ground. ▪ Packaging material does not absorb any moisture from the ground. ▪ Engine is accessible for visual checks.
Storage location of loose equipment	Loose equipment must always be stored in a roofed dry room. The storage location must meet the following requirements: ▪ Parts are protected against environmental effects and the elements. ▪ The room must be well ventilated. ▪ Parts are stored on firm and dry ground. ▪ Packaging material does not absorb any moisture from the ground. ▪ Parts cannot be damaged. ▪ Parts are accessible for visual inspection. ▪ An allocation of loose equipment to the order or requisition must be possible at all times. Note: Packaging made of or including VCI paper or VCI film must not be opened or must be closed immediately after opening. Storage conditions In general the following requirements must be met: ▪ Minimum ambient temperature: -10°C ▪ Maximum ambient temperature: $+60^{\circ}\text{C}$ ▪ Relative humidity: $< 60\%$ In case these conditions cannot be met, contact Everllence for clarification. Storage period The permissible storage period of 12 months must not be exceeded. Before the maximum storage period is reached: ▪ Check the condition of the stored engine and loose equipment. ▪ Renew the preservation or install the engine or components at their intended location.

8.7.3 Follow-up preservation when preservation period is exceeded

A follow-up preservation must be performed before the maximum storage period has elapsed, i.e. generally after 12 months.

Request assistance by authorised personnel of Everllence.

8.7.4 Removal of corrosion protection

Packaging, corrosion protection and silica gel must only be removed from the engine **immediately before commissioning** the engine in its installation location.

Remove outer protective layers, any foreign body from engine or component (VCI packs, blanking covers, etc.), check engine and components for damage and corrosion, perform corrective measures, if required.

The preservation agents sprayed inside the engine do not require any special attention. They will be washed off by engine oil during subsequent engine operation.

Contact Everllence if you have any questions.

8.8 Engine colour

Engine standard colour according RAL colour table is RAL 7040 Window grey. Other colours on request.

This page is intentionally left blank

Index

A

Abbreviations	300
Acceleration times	69
Additions to fuel consumption	73
Aging (Increase of S.F.C.)	79
Air	
Flow rates	79, 85
Starting air consumption	71, 77
Temperature	79, 85
Air receivers	
Capacities	236
Air vessels	
Capacities	190
Condensate amount	189
Airborne noise	104
Ambient conditions causes derating	44
Angle of inclination	35
Approved applications	25
Arctic conditions	57
Arrangement	
Flywheel	119
Attached pumps	
Capacities	79, 85
Auxiliary generator operation	
Definiton	295
Auxiliary GenSet operation	
Definition	295
Available outputs	
Related reference conditions	43, 44

B

Bearing, permissible loads	113
Blackout	
Definition	295
Blackout start	48
Blowing-off the exhaust gas	
Waste gate	36
By-pass	36, 37

C

Capacities	
Attached pumps	79, 85
Pumps	79, 85
CEON	17
Charge air	
Blow-off	36
Blow-off device	37
Blow-off noise	107
By-pass	37
By-pass device	37
Charge air cooler	
Condensate amount	189
Flow rates	79, 85
Heat to be dissipated	79, 85
Colour of the engine	307
Combustion air	
Flow rate	79, 85
Specification	159
Componentes	
SCR system	246
Components	
Exhaust gas system	246
Composition of exhaust gas	99
Compressed air	
Specification	159
Compressed air system	231, 233
Condensate amount	
Air vessels	189
Charge air cooler	189
Consumption	
Control air	77
Fuel	71
Fuel oil	71
Lube oil	75
Control air	
Consumption	71, 77
Controllable pitch propeller	
Definition	297
Operating range	63

Cooler		DMA (fuel oil)	
Flow rates	79, 85	Specification	159
Heat radiation	79, 85	DMA see Fuel oil	74
Heat to be dissipated	79, 85	DMA supply system for diesel en-	224
Specification, nominal values	79, 85	gines	
Temperature	79, 85	DMB see Fuel oil	74
Cooler dimensioning, general	214	E	
Cooling water		Earthing	
Inspecting	159	Bearing insulation	61
Specification	159	Measures	61
Specification for cleaning	159	Welding	62
System description	214	ECR	
System diagram	214	Definition	298
Temperature control	39	Electric propulsion	
Crankcase vent	212	Definition	297
Crankshaft		Emissions	
Moments of inertia	115	Exhaust gas – IMO standard	98
Cross section, engine	28	Static torque fluctuation	117
Cyber security	17	Torsional vibrations	110
Cylinder		Engine	
Designation	295	3D Engine viewer	177, 263
Cylinder liner, removal of	257	Colour	307
D		Cross section	28
Damper		Definition of engine rating	41
Moments of inertia	115	Description	9
Dead ship condition		Designation	29, 295
Definition	295	Equipment for various applica-	37
Required starting conditions	49, 50	tions	
Definition of engine rating	41	Inclinations	35
Definitions		Main dimensions	30
Engine start	47	Operation under arctic condi-	57
Derating		tions	
As a function of water temperat-	44	Outputs	40
ure		Overview	20
Due to ambient conditions	44	Programme	9
Due to special conditions or de-	44	Ratings	40
mands		Ratings for different applications	43
Design parameters	29	Room layout	253
Diagram		Running-in	292
Lube oil system	209	Single-engine propulsion plant	299
Diagram condensate amount	189	(Definition)	
Diesel fuel see Fuel oil	74	Speeds	40
DLC		Speeds, Related main data	44
Data Logging Cabinet	300	Weights	30

Engine automation		Flow rates	
Interfaces	147	Air	79, 85
Operation	144	Cooler	79, 85
Supply and distribution	142	Exhaust gas	79, 85
Technical data	148	Lube oil	79, 85
Engine pipe connections and di- mensions	179	Water	79, 85
Engine ratings		Flow resistances	97
Power, outputs, speeds	40	Flywheel	
Suction dredger	299	Arrangement	119
Equipment for various applications	36	Moments of inertia	115
Exhaust gas		Follow-up preservation	306
Back pressure	44	Foundation	
Blowing-off the exhaust gas (waste gate)	36	General requirements	120
Composition	99	Resilient seating	122
Ducting	277	Four stroke diesel engine pro- gramme for marine	9
Emission	98	Fuel	
Flow rates	79, 85	Consumption	71, 78
Noise	105	Dependent on ambient condi- tions	78
Pressure	44	Diagram of MGO supply system	230
Smoke emission index	98	DMA supply	224
System description	243	MGO supply	230
Temperature	79, 85	Recalculation of consumption	78
Exhaust gas pressure		Stop power, definition	298
Due to after treatment	45	Fuel oil	
Exhaust gas system		Consumption	71
Assemblies	246	Specification for gas oil (DMA)	159
Components	246		
External cooling water system dia- gram	222	G	
External HT cooling water system	220	Gas oil	
External LT cooling water system	218	Specification	159
External seawater system	220	General requirements	
F		Fixed pitch propulsion control	65, 67
Factory Acceptance Test (FAT)	286	Propeller pitch control	65
Filling volumes	97	General requirements for pitch con- trol	65
Firing order	116	GenSet	
Fixed pitch propeller		Definition	297
Definition	297	Grid parallel operation	
Flexible pipe connections		Definition	298
Installation	177, 183	Gross calorific value (GCV)	
		Definition	297

H			
Heat radiation	79, 85	Load application	
Heat to be dissipated	79, 85	Change of load steps	66
Heavy fuel oil see Fuel oil	74	Cold engine (only emergency case)	49
HFO see Fuel oil	74	Electric propulsion plants	49
HT-switching	51	Preheated engine	69
		Start-up time	50
I		Load reduction	
Idle speed	44	As a protective safety measure	55
IMO certification	65	Recommended	54
IMO Marpol Regulation	74, 98	Stopping the engine	54
IMO Tier II		Sudden load shedding	53
Definition	74	Low-load operation	51
IMO Tier II, IMO Tier III		LT-switching	51
Exhaust gas emission	98	Lube oil	
Impact on foundation		Automatc filter	39
Noise and vibration	107	Consumption	75
Inclinations	35	Cooler	39
Installation		Duplex filter	39
Flexible pipe connections	177, 183	Flow rates	79, 85
Installation drawings	254	Outlets	211
Intake air (combustion air)		Pressure control valve	39
Specification	172	Specification (DMA)	159
Intake noise	105	System description	199
Internal HT cooling water system	219	System diagram	199, 209
Internal LT cooling water system	216	Temperature	79, 85
Internal seawater system		Temperature control	39
Seawater pump	220		
ISO		M	
Reference conditions	41	Main dimensions	
Standard output	43, 298	SCR componentes	31
L		Marine diesel oil see Fuel oil	74
Layout of pipes	177, 179	Marine gas oil	
Leakage rate	96	Specification	159
Lifting device	265	MARPOL Regulation	71, 74, 98
Load		Materials	
Low-load operation	51	Piping	181
Reduction	53	MCR	
		Definition	298
		Measuring and control devices	
		Engine-located	151
		Mechanical propulsion	
		System arrangement	276
		Mechanical propulsion with CPP	
		Definition	297

Mechanical propulsion with FPP		P	
Definition	297	Packaging	304
Moments of inertia	115	Part-load operation	51
Mounting points	121	Pipe dimensioning	
Multi-engine propulsion plant		Layout of pipes	180
Definition	298	Piping	
N		Materials	181
Net calorific value (NCV)		Pitch control	
Definition	298	General requirements	65
Noise		Planning data	
Airborne	104	Flow rates of cooler	79, 85
Charge air blow-off	107	Heat to be dissipated	79, 85
Exhaust gas	105	Temperature	79, 85
Intake	105	Position of the outlet casing of the turbocharger	279
Noise and vibration		Postlubrication	211
Impact on foundation	107	Power	
Nominal output		Engine ratings, outputs, speeds	40
Definition	298	Power drive connection	113, 115
NOx		Preheating	
IMO Tier II, IMO Tier III	98	At starting	48
O		Prelubrication	211
Offshore application		Preservation	304
Definition	25, 298	PrimeServ Assist	17
Oil mist detector	36, 38	Propeller	
Operating		General requirements for pitch control	65
Pressures	91	Operating range CPP	63
Standard-output (definition)	298	Pumps	
Temperatures	91	Capacities	79, 85
Operating range		R	
CPP	63	Rated power	
Operating/service temperatures and pressures	90	Definition	298
Operation		Ratings (output) for different applications, engine	43
Acceleration times	69	Reduction of load	53
Load reduction	53	Reference conditions (ISO)	41
Low load	51	Removal	
Running-in of engine	292	Cylinder liner	257
Output		Piston	257
Available outputs, related reference conditions	43, 44	Removal of corrosion protection	307
Definition	298	Room layout	253
Engine ratings, power, speeds	40	Running-in	292
ISO Standard	43		

S		Stand-by operation capability	48
Safety		Starting	48
Instructions	281	Starting air	
Measures	281	/control air consumption	77
SCR		Consumption	71, 77
System	36	receivers, compressors	235
SCR system		System description	231
Componentes	248	Starting air receivers, compressors	235
General	246	Starting air system	231
Installation	251	Start-up time	50
Recommendations	251	Static torque fluctuation	117
SCR system components		Stopping the engine	54
Overview	19	Storage	304
Service tanks capacities	97	Storage location and duration	306
Slow turn	39, 49, 50	Suction dredger application	
Smoke emission index	98	Definition	299
Space requirement for maintenance	268	Sudden load shedding	53
Spare parts	269	Supply system	
Specification		MGO	230
Cleaning agents for cooling wa- ter	159	Switching: HT	51
Combustion air	159	Switching: LT	51
Compressed air	159	Symbols	
Cooling water inspecting	159	For drawings	301
Cooling water system cleaning	159	System bus	129
Engine cooling water	159	System description	
Fuel (Gas oil, Marine gas oil)	159	Lube oil	199
Intake air (combustion air)	172	T	
Lube oil (DMA)	159	Table of ratings	40
Specification for intake air (combus- tion air)	172	Temperature	
Speed		Air	79, 85
Adjusting range	45	Cooling water	79, 85
Droop	45	Exhaust gas	79, 85
Engine ratings	44	Lube oil	79, 85
Engine ratings, power, outputs	40	Temperature control	
Idling	45	Media	147
Main data	44	Time limitation for low-load opera- tion	51
Minimum engine speed	45	Torsional vibration	110
Speeds		Turbocharger assignments	29
Clutch activation	44	Two-stage charge air cooler	36, 38
Idling	44	Type of engine start	47
Minimum engine speed	44	U	
Splash oil monitoring	36, 38	Unloading the engine	53, 55

V		Water systems	
Venting		Cooling water collecting and supply system	223
Crankcase, turbocharger	97	Engine cooling	214
Vibration, torsional	110	Miscellaneous items	223
W		Weights	
Waste gate	36, 37	Engine	30
Water		Lifting device	265
Flow rates	79, 85	SCR componentes	31
Specification for engine cooling water	159	Welding	
Water jet application		Earthing	62
Definition	299	Windmilling protection	66, 67
Water pump performance	224	Works test	286